



TESLA MOTORS, INC.
 33 HERBERT STREET
 ST. LEONARDS
 NSW 2065
 AUSTRALIA

PRELIMINARY
 NOT FOR
 CONSTRUCTION

INDICATIVE LAYOUT
 35 MW | 70 MWh

GENERAL NOTES:

- THE LAYOUTS ARE INDICATIVE AND RECOMMENDED BY TESLA.
- IF PERIMETER FENCE IS PROPOSED:
 - ADDITIONAL CLEARANCE REQUIRED FOR MEGAPACK UNIT DOOR SWING
 - GATES REQUIRED FOR MAINTENANCE TO ACCESS THE FRONT OF THE MEGAPACK UNIT AND MEGAPACK INVERTERS
- EQUIPMENT PROVIDED BY TESLA:
 - MEGAPACK
 - MV TRANSFORMERS
- 2440mm MINIMUM FRONT CLEARANCE REQUIRED FOR MAINTENANCE ACCESS BETWEEN MEGAPACKS
- TRANSFORMER DIMENSIONS ARE APPROXIMATE - ACTUAL DIMENSIONS AND CLEARANCE REQUIREMENTS MAY VARY.

28m

52m

10m
 MOBILE CRANE
 ACCESS

5.5 MVA TRANSFORMER

MEGAPACK

MINIMUM FOOTPRINT

NO.	REVISION	DATE	INIT.
1	Initial Release	12.09.19	SW

ORIGINAL SIZE:
 297x420mm
 SHEET SIZE ISO A3

SHEET TITLE
 OVERALL SITEPLAN

SHEET NUMBER
 A-101

1 PROPOSED 35 MW | 70 MWH LAYOUT
 Scale: 1:200

PROPRIETARY AND CONFIDENTIAL



TESLA MOTORS, INC.
 33 HERBERT STREET
 ST. LEONARDS
 NSW 2065
 AUSTRALIA

PRELIMINARY
 NOT FOR
 CONSTRUCTION

INDICATIVE LAYOUT
 35 MW | 70 MWh


NO.	REVISION	DATE	INIT.
1	Initial Release	12.09.19	SW

ORIGINAL SIZE:
 297x420mm
 SHEET SIZE ISO A3

SHEET TITLE
 BESS AC BLOCK

SHEET NUMBER
 A-102

E
D
C
B
A

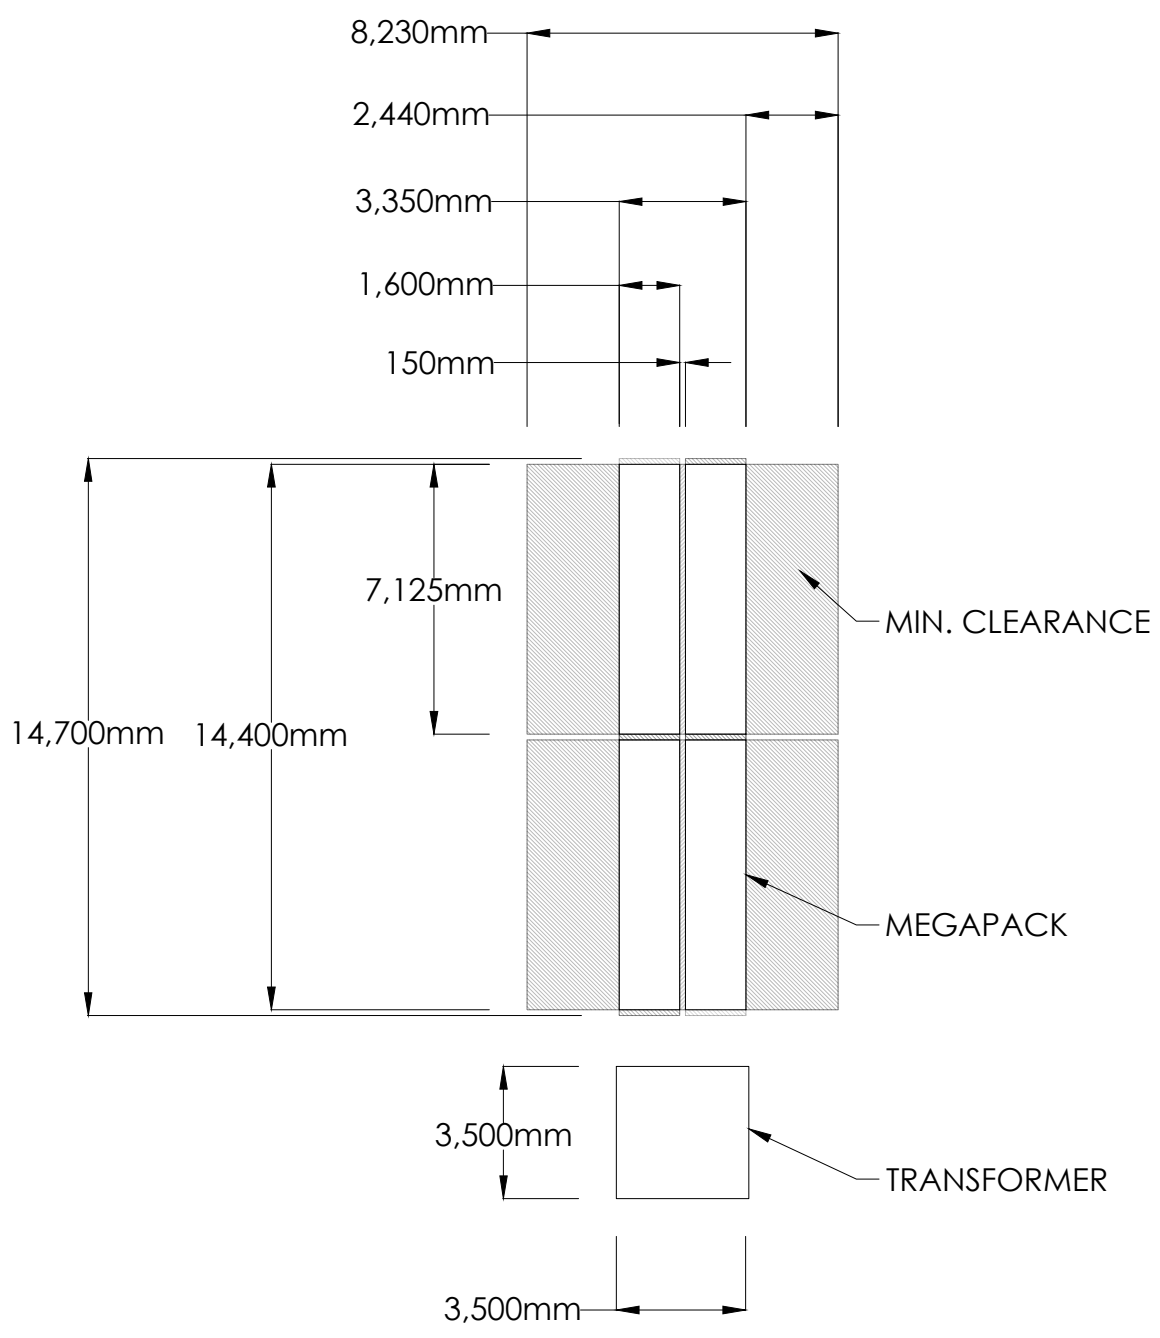


GENERAL NOTES:

- THE LAYOUTS ARE INDICATIVE AND RECOMMENDED BY TESLA.
- IF PERIMETER FENCE IS PROPOSED:
 - ADDITIONAL CLEARANCE REQUIRED FOR MEGAPACK UNIT DOOR SWING
 - GATES REQUIRED FOR MAINTENANCE TO ACCESS THE FRONT OF THE MEGAPACK UNIT AND MEGAPACK INVERTERS
- EQUIPMENT PROVIDED BY TESLA:
 - MEGAPACK
 - MV TRANSFORMERS
- 2440mm MINIMUM FRONT CLEARANCE REQUIRED FOR MAINTENANCE ACCESS BETWEEN MEGAPACKS
- TRANSFORMER DIMENSIONS ARE APPROXIMATE - ACTUAL DIMENSIONS AND CLEARANCE REQUIREMENTS MAY VARY.

② ESS BLOCK, TYP.
 Scale: 1:200

GENERAL NOTES:

1. THE LAYOUTS ARE INDICATIVE AND RECOMMENDED BY TESLA.
2. PARK CONTROLLER TO CONNECT TO METERING CLASS CT AND VT (PROVIDED BY CUSTOMER).
3. REVENUE METERING PROVIDED BY CUSTOMER.
4. THREE PHASE FAULT LEVEL AT THE MV POINT OF CONNECTION HAS BEEN ASSUMED TO BE LESS THAN 20 KVA.
5. THE SLD IS PRELIMINARY ONLY.

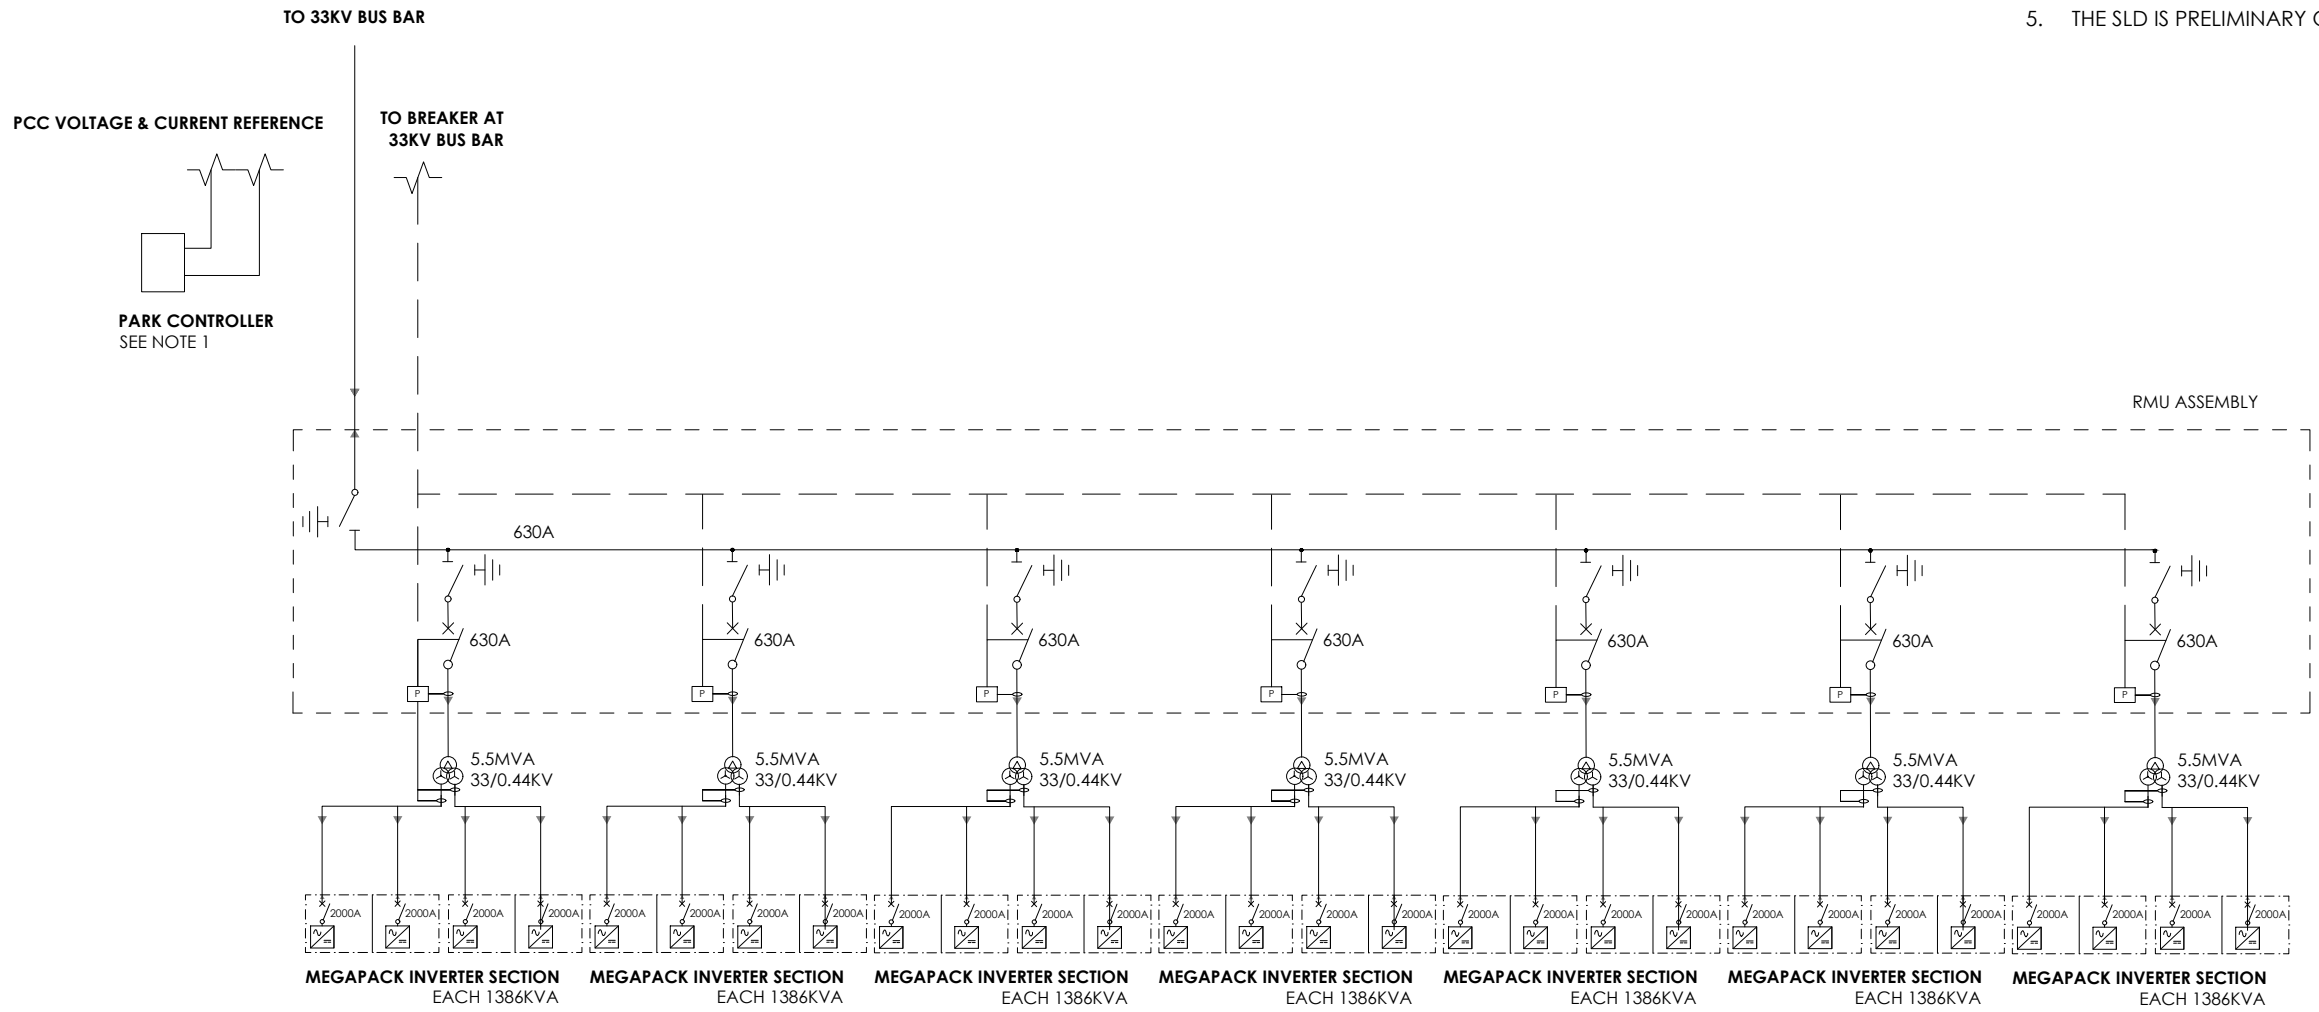

PRELIMINARY
 NOT FOR
 CONSTRUCTION

INDICATIVE SINGLE LINE
 35 MW | 70 MWh

NO.	REVISION	DATE	INIT.
1	Initial Release	12.09.19	SW

ORIGINAL SIZE:
 297x420mm
 SHEET SIZE ISO A3

SHEET TITLE
 SLD

SHEET NUMBER
 A-101

3 PRELIMINARY SLD
 Scale: NTS