



global environmental solutions

# Liverpool Range Wind Farm Noise Impact Assessment

Report Number 640.10487-R1

12 March 2014

Epuron Pty Ltd  
Level 11, 75 Miller St  
North Sydney 2060

Version: Revision 4

# Liverpool Range Wind Farm

## Noise Impact Assessment

### PREPARED BY:

SLR Consulting Australia Pty Ltd  
ABN 29 001 584 612  
Suite 6, 131 Bulleen Road Balwyn North VIC 3104 Australia

T: 61 3 9249 9400 F: 61 3 9249 9499  
E: melbourne@slrconsulting.com www.slrconsulting.com

This report has been prepared by SLR Consulting Australia Pty Ltd with all reasonable skill, care and diligence, and taking account of the timescale and resources allocated to it by agreement with the Client. Information reported herein is based on the interpretation of data collected, which has been accepted in good faith as being accurate and valid.

This report is for the exclusive use of Epuron Pty Ltd.  
No warranties or guarantees are expressed or should be inferred by any third parties.  
This report may not be relied upon by other parties without written consent from SLR Consulting.

SLR Consulting disclaims any responsibility to the Client and others in respect of any matters outside the agreed scope of the work.

### DOCUMENT CONTROL

Reference	Status	Date	Prepared	Checked	Authorised
640.10487-R1	Revision 4	12 March 2014	Philip Setton	Gustaf Reutersward	Gustaf Reutersward
640.10487-R1	Revision 3	6 December 2013	Philip Setton	Gustaf Reutersward	Gustaf Reutersward
640.10487-R1	Revision 2	13 November 2013	Philip Setton	Gustaf Reutersward	Gustaf Reutersward
640.10487-R1	Revision 1	30 November 2012	Philip Setton	Graeme Campbell	Graeme Campbell
640.10487-R1	Revision 0	29 November 2012	Philip Setton	Gustaf Reutersward	Gustaf Reutersward

## Executive Summary

SLR Consulting Australia Pty Ltd (SLR Consulting) has completed a noise impact assessment of Liverpool Range Wind Farm. The methodology and criteria used in the assessment are supported by the South Australia Environmental Protection Authority (SA EPA) *Environment Noise Guidelines for Wind Farms (February 2003)*, World Health Organisation (WHO) limits, construction noise guidelines (DECC Interim Construction Noise Guideline 2009) and blasting impact.

A layout consisting of 288 Vestas V112 Wind Turbine Generators (WTGs) has been considered and noise predictions were made for receptors within 6 km of a proposed WTG. The predicted noise levels were assessed against the relevant criteria prescribed by the SA EPA Guideline and World Health Organisation (WHO) goals where appropriate.

The predicted noise levels of the layout were determined to meet the relevant criteria at all receptor locations.

The project is yet to select and finalise the WTG make and model. Upon finalising the WTG selection a revised noise prediction and assessment will be completed to confirm compliance.

WTG vibration levels have been evaluated and based upon overseas research available were found to be acceptable.

Construction noise has been predicted to all receivers; a number of these are deemed 'noise affected' under the NSW Construction Noise Guidelines. In order to ensure all appropriate measures are being taken to manage construction noise, a more detailed construction management plan should be developed by the proponent. This document will provide detailed guidance on various noise mitigation strategies for the construction stage.

Vibration impacts from construction have been assessed and the 'worst case' scenarios modelled were found to be acceptable.

Blasting impact has been assessed against the ANZECC Guideline and found to be acceptable. With a maximum instantaneous charge (MIC) of up to 98 kg, the airblast overpressure is anticipated to be below the acceptable level of 115 dB Linear for all existing residences. Similarly, vibration levels are anticipated to be well below the acceptable criteria.

Construction traffic noise impact has been assessed and the 'worst case' maximum construction traffic scenario would comply to the NSW Road Noise Policy requirements, due to the typically large setback of dwellings from the road network. Night-time deliveries are unlikely to cause sleep disturbance based on predicted maximum noise levels.

Transmission line noise (corona noise) has also been assessed against NSW Industrial Noise Policy noise limits and has been found to be acceptable as all receiver locations are greater than 240 m from the proposed transmission line.

---

## Table of Contents

1	INTRODUCTION	8
1.1	Wind Farm Assessment Methodology	8
1.1.1	Acceptability Limit Criteria	8
1.1.2	Wind Farm Noise Level Prediction	8
1.1.3	Ambient Noise Monitoring	8
1.1.4	Assessment Procedure	9
2	ENVIRONMENTAL NOISE CRITERIA	10
2.1	Introduction	10
2.2	Applicable Noise Policies and Guidelines	10
2.3	SA EPA Wind Farm Noise Guidelines	11
2.4	NSW Industrial Noise Policy (INP)	12
2.5	World Health Organisation (WHO) Guidelines	12
2.6	Construction Noise Guidelines	13
2.7	Vibration Guidelines	15
2.7.1	Building Damage	16
2.8	Blasting Criteria	16
2.9	Traffic Noise	16
3	GENERAL SITE DESCRIPTION	18
3.1	Characteristics of the site	18
3.2	Dwelling Locations	19
4	PROPOSED WIND FARM LAYOUT	22
4.1	WTG Type and Details	22
4.2	Assessment of Tonality and Infrasound	23
5	OPERATIONAL NOISE LEVELS	24
5.1	Introduction	24
5.2	Wind Turbine Noise	24
6	BACKGROUND LEVELS AND NOISE LIMITS	28
6.1	Measurement Locations	28

---

## Table of Contents

6.2	Measurement Details	29
6.3	Night Period Analysis	30
6.4	Location D4-6 – Zone 3	31
6.5	Location E4-5 – Zone 4	32
6.6	Location C6-4 – Zone 6	33
6.7	Location G6-2 – Zone 8	34
7	ACOUSTIC ASSESSMENT OF PROPOSED WIND FARM	35
7.1	Vestas V112 Detailed Tonality assessment	36
7.2	Atmospheric stability and wind profile	36
7.3	Temperature Inversions	37
7.4	Likelihood of Enhanced Noise Generation and Propagation Conditions	38
7.5	Adaptive Management	40
7.6	Wind Turbine Vibration	40
	7.6.1 Ground borne vibration	40
	7.6.2 Air borne vibration / Infrasound	41
7.7	Substation Transformer Noise Levels	41
7.8	Transmission Line Noise (Corona Noise)	42
8	NSW DRAFT WIND FARM GUIDELINES	44
8.1	Daytime vs. Night-time Background Noise	44
8.2	Special Audible Characteristics	45
	8.2.1 Low Frequency Noise	45
	8.2.2 Tonality	45
	8.2.3 Amplitude Modulation	45
9	ASSESSMENT OF CONSTRUCTION NOISE & VIBRATION LEVELS	47
9.1	Project Construction Noise	47
9.2	Ambient Background Noise Levels	47
9.3	Noise Modelling Parameters	47
9.4	Normal Working Hours Operation	48

## Table of Contents

9.5	Outside Normal Operating Hours Operation	52
9.5.1	Concrete Batching Plants	53
9.5.2	Mitigation for Construction Noise	54
9.6	Construction Vibration Assessment	54
9.7	Blasting	55
9.7.1	Blasting Assessment	55
9.8	Traffic Noise	55
9.8.1	Night-time deliveries	56
10	CONCLUSION	57

### TABLES

Table 1	WHO Guideline values for environmental noise in specific environments	13
Table 2	Noise at Residences Using Quantitative Assessment	13
Table 3	Preferred and maximum values for continuous and impulsive vibration	15
Table 4	Blast Emission Building Damage Assessment Criteria (AS 2187)	16
Table 5	Road Traffic Noise Criteria	17
Table 6	Surrounding Receivers	20
Table 7	WTG Manufacturers Data	22
Table 8	Vestas V112 Sound Power Levels (dBA)	22
Table 9	Audible tonality assessment to IEC 61400-11	23
Table 10	Predicted Wind Turbine Noise Level (dBA) – Base Layout	24
Table 11	Measurement Locations	28
Table 12	Wind mast details	29
Table 13	Measurement Details for each Location	29
Table 14	Likelihood of High Wind Shear Exponent	39
Table 15	Proposed Substation Locations	42
Table 16	Predicted 'worst case' 250 MVA switching substation noise	42
Table 17	Background Noise Regression Curves and Correlation Coefficient	44
Table 18	NSW Draft Wind Farm Guidelines Exceedances – Night-time Criteria	44
Table 19	Typical Construction Equipment	48
Table 20	Predicted Construction Noise Levels	48
Table 21	Night Construction Noise Levels – Noise Affected Receivers	52
Table 22	Concrete Batch Plant Locations	53
Table 23	Concrete Batch Plant Noise Level Prediction	54
Table 24	Typical Vibration Emission Levels from Construction Plant	55

---

## Table of Contents

### FIGURES

Figure 1	Location of proposed Liverpool Range Wind Farm	18
Figure 2	Dwelling Locations and WTG Layout	19
Figure 3	Predicted Noise Levels Contour Map, LAeq, v <sub>ref</sub> =8m/s	27
Figure 4	Photo and Map of Location D4-6	31
Figure 5	Background Noise Measurements and Noise Criteria Curve – Location D4-6	31
Figure 6	Photo and Map of Location E4-5	32
Figure 7	Background Noise Measurements and Noise Criteria Curve – Location E4-5	32
Figure 8	Photo and Map of Location C6-4	33
Figure 9	Background Noise Measurements and Noise Criteria Curve – Location C6-4	33
Figure 10	Photo and Map of Location G6-2	34
Figure 11	Background Noise Measurements and Noise Criteria Curve – Location G6-2	34
Figure 12	Variability of Wind Shear by Month & Hour (Average)	39

### APPENDICES

Appendix A1	Assessment graphs
Appendix A2	Assessment – Tabulated results
Appendix B	WTG Sound Power Data
Appendix C	Distances to Turbines
Appendix D	Acoustic Terminology
Appendix E	Wind Turbine Coordinates and Description
Appendix F	NSW Draft Wind Farm Guidelines Analysis

## 1 INTRODUCTION

SLR Consulting Australia Pty Ltd (SLR Consulting), has been engaged by Epuron Pty Ltd (Epuron) as the acoustical consultants for the proposed Liverpool Range Wind Farm.

This report describes the methodology and findings of the Noise Impact Study (NIS) for the proposed Liverpool Range Wind Farm forming part of the Environmental Impact Assessment for the proposed project.

Detailed in this report are the main aspects of the proposed wind farm project, the acoustic criteria, the background noise measurements and the predicted noise levels at all potentially impacted receivers from the operation of the proposed wind farm. It also addresses the acoustic impact of the wind farm during the construction phase, including blasting and transportation noise.

### 1.1 Wind Farm Assessment Methodology

#### 1.1.1 Acceptability Limit Criteria

The methodology and acceptability limit criteria that have been applied to this study are based upon the *South Australia Environment Protection Authority (SA EPA) Noise Guidelines for Wind Farms (February 2003)* (SA EPA Guidelines). The principal acceptability limit criteria is that the wind farm  $L_{eq,(10 \text{ min})}$  noise should not exceed the greater of an amenity limit of 35 dBA or the pre-existing background noise,  $L_{90,(10 \text{ min})}$  by more than 5 dBA (for any given wind speed).

The project requirements and wind farm acceptability limit criteria are discussed in more detail in **Section 6**.

#### 1.1.2 Wind Farm Noise Level Prediction

The noise emission model used in this study to predict wind farm noise levels at sensitive receptors is based on ISO 9613-2:1996 as implemented in the SoundPLAN computer noise model. The model predicts noise levels through spherical spreading and includes the effect of air absorption (as per ISO 9613), ground attenuation and shielding.

Predicted  $L_{Aeq}$  noise levels were calculated based upon sound power levels determined in accordance to the recognised standard IEC-61400-11:2002 (*Wind Turbine Generator Systems - Part 11: Acoustic Noise Measurement Techniques*), where available, for the wind range 3 to 12 m/s.

The noise character of Wind Turbine Generator (WTG) noise emissions is also assessed for any special audible characteristics, such as tonality or low frequency content, which would be deemed more annoying or offensive. If sufficient characteristics such as tonality are identified then the predicted noise level would be penalised by the addition of 5 dBA. It should be noted that the characteristic noise level modulation of WTGs, commonly referred to as 'swish', is considered to be a fundamental part of wind farm noise and is taken into account by the SA EPA Guideline assessment procedure.

#### 1.1.3 Ambient Noise Monitoring

In order to establish the intrusive noise limit, background noise monitoring is required to establish the pre-existing ambient noise environment as a function of wind speed. As wind speed increases the ambient noise level at most receivers generally also increases as natural sources such as wind in trees begin to dominate. The variation of background noise with wind speed is usually quite site specific and related to various physical characteristics such as topographic shielding and the extent and height of exposed vegetation.



Noise monitoring is completed for a period of approximately 2 weeks and correlated to synchronous wind speed and direction data measured at the wind farm monitoring mast. The captured data is screened for validity, with data monitored during periods of rain or where the average wind speed at the microphone position likely exceeded 20 m/s (hub height) being discarded from the data set. Other data that was obviously affected by external noise sources (eg pond pumps, grass mowing, birds at dawn, frogs etc) was also removed from the data set. A regression analysis of all valid data is used to determine a line of 'best fit' from which the noise limit is established.

#### **1.1.4 Assessment Procedure**

In general, the assessment procedure contains the following steps:

- 1 Predict and plot the  $L_{Aeq}$  35 dBA noise level contour from the wind farm under reference conditions. Receivers outside the contour are considered to be within acceptable wind farm noise levels.
- 2 Establish the pre-existing background noise level at each of the relevant assessment receivers within the  $L_{Aeq}$  35 dBA noise level contour through background noise monitoring.
- 3 Predict wind farm noise levels at all relevant assessment receivers for the wind range from cut-in of the WTG to approximately 10 m/s (at hub height).
- 4 Assess the acceptability of wind farm noise at each relevant assessment receiver to the established limits.

In addition, where the assessment of a receiver has predicted unacceptable wind farm noise levels, a process of noise mitigation and alternative wind farm layouts is considered and Steps 3 and 4 are repeated until an acceptable arrangement is developed.

A brief explanation and description of the acoustic terminology used in this report is included in **Appendix D**.

## 2 ENVIRONMENTAL NOISE CRITERIA

### 2.1 Introduction

The New South Wales (NSW) Government Department of Planning and Infrastructure (DOPI) has issued information on the required inputs into the Environmental Assessment (EA). The environmental assessment requirements issued by the Director-General (DGRs) in relation to noise impacts are:

- Include a comprehensive noise assessment of all phases and components of the project including turbine operation, the operation of the electrical substation, corona and / or Aeolian noise from the transmission line, construction noise (focusing on high noise generating construction scenarios and works outside of standard construction hours) traffic noise during construction and operation, and vibration generating activities (including blasting) during construction and / or operation. The assessment must identify noise/vibration sensitive locations (including approved but not yet developed dwellings), baseline conditions based on monitoring results, the levels and character of noise (e.g. tonality, impulsiveness, low frequency etc) generated by noise sources, noise vibration criteria, modelling assumptions and worst case and representative noise/vibration impacts;
- In related to wind turbine operation, determine the noise impacts under operating meteorological conditions (i.e. wind speeds from cut in to rated power), including impacts under meteorological conditions that exacerbate impacts (including varying atmospheric stability classes and the van den Berg effect for wind turbines). The probability of such occurrences must be quantified;
- Include monitoring to ensure that there is adequate wind speed/profile data and ambient background noise data that is representative for all sensitive receptors;
- Provide justification for the nominated average background noise level used in the assessment process, considering any significant difference between day time and night time background noise levels higher than 30 dB(A)
- Identify any risks with respect to low frequency or infra-noise;
- Clearly outline the noise mitigation, monitoring and management measures that would be applied to the project. This must include an assessment of the feasibility, effectiveness and reliability of the proposed measures and any residual impacts after these measures have been incorporated;
- If any noise agreements with residents are proposed for areas where noise criteria cannot be met, provide sufficient information to enable a clear understanding of what has been agreed and what criteria have been used to frame any such agreements;
- Include a contingency strategy that provides for additional noise attenuation should higher noise levels than those predicted result following commissioning and/or noise agreements with landowners not eventuate.

### 2.2 Applicable Noise Policies and Guidelines

The assessment must be undertaken consistent with the following guidelines for each aspect of the project.

- *Wind Turbines - the South Australian Environment Protection Authority's Wind Farms - Environmental Noise Guidelines (2003);*
- *Electrical Substation – NSW Industrial Noise Policy (EPA 2000)*
- *Site Establishment and Construction – Interim Construction Noise Guidelines (DECCW, 2009);*
- *Traffic Noise – Environmental Criteria for Road Traffic Noise (NSW EPA, 1999); and*
- *Vibration – Assessing Vibration: A Technical Guideline (DECCW, 2006).*

## 2.3 SA EPA Wind Farm Noise Guidelines

The South Australia EPA Noise Guidelines for Wind Farms, 2003 (SA EPA Guidelines) recommends the following noise criteria for new wind farms,

*“The predicted equivalent noise level ( $L_{Aeq, 10min}$ ), adjusted for tonality in accordance with these guidelines, should not exceed:*

- 35 dBA, or
- the background noise level by more than 5 dBA,

*whichever is the greater, at all relevant receivers for each integer wind speed from cut-in to rated power of the WTG.”*

These guidelines also provide information on measuring the background noise levels, locations and requirements on the number of valid data points to be obtained and the methodology for excluding invalid data points. It also outlines the process for determining lines of best fit for the background data, and determination of the noise limit.

The Guideline explicitly states that the “swish” or normal modulation noise from wind turbines is a fundamental characteristic of such turbines; however, it specifies that tonal or annoying characteristics of turbine noise should be penalised.

A 5 dBA penalty should be applied to the measured noise level if an “authorised” officer determines that tonality is an issue and that tonality should be assessed in a way acceptable to the EPA.

The Guideline does not provide an assessment for the potential of low frequency noise or infrasound, but it does state that recent turbine designs do not appear to generate significant levels of infrasound, as the earlier turbine models did.

The Guideline accepts that wind farm developers commonly enter into agreements with private landowners in which they are provided compensation. The guideline is intended to be applied to premises that do not have an agreement with the wind farm developers. This does not absolve the obligations of the wind farm developer entirely as appropriate action can be taken under the *Environmental Protection Act* if a development ‘unreasonably interferes’ with the amenity of an area. The guideline lists that there is unlikely to be unreasonable interference if:

- a formal agreement is documented between the parties
- the agreement clearly outlines to the landowner the expected impact of the noise from the wind farm and its effect on the landowner’s amenity
- the likely impact of exposure will not result in adverse health impacts (e.g. the level does not result in sleep disturbance)

The proponent Epuron has discussed the possible noise implications of the various proposed turbine layouts with the involved residents whose property the turbines would be located on and will enter into agreements with these parties. The full noise assessment will be made available to all residents as part of the exhibited Environmental Assessment on the EPA website.

These agreements would specify that:

(a) Epuron would ensure that the properties met the World Health Organisation noise guidelines (see **Section 2.5**); and,

(b) Epuron would implement an adaptive management approach which could include the use of building treatments and turbine operation / management strategies if operational noise causes significant impact to the amenity of involved residents.

This noise agreement would only be required under those turbine configurations where the SA EPA Guidelines would be exceeded for that particular property.

## 2.4 NSW Industrial Noise Policy (INP)

The NSW Industrial Noise Policy (INP) requirements include site selection for background measurements, description of the site, the equipment used, graphing of results and amenity noise criteria during each of the three periods (Day, Evening and Night).

The proposed site for the Liverpool Range Wind Farm is in a rural area and therefore the Amenity Criteria for rural residential receivers, as detailed in Table 2.1 in the NSW INP, is applicable.

The criteria vary as a function of time of day. The Day, Evening and Night Periods are defined as:

Day Period	7:00 am - 6:00 pm 8:00 am - 6:00 pm (Sundays and Public Holidays)
Evening Period	6:00 pm - 10:00 pm
Night Period	10:00 pm - 7:00 am 10:00 pm - 8:00 am (Sundays and Public Holidays)

The Amenity Criteria ( $L_{Aeq}$  level) for the residential noise sensitive locations for the Liverpool Range Wind Farm project are,

Day Period	50 dBA
Evening Period	45 dBA
Night Period	40 dBA

The Intrusiveness Criterion in the INP is based on the rating background level (RBL), where the Criterion is,

$$L_{Aeq, 15 \text{ min}} \leq \text{RBL} + 5 \text{ dBA}$$

This is almost identical to the SA EPA Guidelines (**Section 2.3**), the difference being the measurement interval (15 minute versus 10 minute) and the determination of the background noise level (RBL, based on the 10<sup>th</sup> percentile of measured background levels, or using a line of best fit through the data points).

The INP states where the measured RBL is less than 30 dBA, then the RBL is considered to be 30 dBA.

In summary it is evident that the non project related residential receivers assessed under the SA EPA Wind Farm Guideline will generally comply to INP amenity criteria. Furthermore, intrusiveness is covered by the SA EPA Wind Farm Guideline.

## 2.5 World Health Organisation (WHO) Guidelines

The WHO publication 'Guidelines for Community Noise' identifies the main health risks associated with noise and derives acceptable environmental noise limits for various activities and environments.

The appropriate guideline limits are listed in **Table 1** below.

**Table 1 WHO Guideline values for environmental noise in specific environments**

Specific Environment	Critical Health Effect(s)	Leq (dBA)	Time base (hours)	LMax (dBA, Fast)
Outdoor living area	Serious Annoyance, daytime & evening	55	16	-
	Moderate annoyance, daytime & evening	50	16	-
Dwelling indoors	Speech Intelligibility & moderate annoyance, daytime & evening	35	16	
Inside bedrooms	Sleep disturbance, night-time	30	8	45
Outside bedrooms	Sleep disturbance – window open, night-time	45	8	60

Where noise levels at project-involved residences do not comply with the SA EPA Guidelines, the proponent intends to enter into agreements with the owners of those residences to achieve noise criteria in accordance with World Health Organisation (WHO) Guidelines. The proponent will apply those guidelines as necessary to ensure that the project does not result in an ‘unreasonable interference’ with the amenity or cause any adverse health effects at those residences. (See **Section 2.3**)

For the assessment of project involved residences the adopted external criteria of 45 dBA or the level given by the SA EPA Guideline criteria, where higher, will be adopted. Effectively this becomes 45 dBA or background + 5 dBA, whichever is the higher.

## 2.6 Construction Noise Guidelines

The Department of Environment, Climate Change and Water (DECCW) issued the “*Interim Construction Noise Guideline*” in July 2009. The main objectives of the guideline are stated in Section 1.3, a portion of which is presented below:

- promote a clear understanding of ways to identify and minimise noise from construction works.
- focus on applying all ‘feasible’ and ‘reasonable’ work practices to minimise construction noise impacts.
- encourage construction to be undertaken only during the recommended standard hours unless approval is given for works that cannot be undertaken during these hours.

The guideline sets out Noise Management Levels (NMLs) at residences, and how they are to be applied, as presented in **Table 2**. This approach intends to provide respite for residents exposed to excessive construction noise outside the recommended standard hours whilst allowing construction during the recommended standard hours without undue constraints.

**Table 2 Noise at Residences Using Quantitative Assessment**

Time of Day	Management Level LAeq(15minute) <sup>1</sup>	How to Apply
Recommended standard hours:	Noise affected RBL + 10 dBA	The noise affected level represents the point above which there may be some community reaction to noise.
Monday to Friday 7.00 am to 6.00 pm		Where the predicted or measured LAeq(15minute) is greater than the noise affected level, the proponent should apply all feasible and reasonable work practices to minimise noise.
Saturday 8.00 am to		The proponent should also inform all potentially impacted residents of the nature of works to be carried out, the expected noise levels and duration, as well as contact details.

<b>Time of Day</b>	<b>Management Level LAeq(15minute)<sup>1</sup></b>	<b>How to Apply</b>
1.00 pm  No work on Sundays or public holidays	Highly noise affected 75 dBA	The highly noise affected level represents the point above which there may be strong community reaction to noise.  Where noise is above this level, the proponent should consider very carefully if there is any other feasible and reasonable way to reduce noise to below this level.  If no quieter work method is feasible and reasonable, and the works proceed, the proponent should communicate with the impacted residents by clearly explaining the duration and noise level of the works, and by describing any respite periods that will be provided.
Outside recommended standard hours	Noise affected RBL + 5 dBA	A strong justification would typically be required for works outside the recommended standard hours.  The proponent should apply all feasible and reasonable work practices to meet the noise affected level.  Where all feasible and reasonable practices have been applied and noise is more than 5 dBA above the noise affected level, the proponent should negotiate with the community.

Note 1: Noise levels apply at the property boundary that is most exposed to construction noise. If the property boundary is more than 30 m from the residence, the location for measuring or predicting noise levels is at the most noise-affected point within 30 m of the residence.

## 2.7 Vibration Guidelines

Impacts from vibration can be considered both in terms of effects on building occupants (human comfort) and the effects on the building structure (building damage). Of these considerations, the human comfort limits are the most stringent. Therefore, for occupied buildings, if compliance with human comfort limits is achieved, it will follow that compliance will be achieved with the building damage objectives.

The DECCW's *Assessing Vibration: A Technical Guideline* provides acceptable values for continuous and impulsive vibration based upon guidelines contained in BS 6472–1992, *Evaluation of human exposure to vibration in buildings (1–80 Hz)*.

Both preferred and maximum vibration limits are defined for various locations and are shown in **Table 3**, with the preferred night-time PPV criteria of 0.2 mm/s being the most relevant to the project.

**Table 3** Preferred and maximum values for continuous and impulsive vibration

Location	Assessment period <sup>1</sup>	Preferred values RMS acceleration m/s <sup>2</sup>		Maximum values RMS acceleration m/s <sup>2</sup>		Peak Velocity PPV mm/s	
		z-axis	x- and y-axes	z-axis	x- and y-axes	Preferred	Maximum
<b>Continuous vibration</b>							
Critical areas <sup>2</sup>	Day- or night-time	0.0050	0.0036	0.010	0.0072	0.14	0.28
Residences	Daytime	0.010	0.0071	0.020	0.014	0.28	0.56
	night-time	0.007	0.005	0.014	0.010	0.20	0.40
Offices, schools, educational institutions and places of worship	Day- or night-time	0.020	0.014	0.040	0.028	0.56	1.1
Workshops	Day- or night-time	0.04	0.029	0.080	0.058	1.1	2.2
<b>Impulsive vibration</b>							
Critical areas <sup>2</sup>	Day- or night-time	0.0050	0.0036	0.010	0.0072	0.14	0.28
Residences	Daytime	0.30	0.21	0.60	0.42	8.6	17.0
	night-time	0.010	0.0071	0.020	0.014	2.8	5.6
Offices, schools, educational institutions and places of worship	Day- or night-time	0.64	0.46	1.28	0.92	18.0	36.0
Workshops	Day- or night-time	0.64	0.46	1.28	0.92	18.0	36.0

1 Daytime is 7.00 am to 10.00 pm and night-time is 10.00 pm to 7.00 am

2 Examples include hospital operating theatres and precision laboratories where sensitive operations are occurring. There may be cases where sensitive equipment or delicate tasks require more stringent criteria than the human comfort criteria specified above. Stipulation of such criteria is outside the scope of this policy, and other guidance documents (e.g. relevant standards) should be referred to. Source: BS 6472–1992

These limits relate to a long-term (16 hours for daytime), continuous exposure to vibration sources. Where vibration is intermittent, a higher level of vibration is typically acceptable.

### 2.7.1 Building Damage

In regard to potential building damage, the German Standard DIN4150 recommends a limit of 10 mm/s PPV within any building and the British Standard BS7385: Part 2 - 1993 sets a limit within buildings which depends upon the vibration frequency, but is as low as 7.5 mm/s PPV (at 4.5Hz). For the purposes of ensuring a reasonable factor of safety a conservative limit of approximately 5 mm/s PPV has been applied for this project.

## 2.8 Blasting Criteria

The ground vibration and airblast levels which cause concern or discomfort to residents are generally lower than the relevant building damage limits.

The DECCW advocates the use of the Australian and New Zealand Environment Conservation Council (ANZECC) guideline “*Technical basis for guidelines to minimise annoyance due to blasting overpressure and ground vibration*” for assessing potential residential disturbance arising from blast emissions. The ANZECC guidelines for control of blasting impact at residences are as follows:

- The recommended maximum level for airblast is 115 dB Linear. The level of 115 dB Linear may be exceeded on up to 5% of the total number of blasts over a period of 12 months. The level should not exceed 120 dB Linear at any time.
- The recommended maximum for ground vibration is 5 mm/s, Peak Vector Sum (PVS) vibration velocity. It is recommended however, that 2 mm/s (PVS) be considered as the long term regulatory goal for the control of ground vibration. The PVS level of 5 mm/s may be exceeded on up to 5% of the total number of blasts over a period of 12 months. The level should not exceed 10 mm/s at any time.
- Blasting should generally only be permitted during the hours of 9:00 am to 5:00 pm Monday to Saturday. Blasting should not take place on Sundays and public holidays.
- Blasting should generally take place no more than once per day.

The Australian Standard 2187.2-1993 “*Explosives - Storage, Transport and Use. Part 2: Use of Explosives*” does not present human comfort criteria for ground vibration from blasting. It does however make mention of human comfort level for airblast in saying “a limit of 120 dB for human comfort is commonly used”. This is consistent with the ANZECC guidelines.

AS 2187.2-1993 nominates building damage assessment criteria as presented in **Table 4**.

**Table 4 Blast Emission Building Damage Assessment Criteria (AS 2187)**

Building Type	Vibration Level	Airblast Level (dB re 20 µPa)
<b>Sensitive (and Heritage)</b>	PVS 5 mm/s	133 dB(Linear) Peak
<b>Residential</b>	PVS 10 mm/s	133 dB(Linear) Peak
<b>Commercial/Industrial</b>	PVS 25 mm/s	133 dB(Linear) Peak

## 2.9 Traffic Noise

The NSW *Environmental Criteria for Road Traffic Noise* (ECRTN May 1999) as required by the Director General Requirements presents guidelines for the assessment of road traffic noise arising from new or redeveloped roads.



Subsequent to the issuing of the DGR's the Department of Environment, Climate Change and Water NSW (DECCW) superseded ECRTN with the publication of NSW Road Noise Policy (RNP) in March 2011. The document provides road traffic noise guidelines for a range of road or residential developments, as well as guidelines that apply for other nominated sensitive land uses.

The road traffic guidelines recommended are based on the functional categories of the subject roads, as applied by the Roads Traffic Authority (RTA).

The functional categories are as follows:

- Arterial roads (including freeways) carrying predominantly through-traffic from one region to another, forming principal avenues of communication for urban traffic movements.
- Sub-arterial roads connecting the arterial roads to areas of development and carrying traffic from one part of a region to another. They may also relieve traffic on arterial roads in some circumstances.
- Local roads, which are the subdivisional roads within a particular developed area. These are used solely as local access roads

For this project, traffic associated with the construction stage has the potential to increase noise levels on existing arterial and local roads during the day (no night period construction proposed). As such, the relevant traffic noise criteria, as provided in Table 3 of the NSW RNP, are provided in **Table 5** below.


**Table 5 Road Traffic Noise Criteria**

Type of Development	Criteria	
	Day 7am - 10pm (dBA)	Where Criteria are Already Exceeded
Existing residences affected by additional traffic on existing freeways/arterial/sub-arterial roads generated by land use developments	L <sub>Aeq</sub> (15hour) 60 dBA	In all cases, the redevelopment should be designed so as not to increase existing noise levels by more than 2 dBA.
Existing residences affected by additional traffic on existing local roads generated by land use developments	L <sub>Aeq</sub> (1hour) 55 dBA	In all cases, the redevelopment should be designed so as not to increase existing noise levels by more than 2 dBA.

### 3 GENERAL SITE DESCRIPTION

The proposed Liverpool Range Wind Farm site is in northern NSW, between the regional towns of Cassilis and Coolah, north of the Great Dividing Range and west of Coolah Tops National Park. Location map indicating the approximate region of the proposed Liverpool Range Wind Farm is shown in **Figure 1** below.

**Figure 1** Location of proposed Liverpool Range Wind Farm

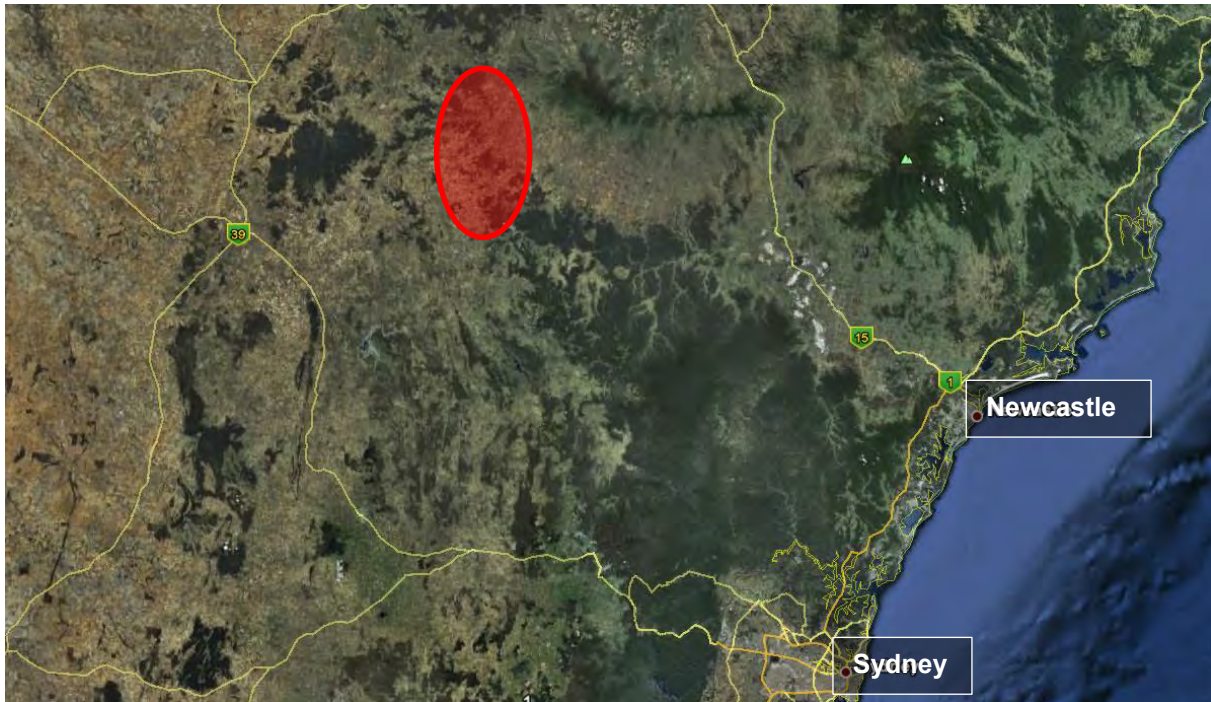

#### 3.1 Characteristics of the site

The proposed project site incorporates up to 21 landowners. A numerical noise assessment has been carried out for all dwellings within 6 km of a turbine using the noise limit set in SA EPA Guidelines. Dwellings further than this distance are deemed to comply if dwellings closer to the wind farm comply with the SA EPA noise limit.

Topographically, the proposed site runs along a series of ridgelines running northeast-to-southwest. The ridges are approximately 700m above sea level, with the majority of the receptor on flat terrain either side of the ridgelines, or in the valleys between the ridges approximately 550 to 450 m above sea level.

The surrounding district is primarily used for agricultural (grazing) purposes with several densely vegetated areas scattered around and within the proposed wind farm allotment. The township of Coolah lies approximately 6 kilometres to the east of the proposed wind farm.


All properties surrounding the proposed wind farm site are expected to have an ambient background noise environment that is determined by pre-dominantly natural sources which are largely wind-influenced.

Prevailing winds are from the south east. The district receives approximately 600 mm – 700 mm of rainfall annually.

### 3.2 Dwelling Locations

Figure 2 shows all locations assessed (shown in blue) and the turbine positions for the layout considered. SLR Consulting has presented the assessment with receivers grouped into 11 zones, labelled below. (See Section 6 for a more detailed explanation.)

Figure 2 Dwelling Locations and WTG Layout

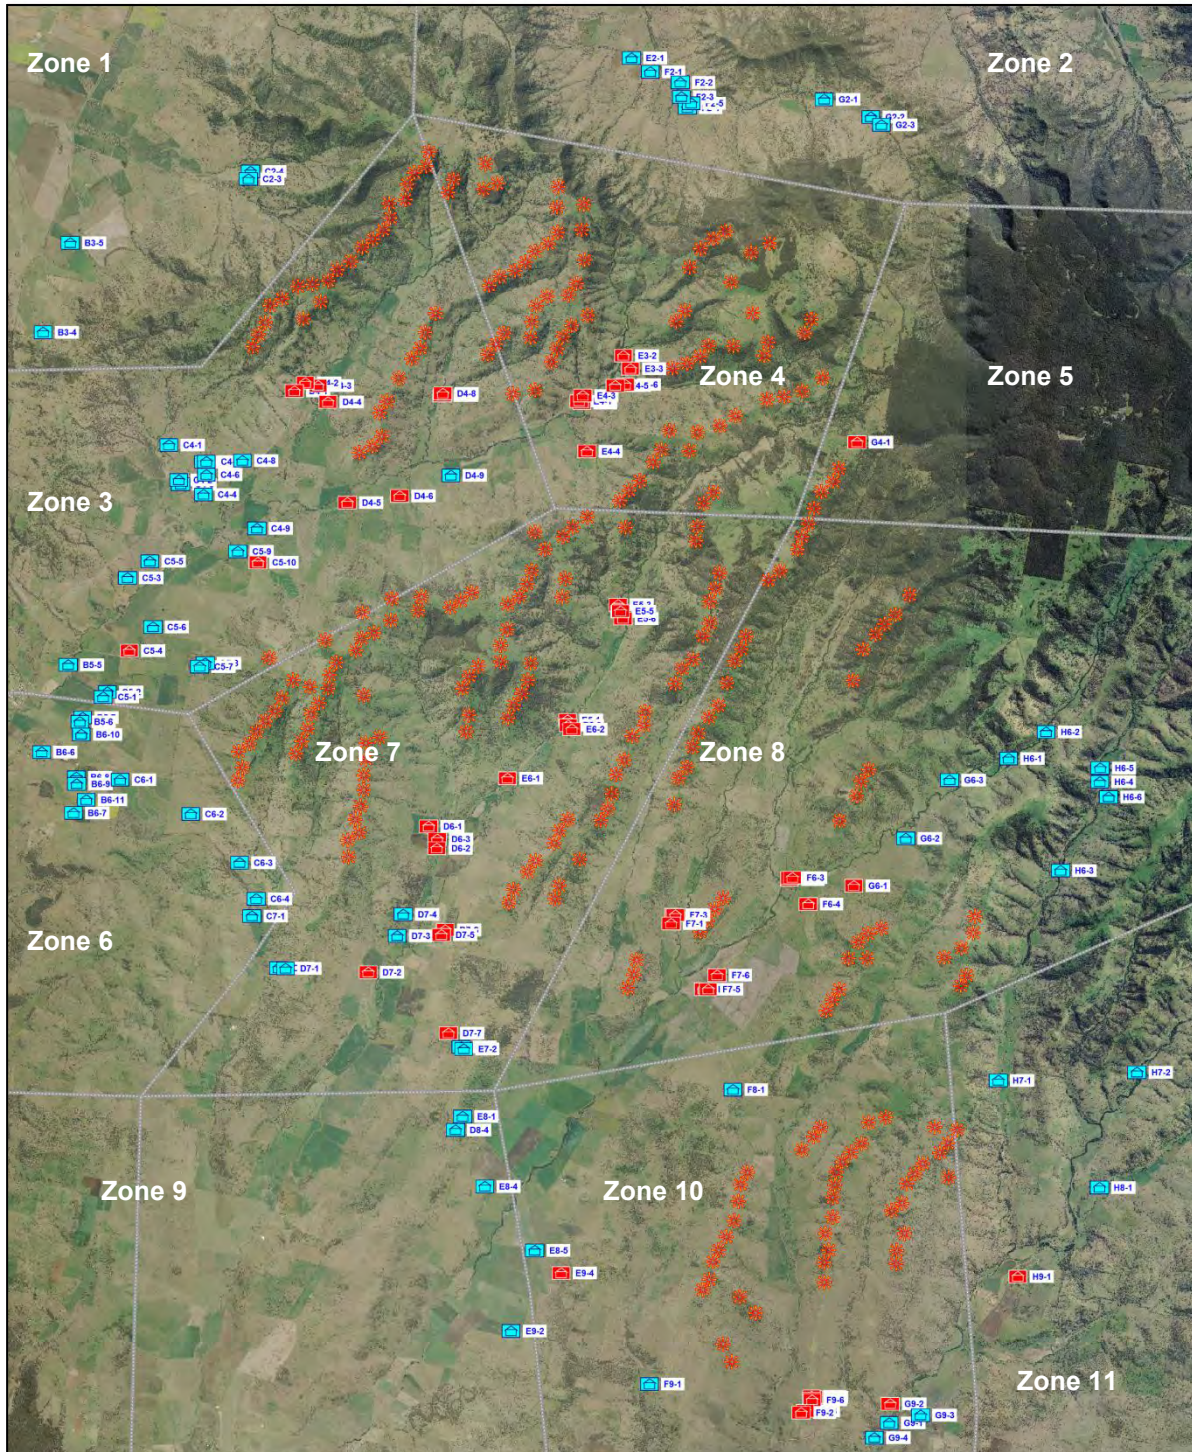

**Table 6** lists all receiver locations, their positions and identifies those that are project involved. Other dwellings located beyond 6 km of a proposed WTG are not considered within this assessment, primarily as WTG noise is unlikely to be audible at these distances and compliance to noise criteria more critical at closer receivers. All eastings and northings use reference MGA94 Zone 55.

**Table 6 Surrounding Receivers**

Location	Easting (m)	Northing (m)	Location	East (m)	North (m)
B3-4	758390	6486058	E4-6*	774681	6484593
B3-5	759148	6488555	E5-1*	773065	6475200
B5-5	759094	6476746	E5-2*	773092	6475057
B5-6	759412	6475153	E5-3*	774485	6478428
B5-7	759494	6475275	E5-4*	774532	6478237
B6-6	758343	6474300	E5-5*	774556	6478244
B6-7	759236	6472605	E5-6*	774620	6478043
B6-8	759315	6473604	E6-1*	771386	6473570
B6-9	759330	6473411	E6-2*	773187	6474948
B6-10	759459	6474801	E7-1	770093	6466051
B6-11	759597	6472970	E7-2	770164	6465993
C2-3	764134	6490350	E8-1	770133	6464104
C2-4	764191	6490559	E8-4	770749	6462144
C4-1	761908	6482895	E8-5	772152	6460352
C4-2	762190	6481915	E9-2	771488	6458097
C4-3	762238	6481795	E9-4*	772890	6459717
C4-4	762874	6481513	F2-1	775382	6493341
C4-5	762878	6482423	F2-2	776225	6493044
C4-6	762958	6482067	F2-3	776258	6492638
C4-7	762958	6482433	F2-4	776417	6492338
C4-8	763965	6482463	F2-5	776525	6492461
C4-9	764371	6480560	F6-1*	779283	6470731
C5-1	760070	6475843	F6-2*	779289	6470778
C5-2	760190	6475987	F6-3*	779360	6470786
C5-3	760755	6479176	F6-4*	779804	6470050
C5-4*	760800	6477141	F7-1*	775970	6469502
C5-5	761379	6479642	F7-2*	776035	6469752
C5-6	761460	6477801	F7-3*	776084	6469736
C5-7*	762771	6476691	F7-4*	776870	6467660
C5-8*	762926	6476796	F7-5*	777002	6467659
C5-9	763840	6479921	F7-6*	777255	6468058
C5-10*	764398	6479612	F8-1	777698	6464852
C6-1	760542	6473529	F9-1	775364	6456611
C6-2	762522	6472569	F9-2*	779611	6455812
C6-3	763886	6471207	F9-3*	779714	6455866

Location	Easting (m)	Northing (m)	Location	East (m)	North (m)
C6-4	764351	6470201	F9-4*	779892	6456264
C7-1	764232	6469712	F9-5*	779898	6456207
C7-2	764972	6468258	F9-6*	779913	6456165
D4-1*	765422	6484412	F9-7*	779942	6456248
D4-2*	765727	6484644	G2-1	780254	6492574
D4-3*	766088	6484562	G2-2	781560	6492081
D4-4*	766362	6484106	G2-3	781848	6491865
D4-5*	766906	6481291	G4-1*	781170	6482977
D4-6*	768370	6481475	G6-1*	781085	6470560
D4-7*	769558	6484285	G6-2	782538	6471887
D4-8*	769576	6484342	G6-3	783765	6473517
D4-9	769800	6482050	G9-1	782075	6455530
D6-1*	769184	6472228	G9-2*	782098	6456061
D6-2*	769411	6471608	G9-3	782953	6455739
D6-3*	769414	6471866	G9-4	781651	6455110
D7-1	765177	6468242	G10-1	780504	6453557
D7-2*	767488	6468138	G10-2	780694	6453578
D7-3	768296	6469155	G10-3	780764	6453747
D7-4	768469	6469763	G10-4	780852	6453776
D7-5*	769535	6469184	G10-5	780994	6453869
D7-6*	769644	6469327	G10-7	781115	6453948
D7-7*	769734	6466440	G10-8	781147	6453997
D8-4	769927	6463730	H6-1	785415	6474126
E1-1	773391	6496054	H6-2	786466	6474865
E2-1	774854	6493728	H6-3	786868	6470984
E3-2*	774634	6485402	H6-4	787970	6473475
E3-3*	774826	6485037	H6-5	787978	6473858
E4-1*	773390	6484129	H6-6	788211	6473047
E4-2*	773466	6484080	H7-1	785125	6465108
E4-3*	773492	6484278	H7-2	789007	6465336
E4-4*	773616	6482725	H8-1	787952	6462116
E4-5*	774406	6484563	H9-1*	785676	6459623

Note: \* Denotes the location is involved with the project

A description of the nearest 25 WTG's to each receptor location is compiled in **Appendix C**.

## 4 PROPOSED WIND FARM LAYOUT

### 4.1 WTG Type and Details

The WTG manufacturer and model has not yet been finalised, and accordingly it is necessary to evaluate the wind farm based on a typical turbine model that may comprise a layout. The base layout presented in this report is a 288 WTG layout, the considered WTG model is the Vestas V112 3.0MW.

The WTG considered is three bladed, upwind, pitch regulated and active yaw. A comprehensive tabulated listing of WTG coordinates for the layout is included in **Appendix E**. Should an alternative selection or turbine type or layout be finalised then a revised noise impact assessment prediction will be completed.

**Table 7** and **Table 8** summarise the relevant turbine input data used for noise level prediction.

**Table 7 WTG Manufacturers Data**

Make, model, power	Vestas V112 3.0MW
Rotor diameter	112 m
Hub height	84 m
Cut-in wind speed	3 m/s
Rated wind speed	12 m/s
Rotor speed	4.4 – 17.7 rpm
'Standard Mode' Sound Power Level, $L_{WA,ref}$ 8 m/s	106.5 dBA

**Table 8 Vestas V112 Sound Power Levels (dBA)**

Wind Turbine Model	Wind speed $V_s$ (10m AGL) (m/s)									
	3	4	5	6	7	8	9	10	11	12
Standard Mode (Mode 0)	94.5	97.4	100.9	104.3	106.0	106.5	106.5	106.5	106.5	106.5

Noise emissions for the proposed WTG have been provided by the manufacturer and have either been independently tested according to International Standard IEC 61400-11. Copies of the certification test or manufacturers documentation that give the sound power level variation with wind speed, frequency spectra and tonality assessment have been provided by Epuron and will be made available on request.

The noise emissions of each WTG were modelled at a hub height of 80 m above ground level. The reference sound power values listed, based on a hub height of 84 m above ground level, are still valid for prediction purposes.

The relationship between ground level wind speed and hub height wind speed is specified as part of the measurement standard IEC 61400-11 (Section 8.1 – Wind Speed). This same equation is used to convert 10 m AGL wind speed back to hub height wind speed, using a roughness of 0.05.

Specifically the equation is:

$$\frac{V_s}{V_z} = \frac{\ln\left(\frac{z_{ref}}{z_{0,ref}}\right) \times \ln\left(\frac{H}{z_0}\right)}{\ln\left(\frac{H}{z_{0,ref}}\right) \times \ln\left(\frac{z}{z_0}\right)}$$

Considering the difference in predicted wind speed (8m/s 10 m AGL) from the logarithmic profile law between 80 m and 84 m hub heights, the difference in wind speed would be 0.07 m/s. The corresponding difference in emitted sound power level would be negligible.

It is therefore determined that differences from the change in hub height would have negligible difference to the noise predictions presented.

#### 4.2 Assessment of Tonality and Infrasound

WTG manufacturers are obliged to conduct independent tests in accordance with IEC 61400-11. A part of this assessment is to conduct a tonal audibility test. The tonal audibility  $\Delta L_{t,a}$  is assessed using the methodology outlined in *Joint Nordic Method Version 2 – Objective Method for Assessing the Audibility of Tones in Noise*.

The tonal audibility data  $\Delta L_{A,k}$  values have been supplied by the WTG manufacturers as follows:

**Table 9 Audible tonality assessment to IEC 61400-11**

Wind Turbine Model	Wind speed Vs (10m AGL) (m/s)									
	3	4	5	6	7	8	9	10	11	12
Standard Mode - Mode 0				-1.97	-3.04	-13.27	-11.88	-9.19		

Infrasound is not tested as an obligatory part of IEC 61400-11. It is noted that, in general, modern WTG's do not exhibit significant infrasound emissions. Refer to **Section 7.1** for a more detailed discussion.

## 5 OPERATIONAL NOISE LEVELS

### 5.1 Introduction

As discussed in **Section 1.1.2**, a three-dimensional computer noise model was used to predict LAeq noise levels from all WTG's at all surrounding residential dwellings.

The ISO 9613 noise model incorporates a 'hard ground' assumption and includes one-third octave band calculated effects for air absorption, ground attenuation and topographic shielding. It is noted that ISO 9613 equations predict for average downwind propagation conditions and also hold for average propagation under a well-developed moderate ground-based temperature inversion.

The estimated accuracy of the prediction model is approximately  $\pm 3$  dBA.

### 5.2 Wind Turbine Noise

For indicative purposes the WTG noise levels from the proposed WTG layout was calculated for the reference wind condition of 8 m/s at 10m AGL and listed in **Table 10**. The predicted noise contour plot is presented in **Figure 3**.

**Table 10 Predicted Wind Turbine Noise Level (dBA) – Base Layout**

Location	Predicted Noise Level, Leq dBA	Location	Predicted Noise Level, Leq dBA
B3-4	23.1	E4-6*	39.9
B3-5	24.2	E5-1*	40.5
B5-5	28.8	E5-2*	40.5
B5-6	29	E5-3*	38.2
B5-7	29.3	E5-4*	38.4
B6-6	27.4	E5-5*	38.3
B6-7	27.8	E5-6*	38.2
B6-8	28.7	E6-1*	39.6
B6-9	28.5	E6-2*	40.5
B6-10	29.2	E7-1	28.2
B6-11	28.7	E7-2	28.4
C2-3	31.6	E8-1	27.4
C2-4	29.6	E8-4	26.4
C4-1	30.3	E8-5	26.6
C4-2	30.9	E9-2	24.5
C4-3	31	E9-4*	27.9
C4-4	32.3	F2-1	29.3
C4-5	31.5	F2-2	29
C4-6	31.7	F2-3	29.7



<b>Location</b>	<b>Predicted Noise Level, Leq dBA</b>
C4-7	31.2
C4-8	33.2
C4-9	34.3
C5-1	30.5
C5-2	30.8
C5-3	30.7
C5-4*	31.5
C5-5	31.2
C5-6	31.7
C5-7*	34.9
C5-8*	35.3
C5-9	33.8
C5-10*	34.6
C6-1	30.9
C6-2	34.9
C6-3	34.9
C6-4	33.5
C7-1	32.4
C7-2	27.7
D4-1*	37.8
D4-2*	38.2
D4-3*	38.6
D4-4*	37.4
D4-5*	37.5
D4-6*	38.5
D4-7*	41.1
D4-8*	41.3
D4-9	37.3
D6-1*	38.5
D6-2*	37.7
D6-3*	37.9
D7-1	27.1
D7-2*	31.6

<b>Location</b>	<b>Predicted Noise Level, Leq dBA</b>
F2-4	30.1
F2-5	29.9
F6-1*	36.5
F6-2*	36.5
F6-3*	36.5
F6-4*	37.5
F7-1*	41.8
F7-2*	41.7
F7-3*	42.1
F7-4*	37.3
F7-5*	37.2
F7-6*	38.3
F8-1	34.3
F9-1	31.1
F9-2*	32.9
F9-3*	32.9
F9-4*	31.8
F9-5*	31.3
F9-6*	31.4
F9-7*	30.4
G2-1	26.9
G2-2	25.3
G2-3	25.1
G4-1*	39.3
G6-1*	38.6
G6-2	35.4
G6-3	31.4
G9-1	27.1
G9-2*	27
G9-3	29.6
G9-4	25.7
G10-1	24
G10-2	24.6

Location	Predicted Noise Level, Leq dBA	Location	Predicted Noise Level, Leq dBA
D7-3	32.4	G10-3	24.4
D7-4	32.9	G10-4	24.7
D7-5*	34.2	G10-5	24.6
D7-6*	34.5	G10-7	24.9
D7-7*	29.1	G10-8	24.8
D8-4	26.9	H6-1	28.9
E1-1	24.7	H6-2	26.1
E2-1	28.9	H6-3	30.3
E3-2*	39.9	H6-4	24.5
E3-3*	40.5	H6-5	24.4
E4-1*	40.4	H6-6	26.1
E4-2*	40.1	H7-1	32.6
E4-3*	40.4	H7-2	24.6
E4-4*	39.7	H8-1	26.1
E4-5*	39.5	H9-1*	32

Note: \* Denotes the location is involved with the project


Furthermore, noise levels from the proposed wind farm were calculated for all integer wind speeds in the range of 3 m/s to 12 m/s (at 10m AGL) at all surrounding assessment receivers within 6 km of a WTG. Whilst the rated wind speed of the WTG's is typically 13 m/s to 14 m/s, published manufacturers sound power level test data (IEC 61400-11) has only been generated as high as 12 m/s. It should be noted that noise produced by WTG's begins to 'plateau off' at higher wind speeds and because of the higher masking background noise level at higher wind speeds, noise impacts and compliance are not critical at these speeds. The assessed wind range sufficiently covers the most noise critical operational conditions.

For ease of presentation, the assessment has been grouped in 11 zones, as shown in **Figure 2**. Where a zone has had no background regression line determined, a noise limit of 35 dBA for non-project involved receivers and 45 dBA for project involved receivers, for all wind speeds, has been applied to that zone. This can be considered a conservative approach.

To compare predicted noise levels with the assessment criteria, the wind speed data measured at several heights above ground level was extrapolated to a hub height of 80 m using the logarithmic profile law<sup>1</sup> by Epuron (Refer to **Section 6**). The assessment graphs of WTG operational noise levels were prepared and are depicted in **Appendix A1**.

<sup>1</sup> (Section 8 Data reduction procedures, page 20, International Standard IEC61400-11 ©IEC:2002+A1:2006 (E) 'Wind Turbine Generator Systems – Part 11: Acoustic noise measurement techniques').

Figure 3 Predicted Noise Levels Contour Map, LAeq, v<sub>ref</sub>=8m/s

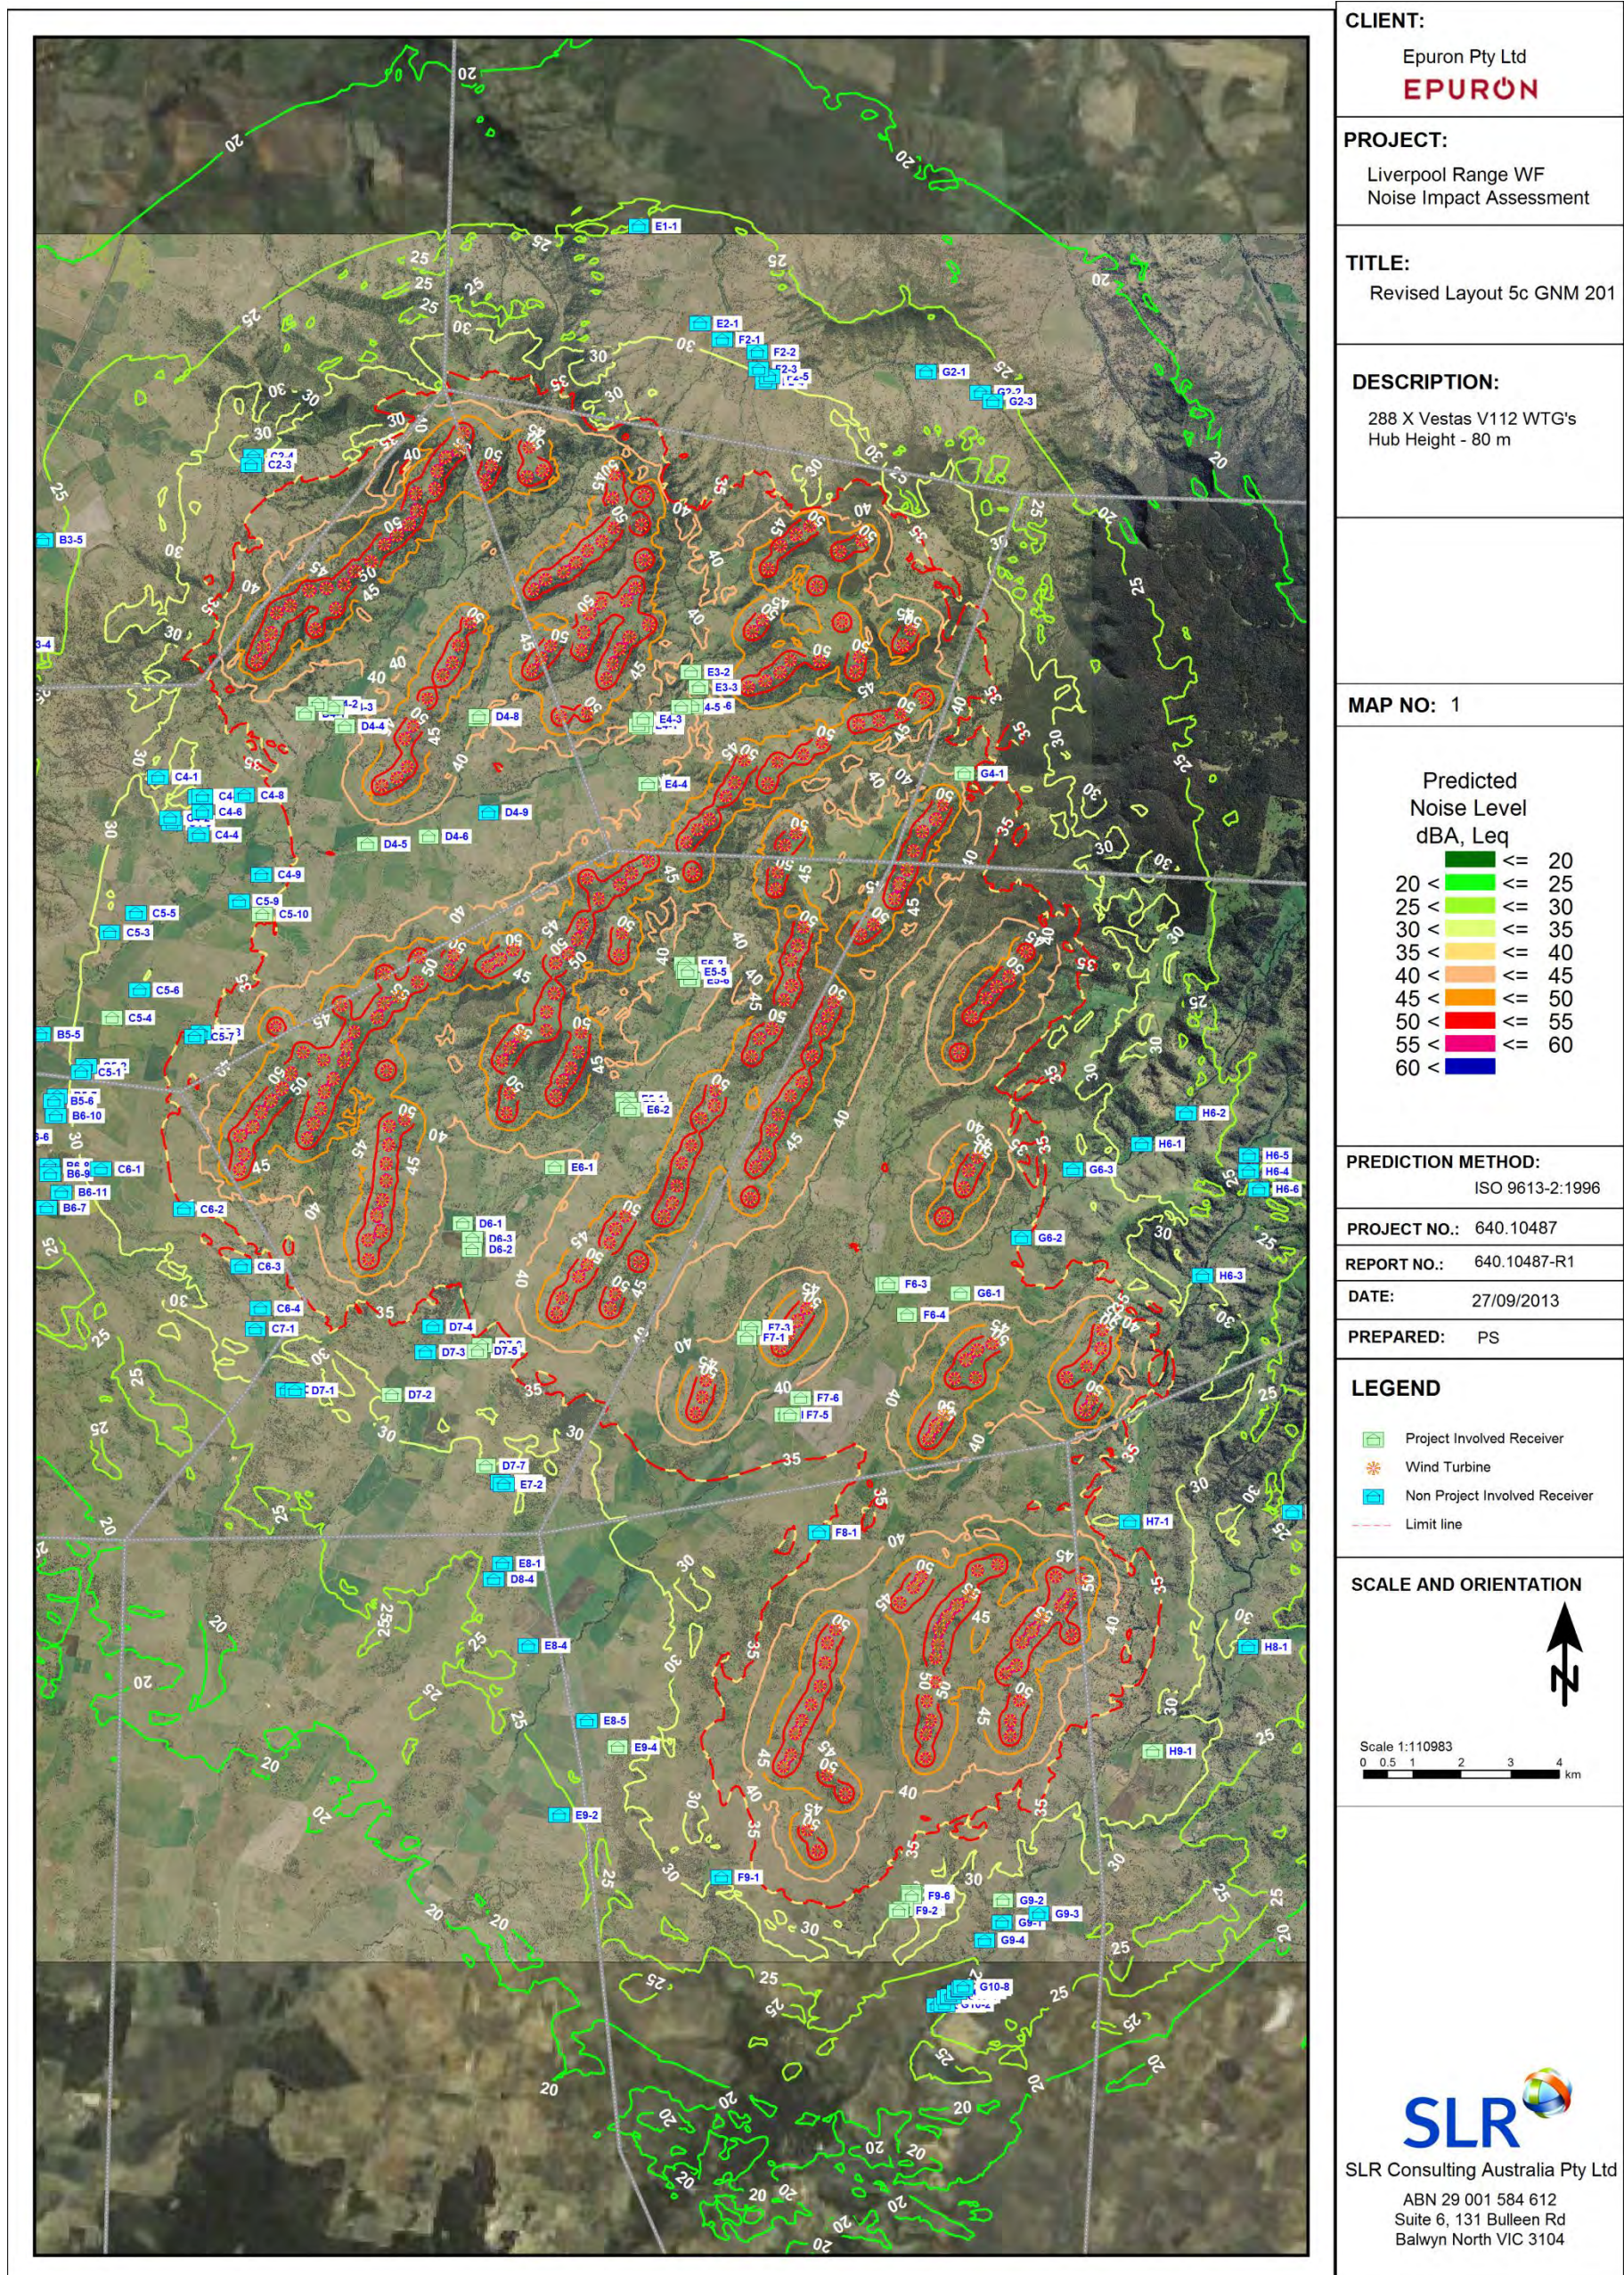

## 6 BACKGROUND LEVELS AND NOISE LIMITS

Background noise measurements were conducted at a total of 12 locations around the site. Detailed analysis of the background noise was prioritised based on the comparison of the predicted noise levels to a limit of 35 dBA for non-project involved receivers and 45 dBA for project involved receivers. (See **Section 7** for full explanation). The following sections that derive the background noise curve apply to the five monitoring locations that were relevant to the predicted exceedances of simplified noise limit.

### 6.1 Measurement Locations

The locations for the background noise measurements were selected by SLR Consulting on the basis of preliminary predicted WTG noise levels as well as proximity and similarity to other receptors.

Monitoring equipment was deployed by Epuron and photos taken at each location. The SA EPA Guidelines recommend that the measurement locations should be located at least 5 metres from a reflecting surface (other than the ground) and within 20 metres of a residence.

The relative proximity of some receiver locations to one another and their similar wind exposure and surrounding environment meant that background noise monitoring could be conducted at one representative location and be considered indicative of other similar locations.

Detailed analysis of monitoring data was conducted at 4 locations around the proposed wind farm site. These background noise monitoring locations, along with the allocated Zone for that location are listed in **Table 11**. Zones without background monitoring data had a flat 35 dBA limit applied for all wind speeds for non-project involved receivers. A full list of allocated zone for each receiver can be found in **Appendix C**.

**Table 11 Measurement Locations**

Location	Relevant Zone	Number of Receivers in Zone
D4-6	Zone 3	29
E4-5	Zone 4	8
C6-4	Zone 6	13
G6-2	Zone 8	19

At each location noise monitoring equipment was placed in the vicinity of the residence and the position of the monitoring equipment was documented with photographs.

A single weather station was deployed by Epuron near the monitoring sites. The weather data was used to identify and exclude any data collected during rain periods, which may have affected the background noise levels. The measured data for rain confirmed that the monitoring period was generally dry and as a result only a small number of data points were rejected due to rain.

Any periods of data that were clearly affected by extraneous noise sources (eg pumps, insects, birds, frogs etc) were removed from the analysis data set. If after exclusion there were not sufficient valid data points, the loggers were typically re-deployed to obtain a more complete data set.

The SA EPA Guidelines require measurements to be conducted in 10 minute intervals, while the NSW INP request 15 minute interval data. Given that almost all wind data, including the wind farm site monitored data, is in 10 minute intervals, this period was used for all measurements.

Simultaneous noise monitoring and wind monitoring was conducted during the period 19 September 2012 to 4 November 2012. Additional monitoring for Zone 6 was conducted between 13 August 2013 and 16 September 2013. Wind speed was monitored at 2 wind masts, both located on the proposed site. Wind speed for a given background monitoring location was allocated to the wind mast nearest to that location.

**Table 12 Wind mast details**

Wind Mast	Easting	Northing	Nearest Background Locations
LVP1	766406	6476284	G6-2
LVP3	778217	6486597	D4-6, E4-5, C5-4

Wind speed at a height of 80 metres AGL was provided by Epuron. Wind speed at this height was derived by measuring at 70 m AGL and scaling the data via the logarithmic law profile to 80 m AGL using wind speed measurements of 31m, 42 m, 59 m and 70 m.

Local noise data was then correlated to the 80 m AGL wind speed.

## 6.2 Measurement Details

The measurement location, monitoring period, and serial number of the Type 2 RION NL42 noise loggers used by Epuron for all testing are summarised in **Table 13**, along with the number of valid data points for each location.

The SA EPA Guideline recommends a set of approximately 2,000 valid data points. Any data points adversely affected by extraneous noise were excluded.

The measured background noise levels ( $L_{A90}$ ) are then plotted against the 80 meter wind speed to obtain a background versus wind speed characteristic.

The line of best fit for the data set is then determined, as required by the SA EPA Guideline, using a linear, second order (quadratic) or third order (cubic) polynomial. The Guideline requires that the correlation coefficient ( $R^2$  value) for each line type be reported and the line of best fit with the highest correlation coefficient used. At each location the cubic polynomial gave the highest correlation and was therefore used for the line of best fit.

**Table 13 Measurement Details for each Location**

Measurement Location	Measurement Period	Noise Logger Model # Serial number	Total No. of monitoring intervals	No. of valid data points		Correlation Coefficient ( $R^2$ )		
				All	Night	Linear	Quad.	Cubic
D4-6**	18/10/2012 to 1/11/2012	RION NL42 S/N 810841	2046	1504	687	0.3233	0.3322	0.3524
E4-5*	20/9/2012 to 17/10/2012	RION NL42 S/N 810712	3838	2460	896	0.1008	0.1167	0.1358
G6-2	24/9/2012 to 2/11/2012	RION NL42 S/N 810713	3515	2943	1160	0.3128	0.3128	0.3136
C6-4	13/8/2013 to 16/9/2013	RION NL42 S/N 810841	4911	4595	1717	0.1946	0.2735	0.2738

Note that '+' denotes a location with fewer than 2000 monitoring intervals

Note that '\*\*' denotes a project involved location

The number of valid data points at location D4-6 fell short of the recommended 2000 intervals due to data exclusion of local, extraneous noise sources.

Correlation coefficients ( $R^2$ ) ranged from approximately 0.13 to 0.35; lower correlation coefficients occur where background noise levels are not determined by local wind-driven sources. This may be for a multitude of reasons including:

- Lack of nearby foliage.
- Other dominant sources, traffic, insects, frogs etc.
- Location is sheltered from wind by topography.
- Atmospheric conditions of high stability or ground level detachment.

Most of these effects are likely to vary on a seasonal basis. The SA EPA guideline does not recommend a minimum cut-off value for correlation coefficient,  $R^2$ . Higher correlations may be yielded from detailed directional sector analysis, however this may be of limited value where all receiver locations in a zone are project involved and do not rely on the background-based limits.

### **6.3 Night Period Analysis**

A reduced data set was created for the night period (10:00 pm to 7:00 am). The resulting data sets typically included 650 to 1700 data points and were fitted with a cubic polynomial regression line of best fit.

The regression line for night-only data is generally lower than that for all data by between 1 dB to 5 dB and varies considerably from location to location. Lower night data is attributed to two main factors. Firstly that extraneous noise sources (animals, traffic etc) are lower during the night period and secondly that the wind shear for the night period is usually greater compared to the day period which results in lower ground level wind speeds for a given hub height reference wind speed and hence lower wind related background noise levels.

The resulting effect on project involved receptors' criteria with consideration to only the lower night period background data is generally minimal with the criteria being exactly the same (eg for project involved locations the criteria is a flat 45 dBA) or marginally higher at high wind speeds where compliance is more easily achieved.


The criteria for project uninvolved receptors with consideration to only the night period background data is generally marginally lower at higher wind speeds. As this is typically not the most critical wind range for compliance the net effect of night data based criteria is negligible with regards to compliance.

### 6.4 Location D4-6 – Zone 3

Location D4-6 is located to the north of the proposed wind farm allotment, between the ridges for turbines D4-1, D4-2 etc and D5-21 and D5-22. The nearest proposed turbine to this location is approximately 1.6 km away.


This residence is occupied by one of the landowners that make up part of the proposed Liverpool Range Wind Farm site and is therefore considered 'project involved'.

**Figure 4 Photo and Map of Location D4-6**

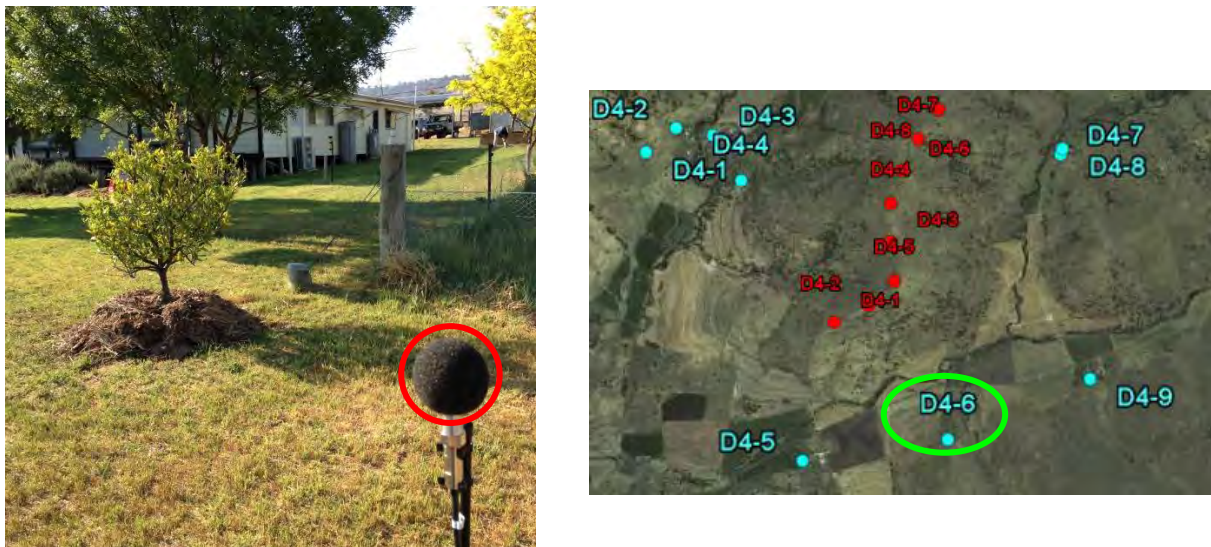

The results of the background noise monitoring showing the data points, line of best fit and criteria curve for Zone 3 are shown in **Figure 5**.

**Figure 5 Background Noise Measurements and Noise Criteria Curve – Location D4-6**

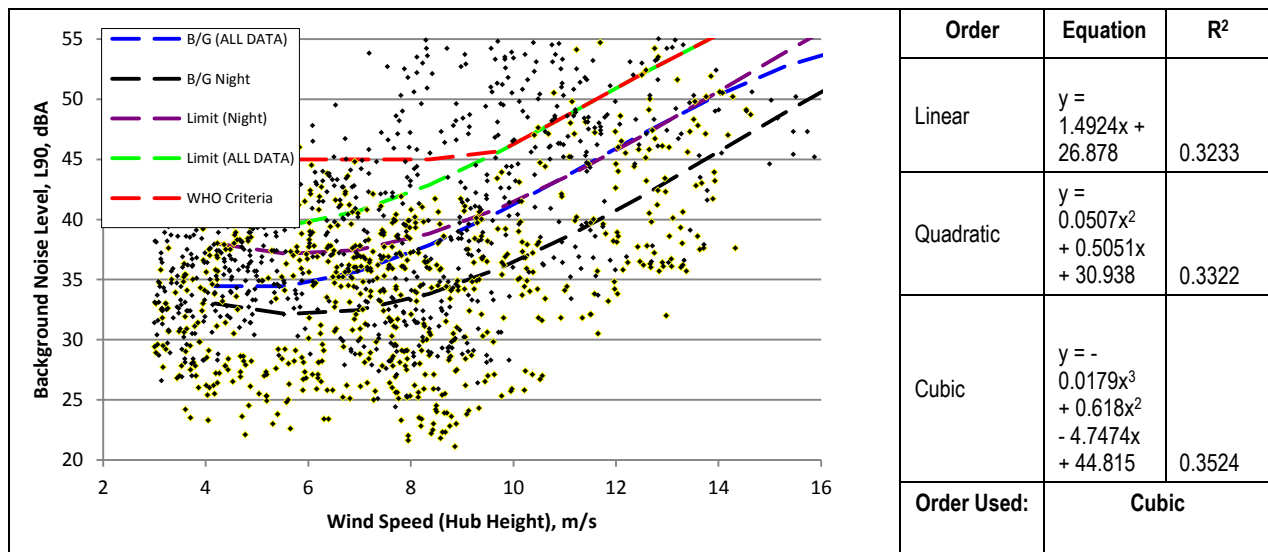

### 6.5 Location E4-5 – Zone 4

Location E4-5 is located in the northern section of the proposed wind farm allotment, between the ridges for turbines F4-42, F4-43 etc. The nearest proposed turbine to this location is approximately 1.7 km away. It lies in a valley with wind turbines to the north-east, north-west and south-east.


This residence is occupied by one of the landowners that make up part of the proposed Liverpool Range Wind Farm site and is therefore considered 'project involved'.

**Figure 6 Photo and Map of Location E4-5**



The results of the background noise monitoring showing the data points, line of best fit and criteria curve for Zone 4 are shown in **Figure 5**.

**Figure 7 Background Noise Measurements and Noise Criteria Curve – Location E4-5**

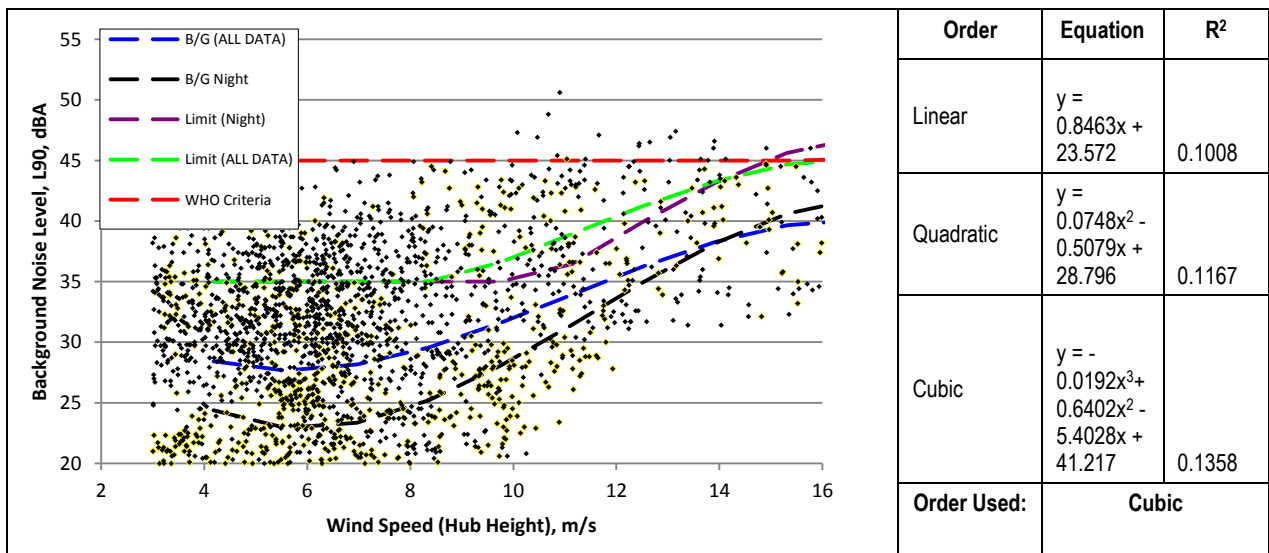




## 6.6 Location C6-4 – Zone 6


Location C6-4 is located to the west of the proposed wind farm allotment, at the bottom of the ridges for C6-5, C6-4 and D6-3, D6-2, respectively. The nearest proposed turbine to this location is approximately 2.8 km away.

**Figure 8 Photo and Map of Location C6-4**

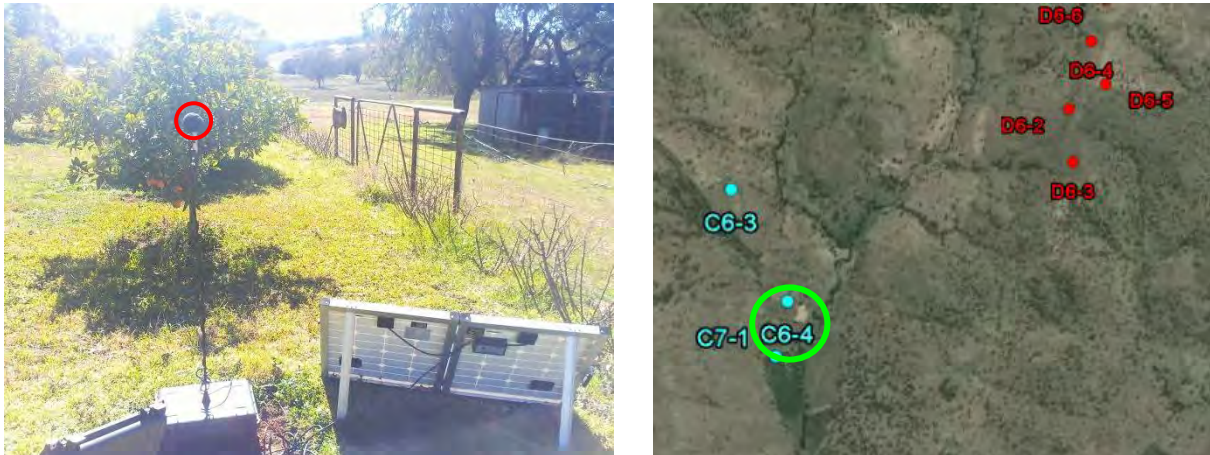

The results of the background noise monitoring showing the data points, line of best fit and criteria curve for Zone 6 are shown in Figure 5.


**Figure 9 Background Noise Measurements and Noise Criteria Curve – Location C6-4**

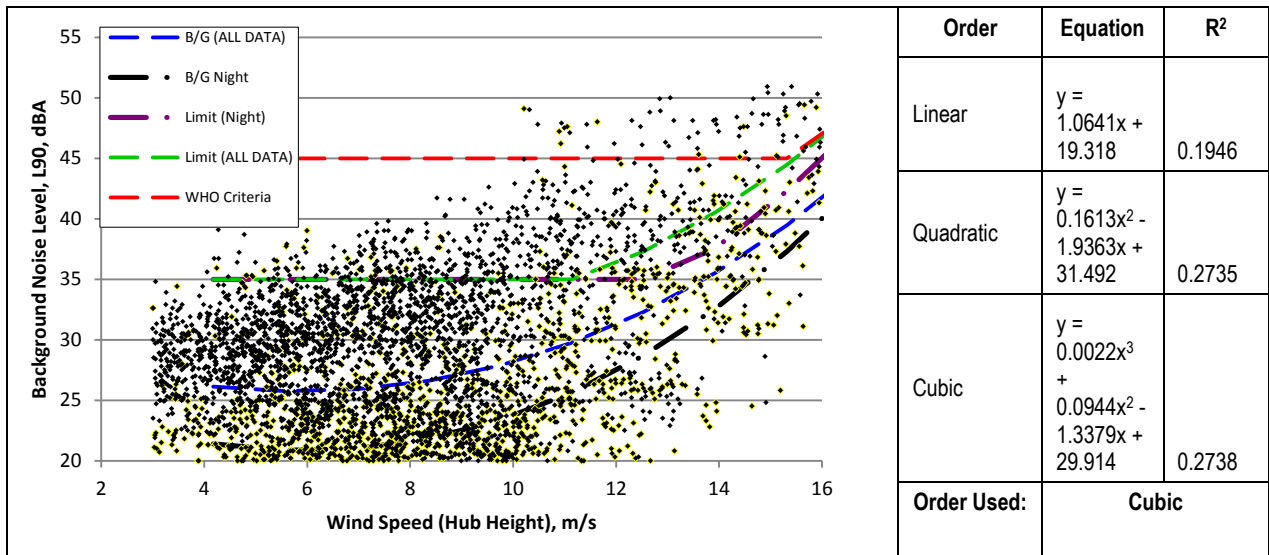

## 6.7 Location G6-2 – Zone 8


Location G6-2 is located to the east of the proposed wind farm allotment, at the bottom of the ridge for turbines G6-5, G6-2 etc. The nearest proposed turbine to this location is approximately 1.8 km away.

**Figure 10 Photo and Map of Location G6-2**

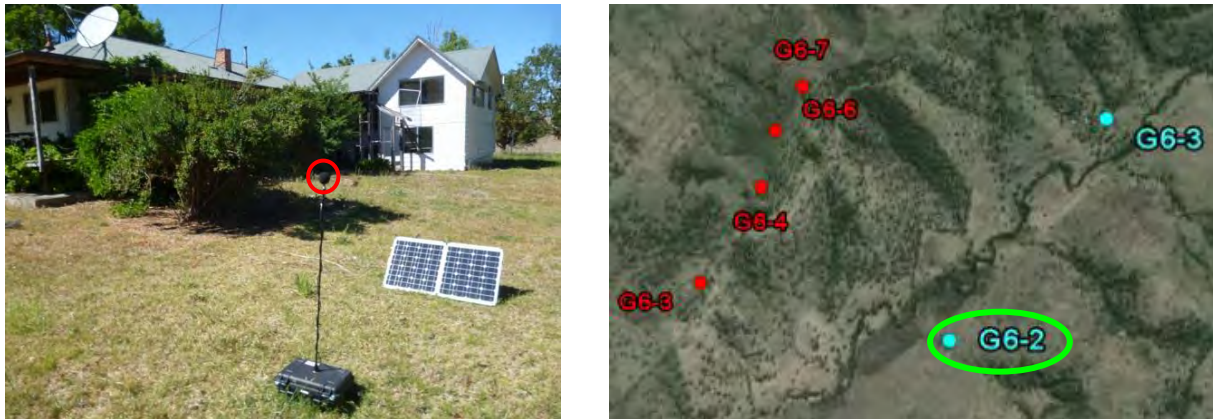

The results of the background noise monitoring showing the data points, line of best fit and criteria curve for Zone 8 are shown in **Figure 5**.

**Figure 11 Background Noise Measurements and Noise Criteria Curve – Location G6-2**

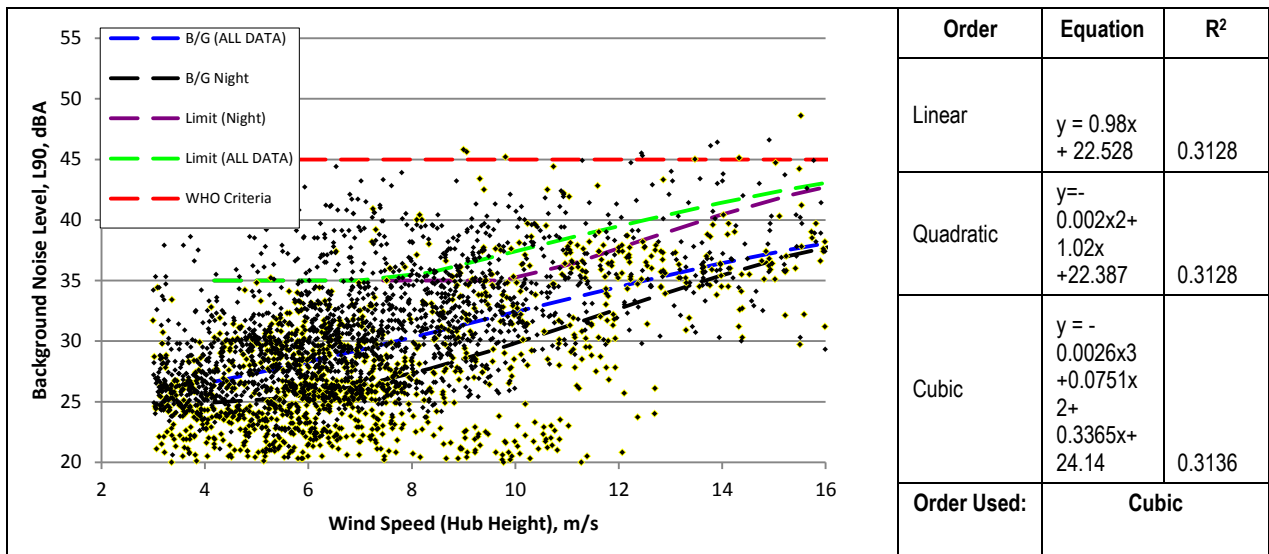

## 7 ACOUSTIC ASSESSMENT OF PROPOSED WIND FARM

An assessment of the acceptability of wind farm noise levels at all assessment receivers located within 6 km of a turbine using the noise limit set in SA EPA Guidelines has been completed. Dwellings further than this distance are deemed to comply if dwellings closer to turbines comply with the SA EPA noise limit.

The proponent Epuron intends to enter into noise agreements with some project involved residences prior to construction. Under the SA EPA Guidelines these residences are not required to comply to the 35 dBA or 'background + 5 dBA' limits. However, it is necessary to ensure that the project does not result in an 'unreasonable interference' with the amenity of these areas or cause any adverse health effects. Therefore for the assessment of project involved residences the adopted external criteria of 45 dBA (as per the WHO guidelines) or the level given by the SA EPA Guideline criteria, where higher, will be adopted. Effectively this becomes 45 dBA or background + 5 dBA, whichever is the higher. (See **Section 2.5** for details)

Preliminary analysis was undertaken and a simplified limit of 35 dBA for project uninvolved receivers and 45 dBA for project involved receivers was adopted. As the sound power curve for the Vestas V112 model attains a maximum at 8m/s and above, the predicted noise level from the SoundPlan model as presented in **Table 10** (page 24), was compared to the simplified limit. Locations which had a predicted exceedance of the simplified criteria had background regression curves derived for the nearest monitoring location. The pre-existing background noise level regression analysis used to set the background + 5 dBA limit curve is detailed in **Section 6**.

Predicted external noise levels will be further mitigated by shielding effects of the building, with the anticipated internal noise levels similarly reduced by the façade of the dwelling.

It should be further noted that all predicted noise levels are considered to be conservative with the model assuming 'hard ground' and average downwind propagation from all WTG's to each receiver or a well-developed moderate ground based temperature inversion.

Predicted noise levels for a reference wind speed of 8 m/s are shown in **Table 10** (See **Section 5.2**), based on the sound power levels provided by the manufacturer at this wind speed.

The assessment figures contained in **Appendix A1** and **Appendix A2** depict the predicted WTG noise level curves for the proposed WTG layout, superimposed over SA EPA Guideline Criteria and WHO based noise limits. Background noise curves are shown for the five locations analysed in **Section 6**.

All receiver locations are predicted to comply with their respective criteria.

## 7.1 Vestas V112 Detailed Tonality assessment

IEC 61400-11:2002 is the measurement standard used for determining the sound power in one-third octave bands for wind turbines, as measured in the near field. In addition, the standard uses narrow band analysis to quantify tones in the measured sound power spectrum. The result of this test is the tonal audibility criterion  $\Delta L_{A,k}$ . In general,  $\Delta L_{A,k}$  values greater than -3 should be reported as per the standard.

The origin of the  $\Delta L_{A,k}$  test can be found in the *Objective Method for Assessing the Audibility of Tones in Noise, Joint Nordic Method* developed by DELTA. While not fully explained in the IEC 61400-11 standard, the tonality penalty is determined according to the following formula.<sup>2</sup>

$$\text{for } \Delta L_{ta} < 4\text{dB: } k = 0 \text{ dB}$$

$$\text{for } 4 \leq \Delta L_{ta} \leq 10\text{dB: } k = \Delta L_{ta} - 4$$

$$\text{for } \Delta L_{ta} > 10\text{dB: } k = 6\text{dB}$$

Note: k is not restricted to integer values

Examining the Vestas V112 data provided by the manufacturer<sup>3</sup>,  $\Delta L_{A,k}$  is less than 4 dB at all wind speeds and therefore does not attract a penalty under the Joint Nordic Method.

In addition to this test a one-third octave band test was completed using the noise levels as predicted by the SoundPLAN model. Levels were assessed against the description of tonality as defined in the NSW Industrial Noise Policy. The policy states that the presence of excessive tonality is defined as when the level of one-third octave band measured in the equivalent noise level  $L_{eq}(10 \text{ minute})$  exceeds the level of the adjacent bands on both sides by:

- **5 dB or more** if the centre frequency of the band containing the tone is above 400Hz
- **8 dB or more** if the centre frequency of the band containing the tone is 160 to 400Hz inclusive
- **15 dB or more** if the centre frequency of the band containing the tone is below 160Hz

The predicted noise level in one third octave bands did not meet the descriptions as stated above and would therefore be deemed 'non tonal' in the field.

## 7.2 Atmospheric stability and wind profile

The wind velocity at a location can be represented by a vertical profile (gradient) that generally is at a minimum at ground level and increases with altitude. The wind velocity profile is primarily determined by physical factors such as surface roughness and topographic (relief) effects, which are reasonably constant over time, however can also be affected by more variable local atmospheric conditions including atmospheric stability and turbulence.

Atmospheric stability is determined by the total heat flux to the ground, primarily being the sum of incoming solar and outgoing thermal radiation and heat exchanged with the air. During clear summer days (incoming radiation dominates) air is heated from below and rises, causing significant thermal mixing, vertical air movements and turbulence. This process limits large variations in the vertical wind velocity profile.

<sup>2</sup> Source: Equation 4 from Objective Method for Assessing the Audibility of Tones in Noise. Joint Nordic Method – Version 2. AV 1952/99 14 April 2000, pg 5.

<sup>3</sup> Source: Garad Hassan report, GLGH-4286 12 09255 258-A-00001-B dated 20 August 2012

During clear nights when outgoing radiation dominates, air is cooled from below, air density is greatest closer to the ground and minimal thermal mixing occurs. This leads to a stable atmosphere where horizontal layers of air are largely decoupled and allows for a higher wind velocity gradient.

The noise assessment methodology outlined in the SA EPA Guidelines, as in many other similar wind farm noise assessment methodologies, by necessity rely on the independently verified reference sound power data available for specific wind turbines measured at a manufacturer's test site. The measurement procedure has been standardised (IEC 61400-11) to require sound power data to be measured coincidentally with reference wind speed measurements at an altitude of 10 metres.

As discussed in **Section 5.2** the SA EPA Guideline methodology has been adapted to the alternative reference wind speed at a height of 80 m AGL which is more representative of hub height wind speed. Accordingly the turbine sound power level data has been amended to the appropriate 80 m AGL wind speed. This approach goes some way to alleviating the variability that changing wind profiles has with respect to a 10 m reference height.

While the proposed layout meets the requirements of the SA EPA Guidelines, some uncertainty remains as to the likely noise conditions that will result under specific atmospheric conditions over time. The SA EPA Guidelines noise limits are generally set within the requirements of the WHO Guidelines that relate to health impacts, and it is highly unlikely that the remaining uncertainty could lead to health impacts. Some additional analysis into the prevalence of stable atmospheres (ie high wind shear) has been undertaken and is discussed in **Section 7.4**.

An adaptive management approach (See **Section 7.5**) could be implemented if undue noise impacts are identified during WTG operation that are related to elevated WTG noise levels during stable atmosphere conditions.

### 7.3 Temperature Inversions

Temperature inversion is an atmospheric condition in which temperature increases with height above ground. Such conditions may increase noise levels by focussing sound wave propagation paths at a single point. Temperature inversions occurring within the lowest 50 m to 100 m of atmosphere can affect noise levels measured on the ground. Temperature inversions are most commonly caused by radiative cooling of the ground at night leading to cooling of the air in contact with the ground. Such conditions are especially prevalent on cloudless nights with little wind.

The SA EPA Guidelines do not require or suggest temperature inversions be included during wind farm noise assessments. The NSW INP states that temperature inversions be included in an assessment if they are deemed to be a prevalent feature of the environment, which generally requires they occur for greater than 30% of the total night-time during winter (approximately two nights per week between 6:00 pm and 7:00 am). Currently there is insufficient data available to accurately determine the prevalence of temperature inversions; however, given that temperature inversions require atmospheric conditions to be stable, the analysis into wind shear values for the site (See **Section 7.4**) may provide some additional context.

Conventional approaches to assessing noise propagation under temperature inversion conditions require knowledge of the temperature gradient and assume that the noise source is located below the temperature inversion, typically near to the ground. The effect of temperature inversions on noise propagation from highly elevated noise sources, such as WTG's is therefore not typical of other sources.

WTG's for the Liverpool Range Wind Farm project are located on top of elevated ridges. The hub height (assumed acoustic centre of the WTG) is typically located 150 m to 200 m higher than receiver locations on the surrounding area. It is therefore unlikely that conventional temperature inversion conditions, in the lower 200 m of the atmosphere, would significantly affect noise propagation from such an elevated source.

A further consideration must be that temperature inversions require little to no wind in order to minimise atmospheric mixing and hence develop. During calm conditions the WTGs are unlikely to operate, as their cut-in speed is typically 3 m/s.

Notwithstanding the above, an adaptive management approach (See **Section 7.5**) could be implemented if undue noise impacts are identified during WTG operation that are related to temperature inversion effects.

#### **7.4 Likelihood of Enhanced Noise Generation and Propagation Conditions**

The probability of meteorological effects that may exacerbate the impacts of noise is an area of interest amongst the research community. Several hypotheses exist to explain why stable atmospheric conditions may cause such phenomena but as yet there is no standardised way of determining a direct, numerical relationship between meteorological conditions and the resulting effect on WTG noise levels.

The IEC61400 testing method does not include any requirement to report the change in output Sound Power Level under differing wind shear values, nor would such information necessarily relate to a particular wind farm site. The local terrain and topographical features of any project site can vary considerably and have a large influence on near-ground-level air flow and, by extension, the wind shear characteristics of the site.

Nonetheless, a brief evaluation of various wind shear values at the site using a simplified model has been undertaken for Liverpool Range Wind Farm. This may better direct decisions regarding the potential for increased noise impact under different atmospheric conditions once further research findings improves the general understanding of these phenomena.

The relationship between wind speeds at differing heights above the ground can be approximated to:


$$V_{@h} = V_{@g} \left( \frac{h}{h_g} \right)^\alpha \text{ where}$$

$V_h$  = Velocity at height  $h$   
 $V_g$  = Velocity at ground level  
 $\alpha$  = Wind Shear Exponent

A high value of  $\alpha$  indicates a stable atmosphere, which may increase the prevalence of conditions that increase noise generation and propagation.

The proponent has provided SLR Consulting measurement data from a wind mast on site which was analysed to give the wind shear exponent values at different times of day. The data provided was for a full year in the period March 2009 to March 2010. **Figure 12** below shows the average values provided by the proponent, grouped by month.

**Figure 12 Variability of Wind Shear by Month & Hour (Average)**

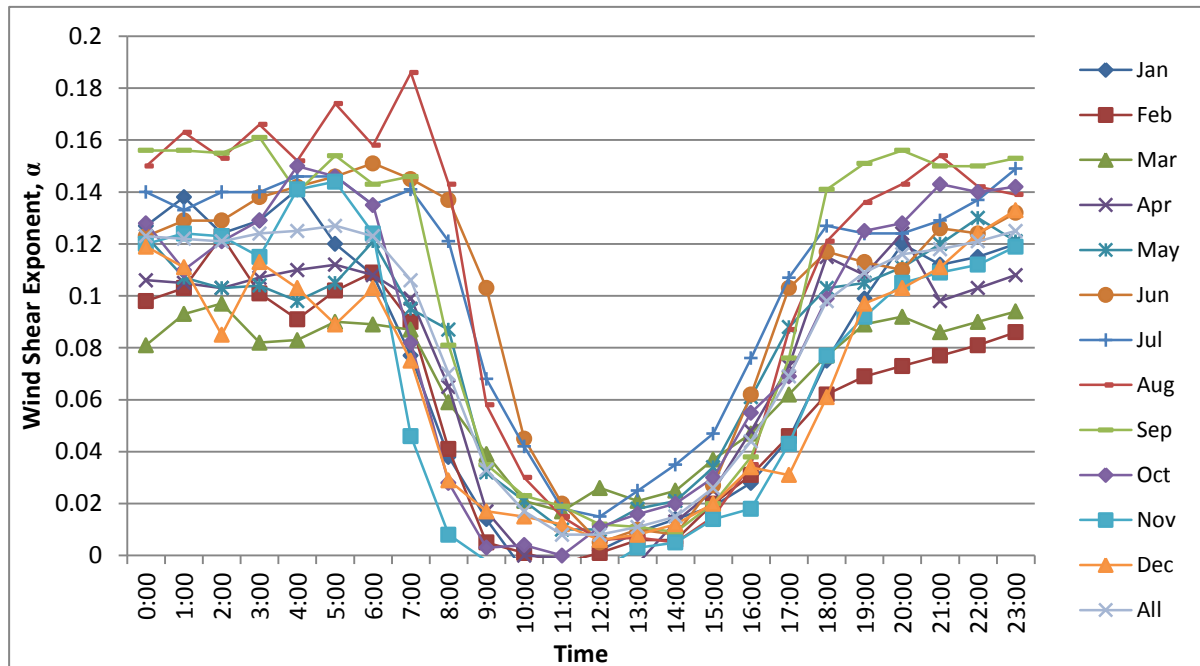

Several values of wind shear exponent value ( $\alpha$ ) have been proposed as defining a stable atmosphere. A wind shear value of greater than 0.55 has been suggested as a 'highly stable' atmosphere for rural environments;<sup>4</sup> van den Berg<sup>5</sup> suggests that a wind shear exponent of 0.41 is appropriate.

To further examine the prevalence of high wind shear values, detailed analysis of wind shear was conducted, with the percentage likelihood of wind shear exponent for each season and time period (Day/Evening/Night). **Table 14** shows the results for two values of  $\alpha$  presented in research papers discussed.

**Table 14 Likelihood of High Wind Shear Exponent**

Season	$\alpha > 0.41$			$\alpha > 0.55$		
	Day	Evening	Night	Day	Evening	Night
Summer	0.7%	1.6%	2.4%	0.3%	0.7%	1.0%
Autumn	0.6%	0.7%	0.9%	0.2%	0.2%	0.1%
Winter	1.1%	1.2%	1.8%	0.4%	0.6%	0.9%
Spring	0.8%	1.3%	3.0%	0.3%	0.3%	1.4%

The values presented show that high wind shear does not occur for more than 30% of any time period in any season. The NSW INP deems this as being sufficiently occurring to define it as a prevailing meteorological feature for a site.

While the data shows that stable atmosphere conditions may exist for short periods of time, the results of the analysis undertaken indicate that stable atmospheres do not occur at this site on a long term basis and are not deemed a prevailing feature of the site under NSW INP.

<sup>4</sup> Source: Table 2 from 'Sources of Wind Turbine Noise and Sound Propagation' - Renzo Tonin and Associates - Acoustics Australia Vol. 40 No. 1 pg 24

<sup>5</sup> Source: Table 1 from 'Effects of the wind profile at night on wind turbine sound' - GP van den Berg - Journal of Sound and Vibration

## 7.5 Adaptive Management

If undue WTG noise impacts are identified during operations due to temperature inversion, atmospheric stability or other reasons, then an 'adaptive management' approach could be implemented to mitigate or remove the impact. This process could include;

- Receiving and documenting noise impact complaint through 'hotline' or other means.
- Investigating the nature of the reported impact.
- Identifying exactly what conditions or times lead to undue impacts.
- Operating WTG's in a reduced 'noise optimised' mode during identified times and conditions (sector management).
- Turning off WTG's that are identified as causing the undue impact.
- Providing acoustic upgrades (glazing, façade, masking noise etc) to affected dwellings.

## 7.6 Wind Turbine Vibration

Vibration or more specifically the oscillatory movement of receptor structures could potentially propagate from a source (in this case a wind farm) through either a ground path (ground borne vibration) or an airborne path as sound which could couple with lightweight structures and produce a movement in the structure.

### 7.6.1 Ground borne vibration

Ground borne vibration levels attenuate with distance with varying amounts dependant upon such variables as frequency and geotechnical parameters. There are a few documented research reports with regards to wind farm generated ground vibration.

The Snow Report (*Low Frequency Noise & Vibration Measurements at a Modern Wind Farm*, ETSU W/13/01392/REP, D J Snow, 1997) describes measurements taken at a wind farm consisting of eleven 450 kW WTG's, where noise and vibration measurements were taken at increasingly distant points up to 1 kilometre. Low frequency vibration was determined down to 0.1 Hz with varying wind speeds and on/off operation. The research found that the absolute level of vibration signals measured at any frequency at 100 metres from the nearest WTG were significantly below the most stringent criteria given by BS 6472:1992 *Evaluation of human exposure to vibration in buildings (1Hz to 80Hz)*. Furthermore vibration in the 0.5Hz to 1Hz range remained at similar levels when the wind farm was not operating, suggesting that the vibration measured may have been due to other (ambient) sources.

Detailed *Microseismic and Infrasound Monitoring of Low Frequency Noise and Vibrations from Wind Farms* were undertaken by the Applied and Environmental Geophysics Group of Keele University as part of a comprehensive report giving '*Recommendations on The Siting of Wind Farm in the Vicinity the Eskdalemuir, Scotland*'. The Eskdalemuir Seismic Array (EKA) is in the southern uplands of Scotland and is sited on a very quiet magnetic and seismic environment with twin 9 km long lines of seismometer instrumentation which are sensitive enough to pick up nuclear explosions from up to 15,000 km away. It should be noted that the objective of the study was to measure vibration levels many orders of magnitude lower than project criteria detailed in **Section 2.7**

The Eskdalemuir report details results taken from St Breock Downs Wind Farm (possibly the same measurements taken in the Snow Report). From the documented seismic vibration measurements taken at 25 metres from a single WTG a peak particle velocity (PPV) of approximately  $8 \times 10^{-5}$  mm/s has been calculated. This is approximately 2500 orders of magnitude lower than project criteria. Whilst we note that turbines proposed for Liverpool Range Wind Farm are larger than those measured above we are confident that ground vibration will be completely imperceptible at surrounding receptors. Furthermore, our own experience and observations at other operating wind farms has not indicated perceptible ground vibration at any distance from turbines.



## 7.6.2 Air borne vibration / Infrasond

A good deal of misunderstanding and attention has been given in recent times to low frequency noise and infrasound generated by wind farms. Infrasound at sufficient levels has the potential to be perceived as vibration or alternatively cause the movement of lightweight structures which then in turn are perceived as vibration. It should be noted that the sometimes audible cyclical modulation of aerodynamic noise, the 'swish swish' of blades, is often mistakenly identified as low frequency noise, where it actually is the low frequency modulation of audible noise.

The subject of infrasound is most complex, dealing with frequencies that are sub audible, requiring alternative frequency weighting scales, specialist measurement equipment and techniques, and evaluating the variance of hearing sensitivity in a population at low frequency. Furthermore, infrasound levels depend on many variables including turbine type and size, wind conditions (including turbulence), propagation distance, building structure and materials, room sizing and positioning within room.

Comprehensive review, measurement testing and evaluation are offered in numerous technical reports investigating infrasound and low frequency noise from wind farms including;

- *A Review of Published Research on Low Frequency Noise and its Effects* - Report for Defra by Dr Geoff Leventhall assisted by Dr Peter Pelmeare and Dr Stephen Benton - 2002 (refer to <http://www.defra.gov.uk/environment/quality/noise/research/lowfrequency/documents/lowfreqnoise.pdf> )
- *The Measurement of Low Frequency Noise at Three UK Wind Farms* - report for DTI by Hayes McKenzie Partnership – 2006 (refer to <http://www.berr.gov.uk/files/file31270.pdf>)
- *Wind turbines & Infrasound 2006* - Report for Canadian Wind Energy Association (CanWEA) by Howe Gastmeier Chapnik Limited (HGC Engineering) – 2006 (refer to [http://www.canwea.ca/images/uploads/File/CanWEA\\_Infrasound\\_Study\\_Final.pdf](http://www.canwea.ca/images/uploads/File/CanWEA_Infrasound_Study_Final.pdf))
- *Wind Farms Technical Paper – Environmental Noise* – report for Clean Energy Council Australia by Sonus Pty Ltd – 2010 (refer to <http://www.cleanenergycouncil.org.au/cec/mediaevents/media-releases/November2010/sonus-report.html> )
- *Infrasound levels near windfarms and in other environments* – Report for SA EPA by Resonate Acoustics – January 2013 (refer to [http://www.epa.sa.gov.au/xstd\\_files/Noise/Report/infrasound.pdf](http://www.epa.sa.gov.au/xstd_files/Noise/Report/infrasound.pdf))

The consensus drawn by all investigations is that infrasound noise emissions from modern WTG's are significantly below the recognised threshold of perception for acoustic energy within this range.

## 7.7 Substation Transformer Noise Levels

The appropriate noise criteria for Substation Noise are provided in *NSW INP* (See **Section 2.2** and **2.4**). Noise from the substation will be assessed separately from the wind farm and will be subject to a separate approval.

Australian Standard AS 60076 Part 10 2009: "*Power Transformers – Determination of sound levels*" indicates that the 250 MVA transformer facility may produce sound power levels up to 100 dBA. The dominant frequency of such transformers is 100 Hz.

Proposed locations for substations are shown in **Table 15**. Note that some substations are listed as alternatives to other locations, but all 9 substations have been modelled together, presenting a worst-case scenario.

**Table 15 Proposed Substation Locations**

Name	Type	Easting	Northing
Bounty Creek	Preferred	779554	6473600
Rotherwood	Alternate	779433	6467022
Coolah East	Preferred	769962	6478161
Starkeys Creek	Alternate	775882	6474615
Coolah Tops	Preferred	777731	6486786
Turee North	Preferred	778008	6481495
Gundare	Alternate	768061	6485101
Rotherwood	Preferred	778815	6463960
Gundare	Preferred	769816	6487467

Noise predictions for transformer substations have been made using CONCAWE algorithms assuming an absolute 'worst case' meteorology enhancement condition of downwind 3 m/s and Pasquill Stability Class F temperature inversion. The results are presented in **Table 16** for the nearest receptor locations, along with the minimum night-time NSW INP limit.

**Table 16 Predicted 'worst case' 250 MVA switching substation noise**

Location	Predicted Noise Level, Leq dB(A)	NSW Industrial Noise Policy Criteria		
		Minimum RBL (Night)	Noise Limit (Intrusive Criteria)	Complies?
D4-3*	28	30	35	Yes
D4-4*	28	30	35	Yes
F8-1	27	30	35	Yes
D4-2*	27	30	35	Yes
F6-2*	26	30	35	Yes
F6-3*	26	30	35	Yes
F6-4*	26	30	35	Yes
F6-1*	25	30	35	Yes
D4-1*	25	30	35	Yes
F7-6*	22	30	35	Yes
G4-1*	21	30	35	Yes
F7-5*	21	30	35	Yes
F7-4*	21	30	35	Yes

## 7.8 Transmission Line Noise (Corona Noise)

Corona noise is caused by the partial breakdown of the insulation properties of air surrounding the conducting wires. It generally only occurs in humid conditions, as provided by fog or rain. A minimum line potential of 70 kV or higher is required to generate corona noise depending on the electrical design. Corona noise does not occur on domestic distribution lines.

Corona noise has two major components, a low frequency tone associated with the frequency of the AC supply (100 Hz for 50 Hz source) and broadband noise. The tonal component of the noise is related to the point along the electric waveform at which the air begins to conduct. This varies with each cycle and consequently the frequency of the emitted tone is subject to great fluctuations. Corona noise can be characterised as broadband 'crackling' or 'buzzing' and is generally only a feature during foggy or raining conditions.

We have previously measured corona noise (reference GEHA Report 045-109/2 dated 9 November 2004) at a site near Officer in outer Melbourne, Victoria. We found it possible to measure corona noise at close distances, at high frequencies only, as other noise sources, namely traffic and birds, caused some interference at times. A 500 kV line was measured during damp foggy conditions.

At a distance of 30m along the ground from the line an  $L_{eq}$  noise level of approximately 44 dBA was measured. At a distance of 100m the corona noise was calculated to be approximately 39 dBA. Assuming a minimum RBL value of 30 dBA, the minimum intrusive criteria as determined by the NSW Industrial Noise Policy (INP) would be 35 dBA. We therefore conservatively estimate that the minimum criteria level of 35 dBA would be complied with at a distance of 240 metres. The developer has advised that the proposed transmission route is further than this distance from any receptor and hence any occasional corona noise will comply with the NSW INP minimum limit at all residential receivers.

## 8 NSW DRAFT WIND FARM GUIDELINES

In December 2011 the NSW Department of Planning and Infrastructure released the *Draft NSW Planning Guidelines Wind Farms – Appendix B: NSW Wind Farm Noise Guidelines*.

Whilst the guidelines are yet to be finalised it has been requested by the Director General that during the interim period due consideration should be given to a number of the additional requirements of the proposed draft guideline. These are presented below.

### 8.1 Daytime vs. Night-time Background Noise

The background noise data was reprocessed to define background noise curves for the daytime period (7.00 am to 10.00 pm) and night-time period (10.00 pm to 7.00 am) as defined by the draft guideline. The corresponding 3<sup>rd</sup> order regression curve and correlation coefficient are presented in **Table 17** below.

**Table 17 Background Noise Regression Curves and Correlation Coefficient**

Location	Daytime	Daytime R <sup>2</sup>	Night-time	Night-time R <sup>2</sup>
D4-6*+	$-0.0197x^3 + 0.6025x^2 - 3.8476x + 42.785$	0.364	$-0.012x^3 + 0.5121x^2 - 4.7601x + 44.829$	0.4897
E4-5*	$-0.0154x^3 + 0.4864x^2 - 3.7878x + 38.925$	0.1164	$-0.027x^3 + 0.933x^2 - 8.1976x + 44.311$	0.269
C6-4	$0.0017x^3 + 0.0873x^2 - 1.022x + 30.964$	0.2766	$0.0019x^3 + 0.1377x^2 - 1.8577x + 26.616$	0.5136
G6-2	$0.0003x^3 - 0.0231x^2 + 1.3236x + 22.737$	0.3585	$-0.0084x^3 + 0.2942x^2 - 1.9926x + 28.741$	0.3948
F6-4	$-0.0002x^3 + 0.0401x^2 + 0.4896x + 35.594$	0.1536	$-0.007x^3 + 0.4391x^2 - 4.9376x + 45.695$	0.447

Daytime regression curves were typically 1 to 3 dB higher than the regression curve based on the full data set. Night-time regression curves were typically 1 to 5 dB lower than the regression curves based on the full data set. Correlations for daytime regression curves were generally close to correlation for the full data set. Correlations for night-time regression curves were usually higher, sometimes to a great extent. This is most likely due to more stable atmospheres at night, leading to less variability with respect to different wind directions, which may have scattered the data during the daytime period.

The new background noise curves were used to update the noise limit curves for all receptors and all predicted results were assessed against these criteria.

No receivers are predicted to exceed the daytime-based criteria. **Table 18** shows the exceedances for the night-time criteria.

**Table 18 NSW Draft Wind Farm Guidelines Exceedances – Night-time Criteria**

Receiver	BG Location	Exceedance at Wind speed (m/s, 10m AGL) dBA										Max	
		3	4	5	6	7	8	9	10	11	12		
G6-2	Zone 8					0.4							0.4

The predicted exceedance is less than 0.5 dBA. This is a relatively minor exceedance which would be difficult to measure in the field.

## 8.2 Special Audible Characteristics

The Draft NSW Guidelines have been developed with the fundamental characteristics of wind turbine noise taken into consideration including reasonable levels of swish, modulation, discrete tones and low frequency noise.

The Draft NSW Guidelines introduce recommendations for procedures to assess excessive levels of special audible character and these procedures (if adopted) are to be used to evaluate noise character from an operational wind farm. Notwithstanding the above, the proposed procedures have been adapted to evaluate the predicted likelihood of excessive levels of special audible character.

### 8.2.1 Low Frequency Noise

An assessment of the potential for low frequency noise was completed with C-weighted noise levels predicted for the proposed layout.

A criteria of 65 dBC daytime and 60 dBC night-time as proposed by the Draft NSW Guidelines was used to determine if further investigation into low frequency noise was warranted.

The results of the SoundPLAN predicted levels showed that only one receiver location (F7-3) exceeded 60 dBC, the predicted level was 60.1 dBC. This is a relatively small exceedance of the criteria and therefore it is recommended that investigation into low frequency noise is considered in the post-construction monitoring phase at this location.

### 8.2.2 Tonality

The simplified 1/3 octave band method for assessing tonality as proposed by the Draft NSW Guidelines was completed for the proposed layouts using the same method evaluated in **Section 7.1**

The tonality tests showed no presence of tonality in the predicted results. A full set of results for this analysis is shown in **Appendix F**.

### 8.2.3 Amplitude Modulation

Amplitude modulation (AM) refers to the cyclical modulation of audible aerodynamic noise from WTGs. The modulation typically occurs at rate corresponding to blade passing frequency which is approximately once per second (i.e. ~1 Hz). This is not to be confused with infrasound, that is, sound waves at frequencies below the range of human hearing; rather it refers to the fluctuation of noise level in the audible range.

Noise from a wind turbine typically includes an inherent level of amplitude modulation, often referred to as 'swish' and the criteria in the Draft NSW Guidelines have been determined with the inherent characteristics of wind turbine noise – including reasonable levels of amplitude modulation – taken into consideration. The Draft NSW Guidelines propose an excessive level of modulation is taken to be a variation of greater than 4 dBA at the blade passing.

The issue of AM of WTG noise is now the subject of considerable research and investigation and whilst 'normal' amplitude modulation (swish) is generally well characterised and the source mechanism better understood, the hypothesised potential causes of excessive (Other) AM are somewhat more complex and not well understood.

Research into AM undertaken by Salford University in 2007, found that out of the total number of operational wind farms investigated (133) in the UK approximately 20% at some point had registered a noise complaint(s); but AM was considered to be a factor in noise complaints at only 3% of the sites and a possible factor at 6% of the sites. Furthermore, the periods when AM complaints were registered at four wind farms determined that the necessary conditions were relatively infrequent. From this it appears that whatever the actual number of occurrences of potential excessive AM, it only occurs at a minority of wind farm sites for a small amount of the time.

There currently is no means to predict the eventuality, severity or frequency of occurrence of excessive AM and the proposed Draft NSW Guideline methodology is limited to the assessment of operational wind farms. Research evidence would suggest that excessive AM has only been confirmed at a small number of wind farm sites and when it occurs it is relatively infrequent.

Nevertheless, should excessive AM be found to be a problem with the wind farm, it would be possible to limit the impact on the residents through adaptive management techniques (See also **Section 7.5**).

## 9 ASSESSMENT OF CONSTRUCTION NOISE & VIBRATION LEVELS

### 9.1 Project Construction Noise

The appropriate criteria for construction noise are provided in the Interim Construction Noise Guidelines (DECCW, 2009) (See **Sections 2.2** and **2.6**).

Proposed construction activities associated with the wind farm include;

- construction of access roads,
- establishment of turbine tower foundations and electrical substation,
- digging of trenches to accommodate underground power cables,
- erection of turbine towers and assembly of WTG's.

The equipment required to complete the above tasks will typically include;

- excavator/grader, bulldozer, dump trucks, vibratory roller
- bucket loader, rock breaker, drill rig, excavator/grader, bulldozer, dump truck, flat bed truck, concrete truck
- cranes, fork lift, and various 4WD and service vehicles.

The anticipated construction period is anticipated to be less than 24 months, with civil works expected to span approximately 12 to 15 months, however, due to the large area of the wind farm site, intensive works will be located within close proximity to individual residential receivers for only very short and intermittent periods of time.

It is anticipated that most construction will occur during standard construction hours and it is therefore considered appropriate that construction noise levels up to 10 dBA above the RBL's would be acceptable. Construction noise levels greater than 10 dBA above RBL could be considered as 'noise affected' as defined by the DECCW guidelines. At levels greater than 75 dBA receptors would be considered 'highly noise affected' by construction noise as defined by the Guidelines.

### 9.2 Ambient Background Noise Levels

Due to lack of data at some locations, ambient background levels were not calculated. Instead, a conservative approach has been taken with the NSW INP minimum RBL of 30 dBA applied to all receiver locations.

### 9.3 Noise Modelling Parameters

In order to calculate the noise levels at the various noise sensitive receiver locations from construction equipment associated with the project, a SoundPLAN computer noise model was developed.

The model predicts noise levels by taking into account such factors as the source sound power levels and locations of sources and receivers, distance attenuation, ground absorption, air absorption and shielding attenuation, as well as meteorological conditions, including wind effects. The noise model was configured to use prediction algorithms in accordance with the Conservation of Clean Air and Water Europe (CONCAWE) prediction methodology which allows for conservative 'worst case' meteorological propagation conditions.

Sound power levels used to derive the predicted construction noise were based on typical data sourced from the SLR Consulting noise source database. Computer noise models of typical construction scenarios were developed which included all anticipated mobile equipment for the activity operating simultaneously at full load. **Table 19** shows typical sound power levels of equipment used in wind farm construction.

**Table 19 Typical Construction Equipment**

Equipment	Octave band mid frequency - Leq Sound Power Levels dB							Total, dBA
	63	125	250	500	1 K	2 k	4 K	
Excavator	121	126	111	107	106	101	96	113
Grader	118	124	115	114	115	114	113	120
Rock Breaker	113	115	117	122	121	120	118	126
Crane	108	105	109	107	111	105	97	113

To examine the possible worst case construction noise impacts for all nearby receivers, four different construction scenarios were modelled at each turbine location and the highest noise levels for each receiver predicted. These are:

- Construction of Access Roads
- Establishment of Turbine Foundations
- Trench Excavation
- WTG Erection and Assembly

#### 9.4 Normal Working Hours Operation

**Table 20** shows the predicted construction level for all receivers and the minimum applicable noise limit for the daytime period (intrusive criteria) Locations where the predicted noise levels are deemed 'noise affected' are highlighted in red.

**Table 20 Predicted Construction Noise Levels**

Location	Construction Activity					
	Trench Excavation	Construction of Access Roads	Establishment of Turbine Tower Foundations	WTG Erection & Assembly	Minimum RBL = 30 dBA	Noise Management Level = RBL + 10
B3-4	0	0	0	0	30	40
B3-5	0	0	0	0	30	40
B5-5	0	0	0	0	30	40
B5-6	32	34	38	26	30	40
B5-7	32	34	38	26	30	40
B6-10	0	0	0	0	30	40
B6-11	31	33	37	25	30	40
B6-6	31	33	38	26	30	40
B6-7	31	33	38	26	30	40
B6-8	32	34	38	26	30	40
B6-9	32	34	39	26	30	40
C2-3	32	35	41	29	30	40
C2-4	32	35	40	28	30	40
C4-1	35	37	42	30	30	40
C4-2	33	35	39	27	30	40
C4-3	33	34	39	27	30	40
C4-4	33	34	39	27	30	40
C4-5	35	37	42	30	30	40



Location	Construction Activity					
	Trench Excavation	Construction of Access Roads	Establishment of Turbine Tower Foundations	WTG Erection & Assembly	Minimum RBL = 30 dBA	Noise Management Level = RBL + 10
C4-6	34	36	41	29	30	40
C4-7	35	38	43	30	30	40
C4-8	36	38	44	32	30	40
C4-9	35	37	42	30	30	40
C5-1	33	35	40	28	30	40
C5-10*	33	35	40	28	30	40
C5-2	32	34	38	26	30	40
C5-3	33	35	40	28	30	40
C5-4*	33	34	39	27	30	40
C5-5	35	37	43	30	30	40
C5-6	39	44	50	38	30	40
C5-7*	40	45	52	39	30	40
C5-8*	37	39	44	32	30	40
C5-9	38	41	46	34	30	40
C6-1	34	37	43	31	30	40
C6-2	42	45	51	39	30	40
C6-3	38	43	49	36	30	40
C6-4	38	40	46	33	30	40
C7-1	36	39	44	32	30	40
C7-2	33	36	41	29	30	40
D4-1*	43	47	53	40	30	40
D4-2*	43	46	52	40	30	40
D4-3*	42	45	51	39	30	40
D4-4*	39	44	50	37	30	40
D4-5*	45	49	55	43	30	40
D4-6*	43	47	53	41	30	40
D4-7*	46	50	56	44	30	40
D4-8*	46	50	56	44	30	40
D4-9	40	43	49	37	30	40
D6-1*	41	45	51	39	30	40
D6-2*	40	44	49	37	30	40
D6-3*	41	44	49	37	30	40
D7-1	25	25	27	16	30	40
D7-2*	35	38	43	31	30	40
D7-3	38	41	47	35	30	40
D7-4	37	40	45	33	30	40
D7-5*	41	44	50	38	30	40
D7-6*	41	45	51	39	30	40
D7-7*	33	35	40	28	30	40

Location	Construction Activity					
	Trench Excavation	Construction of Access Roads	Establishment of Turbine Tower Foundations	WTG Erection & Assembly	Minimum RBL = 30 dBA	Noise Management Level = RBL + 10
D8-4	0	0	0	0	30	40
E1-1	0	0	0	0	30	40
E2-1	33	35	40	27	30	40
E3-2*	42	46	52	41	30	40
E3-3*	41	45	50	38	30	40
E4-1	44	48	53	41	30	40
E4-2	43	48	54	42	30	40
E4-3	44	48	54	42	30	40
E4-4*	43	47	53	41	30	40
E4-5*	42	45	52	40	30	40
E4-6*	43	47	54	42	30	40
E5-1*	40	45	52	40	30	40
E5-2*	41	46	53	40	30	40
E5-3*	40	44	49	37	30	40
E5-4*	41	46	52	40	30	40
E5-5*	41	46	52	39	30	40
E5-6*	41	45	51	38	30	40
E6-1*	43	47	53	40	30	40
E6-2*	40	46	52	40	30	40
E7-1	32	34	39	27	30	40
E7-2	31	34	39	27	30	40
E8-1	0	0	0	0	30	40
E8-4	0	0	0	0	30	40
E8-5	32	33	37	25	30	40
E9-2	0	0	0	0	30	40
E9-4*	34	36	40	28	30	40
F2-1	33	35	40	27	30	40
F2-2	30	32	38	25	30	40
F2-3	30	33	39	26	30	40
F2-4	30	33	39	26	30	40
F2-5	30	33	38	26	30	40
F6-1*	42	45	51	39	30	40
F6-2*	42	45	51	39	30	40
F6-3*	41	45	50	38	30	40
F6-4*	43	46	52	40	30	40
F7-1*	50	55	61	49	30	40
F7-2*	48	54	60	48	30	40
F7-3*	49	55	61	49	30	40
F7-4*	44	48	53	41	30	40

Location	Construction Activity					
	Trench Excavation	Construction of Access Roads	Establishment of Turbine Tower Foundations	WTG Erection & Assembly	Minimum RBL = 30 dBA	Noise Management Level = RBL + 10
F7-5*	44	47	53	41	30	40
F7-6*	46	50	56	44	30	40
F8-1	38	42	48	35	30	40
F9-1	39	42	48	36	30	40
F9-2*	39	42	48	36	30	40
F9-3*	39	42	48	35	30	40
F9-4*	39	42	48	36	30	40
F9-5*	39	42	48	35	30	40
F9-6*	39	42	48	35	30	40
F9-7*	37	42	48	35	30	40
G10-1	15	15	19	7	30	40
G10-2	21	20	22	11	30	40
G10-3	14	14	18	6	30	40
G10-4	48	54	60	48	30	40
G10-5	45	49	55	43	30	40
G10-7	42	45	51	39	30	40
G10-8	39	43	49	36	30	40
G2-1	33	34	39	27	30	40
G2-2	33	35	40	28	30	40
G2-3	32	34	39	26	30	40
G4-1*	32	34	38	26	30	40
G6-1*	32	33	38	26	30	40
G6-2	32	33	37	25	30	40
G6-3	32	33	38	25	30	40
G9-1	32	33	37	25	30	40
G9-2*	32	33	37	25	30	40
G9-3	32	33	37	25	30	40
G9-4	32	33	37	25	30	40
H6-1	34	36	41	28	30	40
H6-2	0	0	0	0	30	40
H6-3	33	36	42	30	30	40
H6-4	0	0	0	0	30	40
H6-5	0	0	0	0	30	40
H6-6	0	0	0	0	30	40
H7-1	38	40	46	33	30	40
H7-2	0	0	0	0	30	40
H8-1	32	34	39	27	30	40
H9-1*	36	38	43	31	30	40

The majority of occurrences of locations being 'noise affected' occur when turbine foundation civil works are located nearby and is largely attributed to the operation of a rock breaker. Due to the anticipated short period of localised works this activity would likely be considered acceptable under the Guideline. Operation of the rock-breaker is dependent upon the geotechnical conditions of the foundation site and would be operated intermittently at most. Consideration for mitigation measures such as localised shrouding may be needed if adverse conditions are experienced if and when operating the rock-breaker at the most exposed positions.

No predicted levels exceed 75 dBA and therefore no receptors would be considered as being 'highly noise affected' as defined by the Guideline.

## 9.5 Outside Normal Operating Hours Operation

The only operation likely to occur at night is the erection of WTG's, as low wind conditions are preferable while the towers are being erected by large cranes. **Table 24** shows all noise affected receivers for this construction activity for the night period. Note that the minimum RBL under NSW INP is 30 dBA which therefore creates a minimum noise management level of 35 dBA for the night-time period.

**Table 21 Night Construction Noise Levels – Noise Affected Receivers**

Location	Construction Activity - WTG Erection & Assembly	Minimum RBL = 30 dBA	Noise Management Level = RBL + 5 dBA
F7-1*	49	30	35
F7-3*	49	30	35
F7-2*	48	30	35
G10-4	48	30	35
D4-7*	44	30	35
D4-8*	44	30	35
F7-6*	44	30	35
G10-5	43	30	35
D4-5*	43	30	35
E4-2	42	30	35
E4-3	42	30	35
E4-6*	42	30	35
E4-1	41	30	35
F7-4*	41	30	35
F7-5*	41	30	35
D4-6*	41	30	35
E3-2*	41	30	35
E4-4*	41	30	35
D4-1*	40	30	35
E6-1*	40	30	35
E5-2*	40	30	35
E5-5*	39	30	35
C5-7*	39	30	35
G10-7	39	30	35
F6-1*	39	30	35
D4-3*	39	30	35

Location	Construction Activity - WTG Erection & Assembly	Minimum RBL = 30 dBA	Noise Management Level = RBL + 5 dBA
D7-6*	39	30	35
C6-2	39	30	35
D6-1*	39	30	35
F6-2*	39	30	35
E5-6*	38	30	35
F6-3*	38	30	35
E3-3*	38	30	35
C5-6	38	30	35
D7-5*	38	30	35
D4-4*	37	30	35
D6-3*	37	30	35
E5-3*	37	30	35
D4-9	37	30	35
D6-2*	37	30	35
G10-8	36	30	35
C6-3	36	30	35
F9-1	36	30	35
F9-2*	36	30	35
F9-4*	36	30	35

A total of 45 locations are deemed 'noise affected' by the Guideline for night-time construction. Tower erection near these locations should occur during the daytime, if possible. No predicted levels exceed 75 dBA and therefore no receptors would be considered as being 'highly noise affected'.

### 9.5.1 Concrete Batching Plants

A number of portable concrete batching plants with a combined Sound Power Level of 115 dB will be required to supply concrete onsite. The proposed locations of these batching plants are listed in **Table 22**. They are often located within or near to the construction compounds where equipment is stored for the duration of the construction phase of the project.

**Table 22 Concrete Batch Plant Locations**

Name	Easting	Northing
Concrete Batch Plant 1	769331	6471183
Concrete Batch Plant 2	779249	6464092
Concrete Batch Plant 3	779225	6473080
Concrete Batch Plant 4	773729	6483597

Using the existing SoundPLAN noise model, predicted noise levels for the proposed batch plant site at the nearest affected properties were calculated under worst case conditions. Results for those locations that exceed the night-time criteria are shown in **Table 23**, along with the minimum RBL and night-time limit for each location.

**Table 23 Concrete Batch Plant Noise Level Prediction**

Location	Predicted Noise Level, dBA	RBL – Night, dBA	Night-time Noise Management Level, dBA
D6-2*	51.3	30	35
E4-2	50.7	30	35
E4-1	49.3	30	35
E4-3	47.9	30	35
D6-3*	47.1	30	35
E4-4*	45.3	30	35
D6-1*	42.5	30	35
E4-5*	42.3	30	35
D7-6*	37.3	30	35
E3-3*	37.1	30	35
D7-5*	36.4	30	35
E3-2*	35.7	30	35

All other locations are predicted to be below the night-time NML. Some mitigation may be possible for these sources, particularly if they are near other project equipment infrastructure which may provide some localised shielding of the concrete batching plants. This should be addressed in any further management plans for construction noise for the project, as described in **Section 9.5.2**.

### 9.5.2 Mitigation for Construction Noise

The Interim Construction Noise Guidelines recommend that where residences are deemed ‘noise affected’, that work practices and mitigation measures deemed feasible and reasonable should be applied. Possible mitigation measures may include:

- Scheduling construction works for less critical times of day
- Using alternative, quieter equipment
- Noise controls including temporary walls/earth berms and exhaust silencers
- Keeping the community informed about upcoming works in the area
- Detailed tracking regarding complaints about construction noise, including how each complaint was addressed.

A detailed construction noise management plan will be developed closer to the construction of the wind farm to ensure that all reasonable steps are taken to reduce noise from construction sources including batching plants, and that appropriate community engagement occurs with respect to construction noise.

### 9.6 Construction Vibration Assessment

The activities and equipment with the potential to generate the highest levels of ground vibration are the operation of the vibratory roller during construction of access roads and the operation of the rock breaker during establishment of turbine tower foundations. Typical vibration levels from these sources are presented in **Table 24**.

**Table 24 Typical Vibration Emission Levels from Construction Plant**

Activity	PPV Vibration Level (mm/s) at Distance			
	10m	20m	30m	100m
4-Tonne Vibratory Roller	2.0 - 2.4	0.4 - 1.2	0.2 - 0.8	<0.2
Hydraulic Hammer (30t)	3	1.5	1.0	<0.5

It is evident that given the large distances between receptors and structures where construction works are likely to be undertaken (greater than 500 m, refer to **Appendix C**), the building damage and human comfort vibration criteria will easily be met during construction.

## 9.7 Blasting

### 9.7.1 Blasting Assessment

Blasting may be required in some areas to clear large rock outcrops to prepare turbine foundations.

The proposed wind farm site is a green field site where no previous blasting or blast monitoring has been conducted and therefore no specific site laws exist. We have therefore adopted a site law derived from measurement data at a different site to give an indicative result.

The 5% site laws for ground vibration and airblast are:

**Ground Vibration**                      PVS (5%) = 16202 (SD<sub>1</sub>)<sup>-2.03</sup>

**Airblast**                                      SPL(5%) = 189.3 - 31.8 log (SD<sub>2</sub>)

where PVS (5%) and SPL (5%) are the levels of ground vibration (Peak Vector Sum - mm/s) and airblast (dB Linear) respectively, above which 5% of the total population (of data points) will lie, assuming that the population has the same statistical distribution as the underlying measured sample.

SD<sub>1</sub> and SD<sub>2</sub> are the ground vibration and airblast scaled distances, where:

$$SD_1 = \frac{\text{Distance}}{\sqrt{\text{MIC}}} = (\text{m.kg}^{-0.5}) \quad \text{and} \quad SD_2 = \frac{\text{Distance}}{\sqrt[3]{\text{MIC}}} = (\text{m.kg}^{-0.33})$$

Based on the blast emissions site laws, calculations were also conducted to indicate the allowable MIC's for compliance with the general EPA Human Comfort criteria of 115 dB Linear (airblast) and 5 mm/s (ground vibration).

The closest anticipated distance between blasting and residences would be approximately 1300 metres (D4-8). At this distance, based on a site constant K<sub>a</sub> of 40, the predicted maximum MIC of up to 98 kg is likely to produce an airblast overpressure below the acceptable level of 115 dB Linear. An MIC of 98 kg is expected to result in a vibration level (Peak Vector Sum) of 0.8 mm/s, well within the recommended maximum level of 5 mm/s in the ANZECC Guidelines.

It is evident that the anticipated blasting is likely to meet all human comfort limits and building damage assessment criteria are easily met. All other sources of vibration would be less than above.

## 9.8 Traffic Noise

Traffic generated by the project during its construction phase has been evaluated in *Liverpool Range Wind Farm Traffic and Transport Report* prepared by Epuron Pty Ltd, dated 20 November 2012. The report states that a maximum of approximately 300 trips per day could be expected from the project.

There are no traffic flow records available for the Liverpool Range local road network.

The projected increase in road traffic noise levels on all local roads is expected to be greater than 2 dBA during peak construction periods, however, road traffic noise levels are anticipated to meet the *Environmental Criteria for Road Traffic Noise (ECRTN)* and subsequent *Road Noise Policy (RNP)* target for a local road of daytime  $L_{Aeq}(1 \text{ hour}) = 55 \text{ dBA}$  at a typical setback distance of 50m. We note that being a rural farming community that most receptors are at much greater setback distances from their road frontage and therefore will easily meet the ECRTN requirement.

### 9.8.1 Night-time deliveries

There could potentially be deliveries of equipment scheduled for out of hours, necessitated by traffic congestion considerations and safe passage of heavy vehicle convoys or especially long loads. Night-time traffic has the potential to cause sleep disturbance to residential receivers along the route.

Preliminary calculations indicate that maximum noise levels at a residence approximately 50 metres from the road as a result of a heavy vehicle pass-by would be in the range 45-55 dBA. Assuming a 10dBA transmission loss through an open window this would result in 35 to 45 dBA inside.

The NSW RNP states that:

*Maximum internal noise levels below 50-55 dBA are unlikely to awaken people from sleep*

and

*One or two noise events per night, with maximum internal levels of 65-70 dBA are not likely to affect health and wellbeing significantly.*

In order to further minimise potential noise impacts associated with night-time deliveries some potential measures to be considered are:

- Prior notification of affected public where night-time convoys are scheduled
- Restricted use of exhaust/engine brakes in built up areas



## 10 CONCLUSION

Noise from the proposed Liverpool Range Wind Farm using a layout of 288 Vestas V112 WTGs has been predicted. The predicted noise levels were assessed against the relevant criteria prescribed by the SA EPA Guideline and World Health Organisation (WHO) goals where appropriate.

The predicted noise levels of the layout were determined to meet the relevant criteria at all receptors.

The project is yet to select and finalise the WTG make and model. Upon finalising the WTG selection a revised noise prediction and assessment will be completed to confirm compliance.

WTG vibration levels have been evaluated and based upon overseas research available were found to be acceptable.


Construction noise has been predicted to all receivers; a number of these are deemed 'noise affected' under the NSW Construction Noise Guidelines. In order to ensure all appropriate measures are being taken to manage construction noise, a more detailed construction management plan should be developed by the proponent. This document will provide detailed guidance on various noise mitigation strategies for the construction stage.

Vibration impacts from construction have been assessed and the 'worst case' scenarios modelled were found to be acceptable.


Blasting impact has been assessed and found to be acceptable. With a maximum instantaneous charge (MIC) of up to 98 kg, the airblast overpressure is anticipated to be below the acceptable level of 115 dB Linear for all existing residences. Similarly, vibration levels are anticipated to be well below the acceptable criteria.

Construction traffic noise impact has been assessed and the 'worst case' maximum construction traffic scenario would comply to the NSW RNP requirements, due to the typically large setback of dwellings from the road network. Night-time deliveries are unlikely to cause sleep disturbance based on predicted maximum noise levels.




Transmission line noise (corona noise) has also been assessed against NSW INP noise limits and has been found to be acceptable as all receiver locations are greater than 240 m from the proposed transmission line.

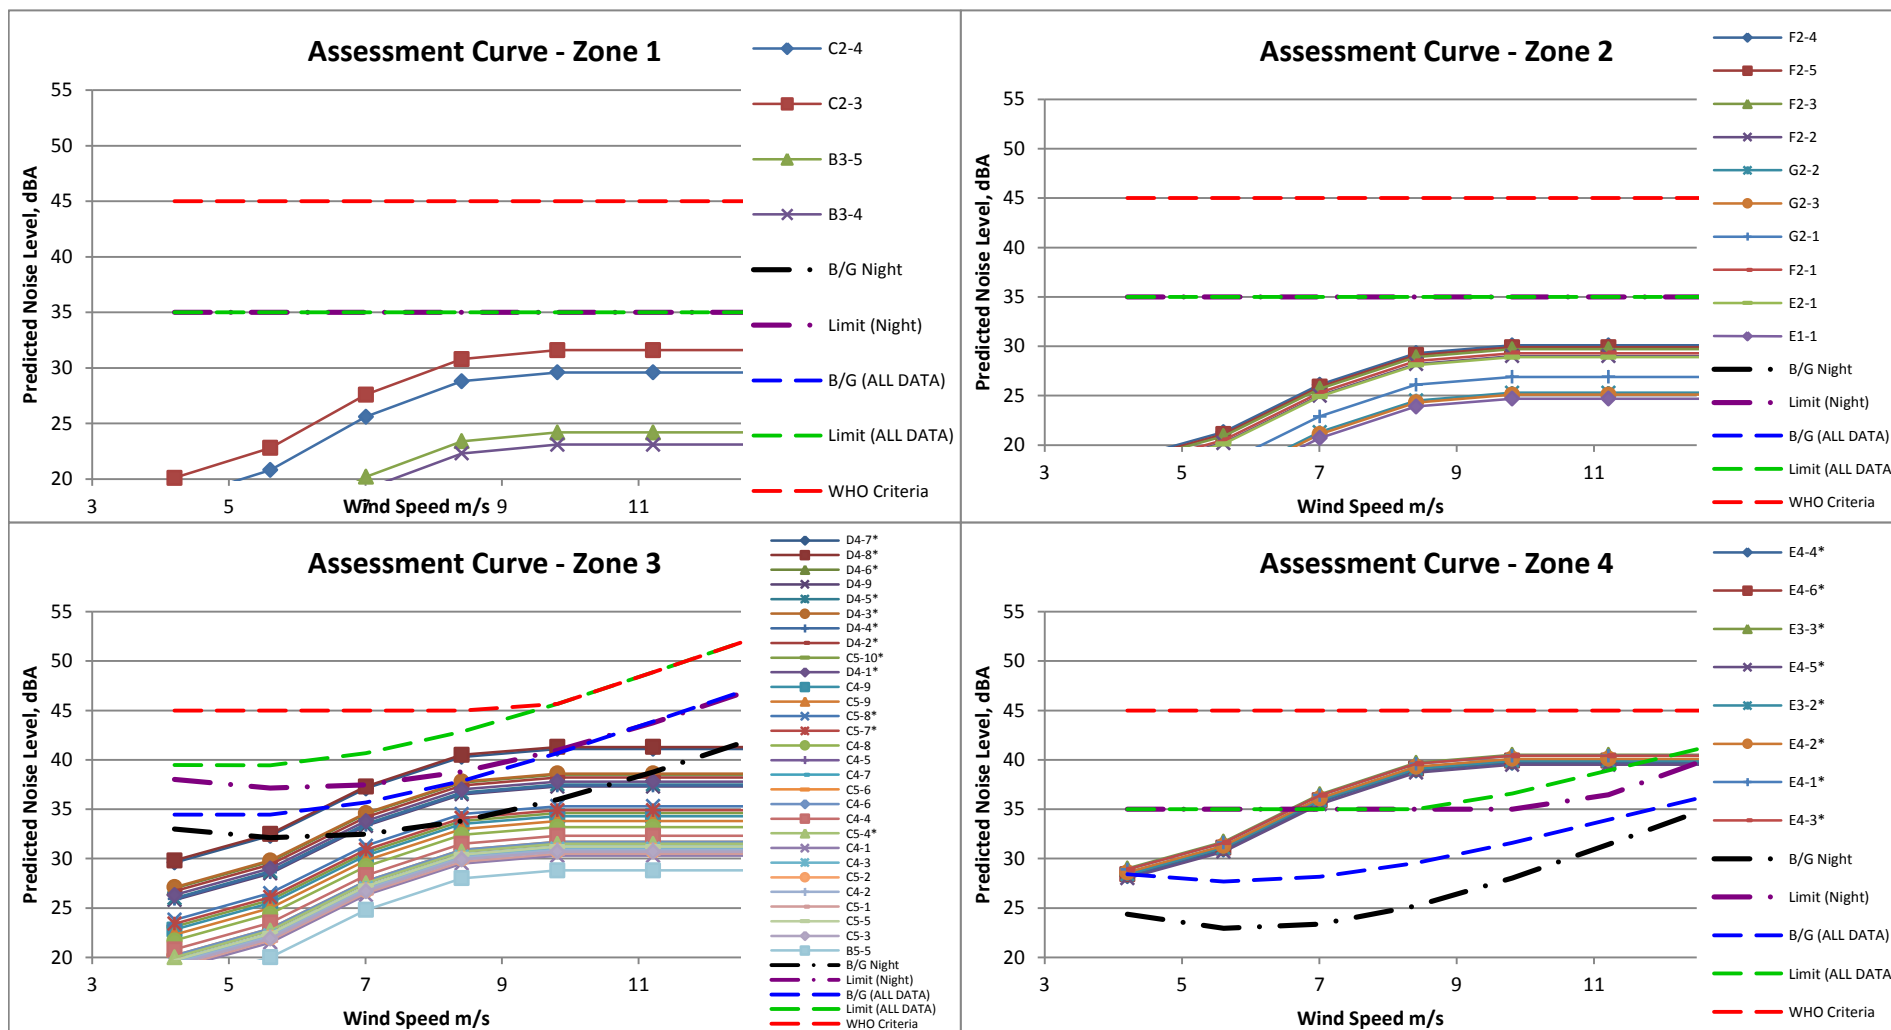

\* Denotes a project-involved location

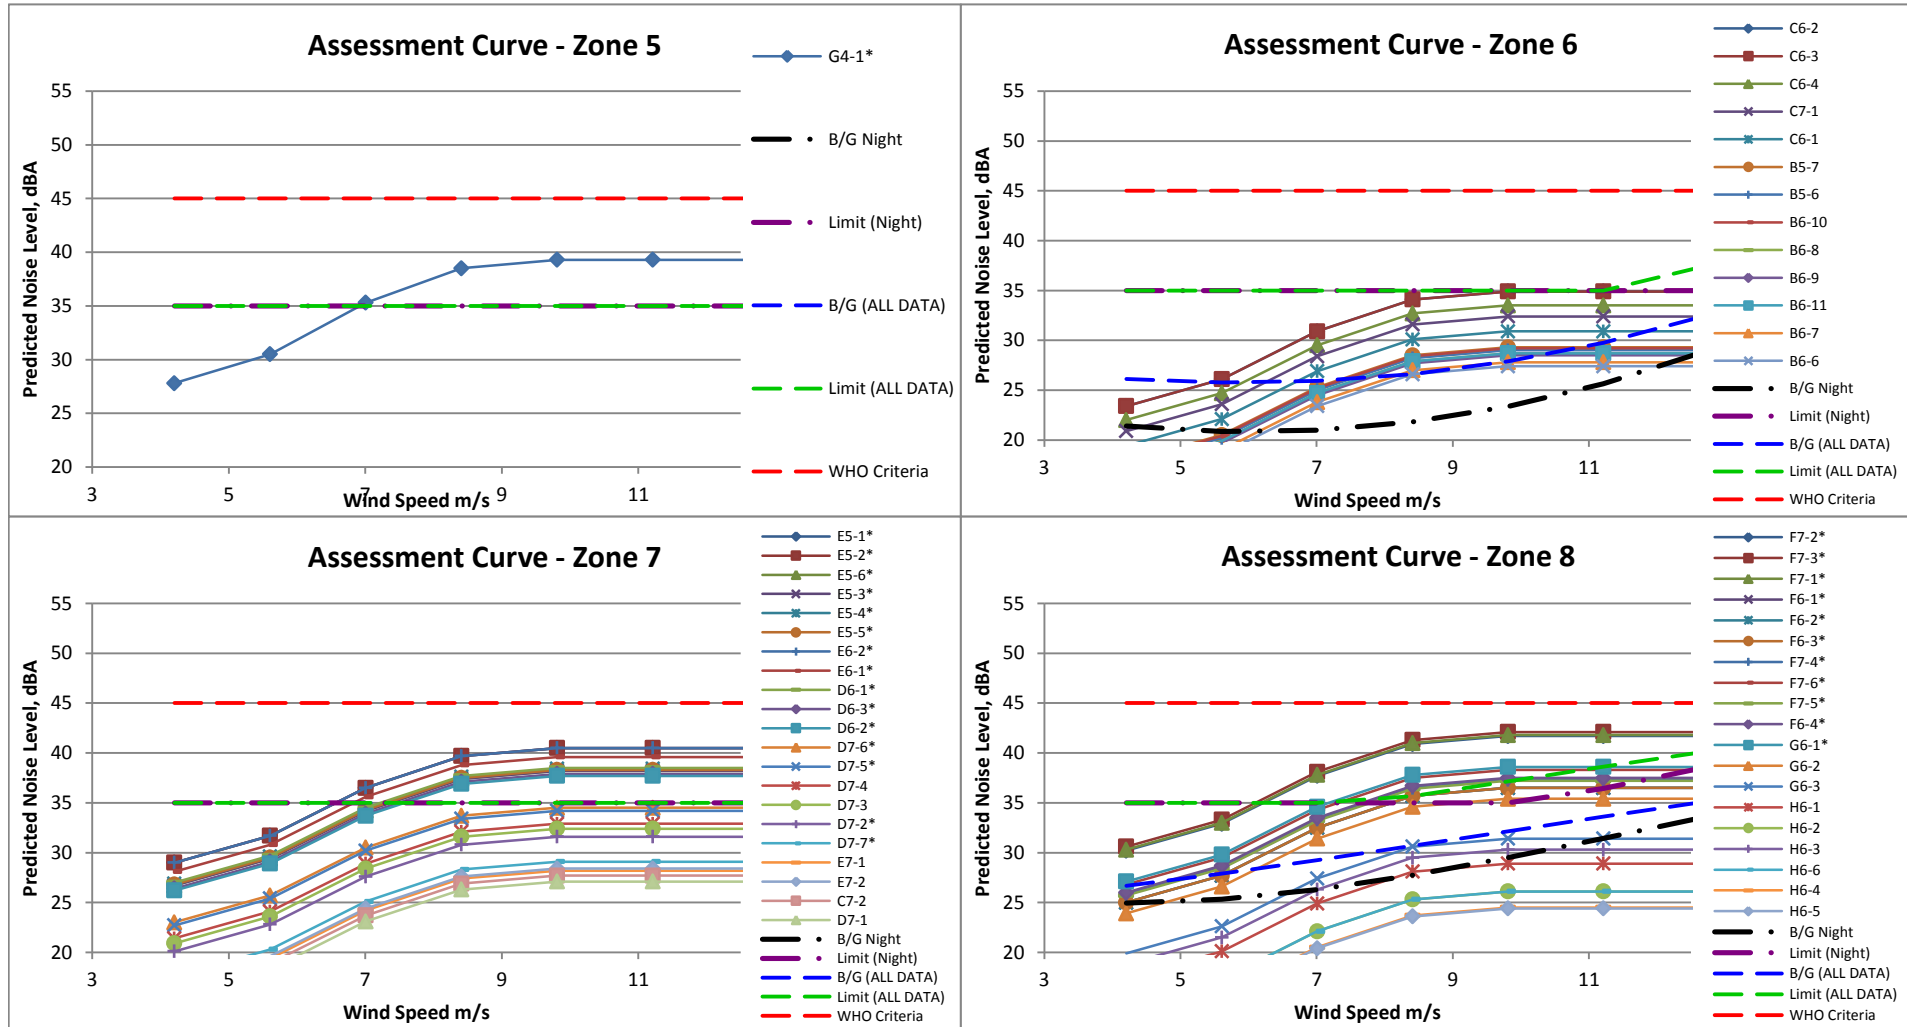

\*1 Denotes a project-involved location

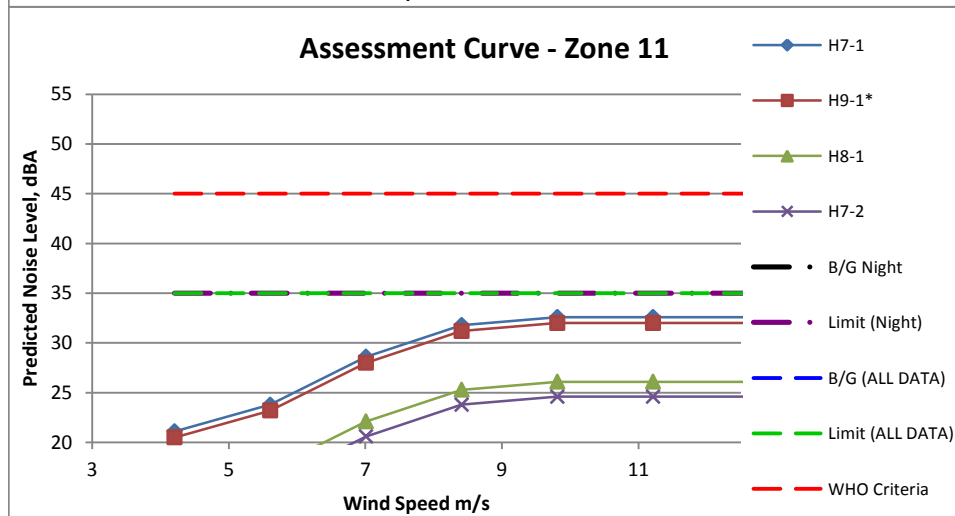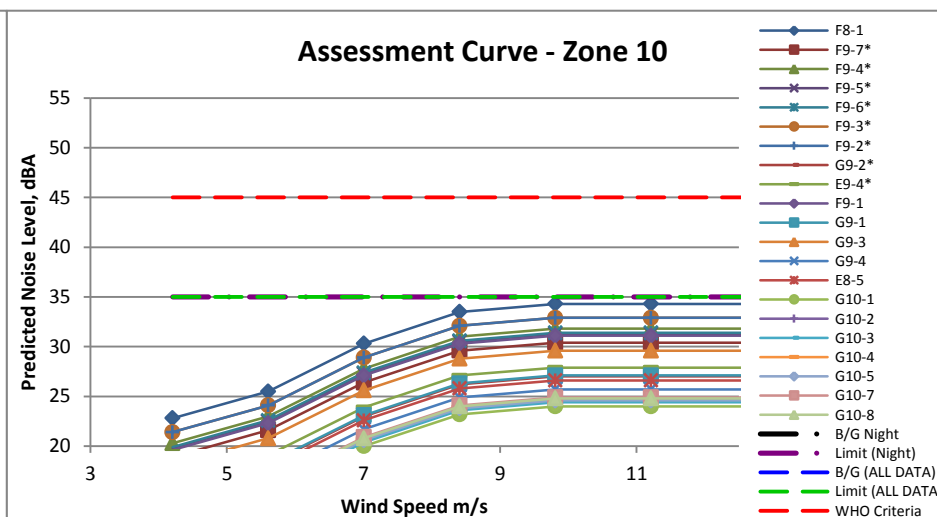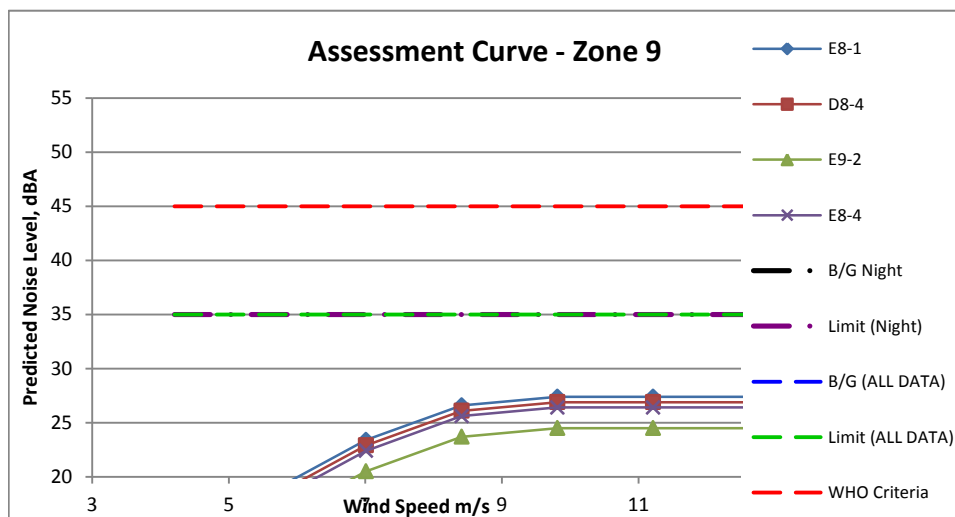

\*1 Denotes a project-involved location

<b>Zone 1</b>		3 m/s	4 m/s	5 m/s	6 m/s	7 m/s	8 m/s	9 m/s	10 m/s	11 m/s	12 m/s
SA EPA Criteria		35	35	35	35	35	35	35	35	35	35
EPA Night Criteria		35	35	35	35	35	35	35	35	35	35
WHO Criteria		45	45	45	45	45	45	45	45	45	45
<i>Wind Speed</i>	<i>(Hub Height)</i>	4.3	5.7	7.2	8.6	10.0	11.5	12.9	14.3	15.8	17.2
C2-4		18.1	20.8	25.6	28.8	29.6	29.6	29.6	29.6	29.6	29.6
C2-3		20.1	22.8	27.6	30.8	31.6	31.6	31.6	31.6	31.6	31.6
B3-5		12.7	15.4	20.2	23.4	24.2	24.2	24.2	24.2	24.2	24.2
B3-4		11.6	14.3	19.1	22.3	23.1	23.1	23.1	23.1	23.1	23.1

<b>Zone 2</b>		3 m/s	4 m/s	5 m/s	6 m/s	7 m/s	8 m/s	9 m/s	10 m/s	11 m/s	12 m/s
SA EPA Criteria		35	35	35	35	35	35	35	35	35	35
EPA Night Criteria		35	35	35	35	35	35	35	35	35	35
WHO Criteria		45	45	45	45	45	45	45	45	45	45
<i>Wind Speed</i>	<i>(Hub Height)</i>	4.3	5.7	7.2	8.6	10.0	11.5	12.9	14.3	15.8	17.2
F2-4		18.6	21.3	26.1	29.3	30.1	30.1	30.1	30.1	30.1	30.1
F2-5		18.4	21.1	25.9	29.1	29.9	29.9	29.9	29.9	29.9	29.9
F2-3		18.2	20.9	25.7	28.9	29.7	29.7	29.7	29.7	29.7	29.7
F2-2		17.5	20.2	25.0	28.2	29.0	29.0	29.0	29.0	29.0	29.0
G2-2		13.8	16.5	21.3	24.5	25.3	25.3	25.3	25.3	25.3	25.3
G2-3		13.6	16.3	21.1	24.3	25.1	25.1	25.1	25.1	25.1	25.1
G2-1		15.4	18.1	22.9	26.1	26.9	26.9	26.9	26.9	26.9	26.9
F2-1		17.8	20.5	25.3	28.5	29.3	29.3	29.3	29.3	29.3	29.3
E2-1		17.4	20.1	24.9	28.1	28.9	28.9	28.9	28.9	28.9	28.9
E1-1		13.2	15.9	20.7	23.9	24.7	24.7	24.7	24.7	24.7	24.7

<b>Zone 3</b>		3 m/s	4 m/s	5 m/s	6 m/s	7 m/s	8 m/s	9 m/s	10 m/s	11 m/s	12 m/s
B/G Regression Line	$-0.0179x^3 + 0.618x^2 - 4.7474x + 44.815$	34	34	36	38	41	44	47	50	53	55
SA EPA Criteria		39	39	41	43	46	49	52	55	58	60
NIGHT BG Regression Line	$-0.012x^3 + 0.5121x^2 - 4.7601x + 44.829$	33	32	32	34	36	39	42	45	49	52
EPA Night Criteria		38	37	37	39	41	44	47	50	54	57
WHO Criteria		45	45	45	45	46	49	52	55	58	60
<i>Wind Speed</i>	<i>(Hub Height)</i>	4.3	5.7	7.2	8.6	10.0	11.5	12.9	14.3	15.8	17.2
D4-7*		29.6	32.3	37.1	40.3	41.1	41.1	41.1	41.1	41.1	41.1
D4-8*		29.8	32.5	37.3	40.5	41.3	41.3	41.3	41.3	41.3	41.3
D4-6*		27.0	29.7	34.5	37.7	38.5	38.5	38.5	38.5	38.5	38.5
D4-9		25.8	28.5	33.3	36.5	37.3	37.3	37.3	37.3	37.3	37.3
D4-5*		26.0	28.7	33.5	36.7	37.5	37.5	37.5	37.5	37.5	37.5
D4-3*		27.1	29.8	34.6	37.8	38.6	38.6	38.6	38.6	38.6	38.6
D4-4*		25.9	28.6	33.4	36.6	37.4	37.4	37.4	37.4	37.4	37.4
D4-2*		26.7	29.4	34.2	37.4	38.2	38.2	38.2	38.2	38.2	38.2
C5-10*		23.1	25.8	30.6	33.8	34.6	34.6	34.6	34.6	34.6	34.6
D4-1*		26.3	29.0	33.8	37.0	37.8	37.8	37.8	37.8	37.8	37.8
C4-9		22.8	25.5	30.3	33.5	34.3	34.3	34.3	34.3	34.3	34.3
C5-9		22.3	25.0	29.8	33.0	33.8	33.8	33.8	33.8	33.8	33.8
C5-8*		23.8	26.5	31.3	34.5	35.3	35.3	35.3	35.3	35.3	35.3
C5-7*		23.4	26.1	30.9	34.1	34.9	34.9	34.9	34.9	34.9	34.9
C4-8		21.7	24.4	29.2	32.4	33.2	33.2	33.2	33.2	33.2	33.2
C4-5		20.0	22.7	27.5	30.7	31.5	31.5	31.5	31.5	31.5	31.5

<b>Zone 3</b>		3 m/s	4 m/s	5 m/s	6 m/s	7 m/s	8 m/s	9 m/s	10 m/s	11 m/s	12 m/s
B/G Regression Line	$-0.0179x^3 + 0.618x^2 - 4.7474x + 44.815$	34	34	36	38	41	44	47	50	53	55
SA EPA Criteria		39	39	41	43	46	49	52	55	58	60
NIGHT BG Regression Line	$-0.012x^3 + 0.5121x^2 - 4.7601x + 44.829$	33	32	32	34	36	39	42	45	49	52
EPA Night Criteria		38	37	37	39	41	44	47	50	54	57
WHO Criteria		45	45	45	45	46	49	52	55	58	60
<i>Wind Speed</i>	<i>(Hub Height)</i>	4.3	5.7	7.2	8.6	10.0	11.5	12.9	14.3	15.8	17.2
C4-7		19.7	22.4	27.2	30.4	31.2	31.2	31.2	31.2	31.2	31.2
C5-6		20.2	22.9	27.7	30.9	31.7	31.7	31.7	31.7	31.7	31.7
C4-6		20.2	22.9	27.7	30.9	31.7	31.7	31.7	31.7	31.7	31.7
C4-4		20.8	23.5	28.3	31.5	32.3	32.3	32.3	32.3	32.3	32.3
C5-4*		20.0	22.7	27.5	30.7	31.5	31.5	31.5	31.5	31.5	31.5
C4-1		18.8	21.5	26.3	29.5	30.3	30.3	30.3	30.3	30.3	30.3
C4-3		19.5	22.2	27.0	30.2	31.0	31.0	31.0	31.0	31.0	31.0
C5-2		19.3	22.0	26.8	30.0	30.8	30.8	30.8	30.8	30.8	30.8
C4-2		19.4	22.1	26.9	30.1	30.9	30.9	30.9	30.9	30.9	30.9
C5-1		19.0	21.7	26.5	29.7	30.5	30.5	30.5	30.5	30.5	30.5
C5-5		19.7	22.4	27.2	30.4	31.2	31.2	31.2	31.2	31.2	31.2
C5-3		19.2	21.9	26.7	29.9	30.7	30.7	30.7	30.7	30.7	30.7
B5-5		17.3	20.0	24.8	28.0	28.8	28.8	28.8	28.8	28.8	28.8

<b>Zone 4</b>		3 m/s	4 m/s	5 m/s	6 m/s	7 m/s	8 m/s	9 m/s	10 m/s	11 m/s	12 m/s
B/G Regression Line	$-0.0192x^3 + 0.6402x^2 - 5.4028x + 41.217$	28	28	28	30	32	34	36	38	40	40
SA EPA Criteria		35	35	35	35	37	39	41	43	45	45
NIGHT BG Regression Line	$-0.027x^3 + 0.933x^2 - 8.1976x + 44.311$	24	23	23	25	28	31	35	38	41	42
EPA Night Criteria		35	35	35	35	35	36	40	43	46	47
WHO Criteria		45	45	45	45	45	45	45	45	45	45
<i>Wind Speed</i>	<i>(Hub Height)</i>	4.3	5.7	7.2	8.6	10.0	11.5	12.9	14.3	15.8	17.2
<i>E4-4*</i>		28.2	30.9	35.7	38.9	39.7	39.7	39.7	39.7	39.7	39.7
<i>E4-6*</i>		28.4	31.1	35.9	39.1	39.9	39.9	39.9	39.9	39.9	39.9
<i>E3-3*</i>		29.0	31.7	36.5	39.7	40.5	40.5	40.5	40.5	40.5	40.5
<i>E4-5*</i>		28.0	30.7	35.5	38.7	39.5	39.5	39.5	39.5	39.5	39.5
<i>E3-2*</i>		28.4	31.1	35.9	39.1	39.9	39.9	39.9	39.9	39.9	39.9
<i>E4-2</i>		28.6	31.3	36.1	39.3	40.1	40.1	40.1	40.1	40.1	40.1
<i>E4-1</i>		28.9	31.6	36.4	39.6	40.4	40.4	40.4	40.4	40.4	40.4
<i>E4-3</i>		28.9	31.6	36.4	39.6	40.4	40.4	40.4	40.4	40.4	40.4
<b>Zone 5</b>		3 m/s	4 m/s	5 m/s	6 m/s	7 m/s	8 m/s	9 m/s	10 m/s	11 m/s	12 m/s
SA EPA Criteria		35	35	35	35	35	35	35	35	35	35
EPA Night Criteria		35	35	35	35	35	35	35	35	35	35
WHO Criteria		45	45	45	45	45	45	45	45	45	45
<i>Wind Speed</i>	<i>(Hub Height)</i>	4.3	5.7	7.2	8.6	10.0	11.5	12.9	14.3	15.8	17.2
<i>G4-1*</i>		27.8	30.5	35.3	38.5	39.3	39.3	39.3	39.3	39.3	39.3



<b>Zone 6</b>		3 m/s	4 m/s	5 m/s	6 m/s	7 m/s	8 m/s	9 m/s	10 m/s	11 m/s	12 m/s
SA EPA Criteria		35	35	35	35	35	35	35	35	35	35
EPA Night Criteria		35	35	35	35	35	35	35	35	35	35
WHO Criteria		45	45	45	45	45	45	45	45	45	45
<i>Wind Speed</i>	<i>(Hub Height)</i>	4.3	5.7	7.2	8.6	10.0	11.5	12.9	14.3	15.8	17.2
C6-2		23.4	26.1	30.9	34.1	34.9	34.9	34.9	34.9	34.9	34.9
C6-3		23.4	26.1	30.9	34.1	34.9	34.9	34.9	34.9	34.9	34.9
C6-4		22.0	24.7	29.5	32.7	33.5	33.5	33.5	33.5	33.5	33.5
C7-1		20.9	23.6	28.4	31.6	32.4	32.4	32.4	32.4	32.4	32.4
C6-1		19.4	22.1	26.9	30.1	30.9	30.9	30.9	30.9	30.9	30.9
B5-7		17.8	20.5	25.3	28.5	29.3	29.3	29.3	29.3	29.3	29.3
B5-6		17.5	20.2	25.0	28.2	29.0	29.0	29.0	29.0	29.0	29.0
B6-10		17.7	20.4	25.2	28.4	29.2	29.2	29.2	29.2	29.2	29.2
B6-8		17.2	19.9	24.7	27.9	28.7	28.7	28.7	28.7	28.7	28.7
B6-9		17.0	19.7	24.5	27.7	28.5	28.5	28.5	28.5	28.5	28.5
B6-11		17.2	19.9	24.7	27.9	28.7	28.7	28.7	28.7	28.7	28.7
B6-7		16.3	19.0	23.8	27.0	27.8	27.8	27.8	27.8	27.8	27.8

<b>Zone 7</b>		3 m/s	4 m/s	5 m/s	6 m/s	7 m/s	8 m/s	9 m/s	10 m/s	11 m/s	12 m/s
SA EPA Criteria		35	35	35	35	35	35	35	35	35	35
EPA Night Criteria		35	35	35	35	35	35	35	35	35	35
WHO Criteria		45	45	45	45	45	45	45	45	45	45
<i>Wind Speed</i>	<i>(Hub Height)</i>	4.3	5.7	7.2	8.6	10.0	11.5	12.9	14.3	15.8	17.2
E5-1*		29.0	31.7	36.5	39.7	40.5	40.5	40.5	40.5	40.5	40.5
E5-2*		29.0	31.7	36.5	39.7	40.5	40.5	40.5	40.5	40.5	40.5

<b>Zone 7</b>		3 m/s	4 m/s	5 m/s	6 m/s	7 m/s	8 m/s	9 m/s	10 m/s	11 m/s	12 m/s
SA EPA Criteria		35	35	35	35	35	35	35	35	35	35
EPA Night Criteria		35	35	35	35	35	35	35	35	35	35
WHO Criteria		45	45	45	45	45	45	45	45	45	45
<i>Wind Speed</i>	<i>(Hub Height)</i>	4.3	5.7	7.2	8.6	10.0	11.5	12.9	14.3	15.8	17.2
<i>E5-6*</i>		26.7	29.4	34.2	37.4	38.2	38.2	38.2	38.2	38.2	38.2
<i>E5-3*</i>		26.7	29.4	34.2	37.4	38.2	38.2	38.2	38.2	38.2	38.2
<i>E5-4*</i>		26.9	29.6	34.4	37.6	38.4	38.4	38.4	38.4	38.4	38.4
<i>E5-5*</i>		26.8	29.5	34.3	37.5	38.3	38.3	38.3	38.3	38.3	38.3
<i>E6-2*</i>		29.0	31.7	36.5	39.7	40.5	40.5	40.5	40.5	40.5	40.5
<i>E6-1*</i>		28.1	30.8	35.6	38.8	39.6	39.6	39.6	39.6	39.6	39.6
<i>D6-1*</i>		27.0	29.7	34.5	37.7	38.5	38.5	38.5	38.5	38.5	38.5
<i>D6-3*</i>		26.4	29.1	33.9	37.1	37.9	37.9	37.9	37.9	37.9	37.9
<i>D6-2*</i>		26.2	28.9	33.7	36.9	37.7	37.7	37.7	37.7	37.7	37.7
<i>D7-6*</i>		23.0	25.7	30.5	33.7	34.5	34.5	34.5	34.5	34.5	34.5
<i>D7-5*</i>		22.7	25.4	30.2	33.4	34.2	34.2	34.2	34.2	34.2	34.2
<i>D7-4</i>		21.4	24.1	28.9	32.1	32.9	32.9	32.9	32.9	32.9	32.9
<i>D7-3</i>		20.9	23.6	28.4	31.6	32.4	32.4	32.4	32.4	32.4	32.4
<i>D7-2*</i>		20.1	22.8	27.6	30.8	31.6	31.6	31.6	31.6	31.6	31.6
<i>D7-7*</i>		17.6	20.3	25.1	28.3	29.1	29.1	29.1	29.1	29.1	29.1
<i>E7-1</i>		16.7	19.4	24.2	27.4	28.2	28.2	28.2	28.2	28.2	28.2
<i>E7-2</i>		16.9	19.6	24.4	27.6	28.4	28.4	28.4	28.4	28.4	28.4
<i>C7-2</i>		16.2	18.9	23.7	26.9	27.7	27.7	27.7	27.7	27.7	27.7
<i>D7-1</i>		15.6	18.3	23.1	26.3	27.1	27.1	27.1	27.1	27.1	27.1

<b>Zone 8</b>		3 m/s	4 m/s	5 m/s	6 m/s	7 m/s	8 m/s	9 m/s	10 m/s	11 m/s	12 m/s
B/G Regression Line	$-0.0026x^3 + 0.0751x^2 + 0.3365x + 24.14$	27	28	29	31	32	34	35	36	38	39
SA EPA Criteria		35	35	35	36	37	39	40	41	43	44
NIGHT BG Regression Line	$-0.0084x^3 + 0.2942x^2 - 1.9926x + 28.741$	25	25	26	28	29	31	33	35	37	38
EPA Night Criteria		35	35	35	35	35	36	38	40	42	43
WHO Criteria		45	45	45	45	45	45	45	45	45	45
<i>Wind Speed</i>	<i>(Hub Height)</i>	4.3	5.7	7.2	8.6	10.0	11.5	12.9	14.3	15.8	17.2
F7-2*		30.2	32.9	37.7	40.9	41.7	41.7	41.7	41.7	41.7	41.7
F7-3*		30.6	33.3	38.1	41.3	42.1	42.1	42.1	42.1	42.1	42.1
F7-1*		30.3	33.0	37.8	41.0	41.8	41.8	41.8	41.8	41.8	41.8
F6-1*		25.0	27.7	32.5	35.7	36.5	36.5	36.5	36.5	36.5	36.5
F6-2*		25.0	27.7	32.5	35.7	36.5	36.5	36.5	36.5	36.5	36.5
F6-3*		25.0	27.7	32.5	35.7	36.5	36.5	36.5	36.5	36.5	36.5
F7-4*		25.8	28.5	33.3	36.5	37.3	37.3	37.3	37.3	37.3	37.3
F7-6*		26.8	29.5	34.3	37.5	38.3	38.3	38.3	38.3	38.3	38.3
F7-5*		25.7	28.4	33.2	36.4	37.2	37.2	37.2	37.2	37.2	37.2
F6-4*		26.0	28.7	33.5	36.7	37.5	37.5	37.5	37.5	37.5	37.5
G6-1*		27.1	29.8	34.6	37.8	38.6	38.6	38.6	38.6	38.6	38.6
G6-2		23.9	26.6	31.4	34.6	35.4	35.4	35.4	35.4	35.4	35.4
G6-3		19.9	22.6	27.4	30.6	31.4	31.4	31.4	31.4	31.4	31.4
H6-1		17.4	20.1	24.9	28.1	28.9	28.9	28.9	28.9	28.9	28.9
H6-2		14.6	17.3	22.1	25.3	26.1	26.1	26.1	26.1	26.1	26.1
H6-3		18.8	21.5	26.3	29.5	30.3	30.3	30.3	30.3	30.3	30.3
H6-6		14.6	17.3	22.1	25.3	26.1	26.1	26.1	26.1	26.1	26.1

<b>Zone 8</b>		3 m/s	4 m/s	5 m/s	6 m/s	7 m/s	8 m/s	9 m/s	10 m/s	11 m/s	12 m/s
B/G Regression Line	$-0.0026x^3 + 0.0751x^2 + 0.3365x + 24.14$	27	28	29	31	32	34	35	36	38	39
SA EPA Criteria		35	35	35	36	37	39	40	41	43	44
NIGHT BG Regression Line	$-0.0084x^3 + 0.2942x^2 - 1.9926x + 28.741$	25	25	26	28	29	31	33	35	37	38
EPA Night Criteria		35	35	35	35	35	36	38	40	42	43
WHO Criteria		45	45	45	45	45	45	45	45	45	45
<i>Wind Speed</i>	<i>(Hub Height)</i>	4.3	5.7	7.2	8.6	10.0	11.5	12.9	14.3	15.8	17.2
H6-4		13.0	15.7	20.5	23.7	24.5	24.5	24.5	24.5	24.5	24.5
H6-5		12.9	15.6	20.4	23.6	24.4	24.4	24.4	24.4	24.4	24.4

<b>Zone 9</b>		3 m/s	4 m/s	5 m/s	6 m/s	7 m/s	8 m/s	9 m/s	10 m/s	11 m/s	12 m/s
SA EPA Criteria		35	35	35	35	35	35	35	35	35	35
EPA Night Criteria		35	35	35	35	35	35	35	35	35	35
WHO Criteria		45	45	45	45	45	45	45	45	45	45
<i>Wind Speed</i>	<i>(Hub Height)</i>	4.3	5.7	7.2	8.6	10.0	11.5	12.9	14.3	15.8	17.2
E8-1		15.9	18.6	23.4	26.6	27.4	27.4	27.4	27.4	27.4	27.4
D8-4		15.4	18.1	22.9	26.1	26.9	26.9	26.9	26.9	26.9	26.9
E9-2		13.0	15.7	20.5	23.7	24.5	24.5	24.5	24.5	24.5	24.5
E8-4		14.9	17.6	22.4	25.6	26.4	26.4	26.4	26.4	26.4	26.4

<b>Zone 10</b>		3 m/s	4 m/s	5 m/s	6 m/s	7 m/s	8 m/s	9 m/s	10 m/s	11 m/s	12 m/s
SA EPA Criteria		35	35	35	35	35	35	35	35	35	35
EPA Night Criteria		35	35	35	35	35	35	35	35	35	35
WHO Criteria		45	45	45	45	45	45	45	45	45	45
<i>Wind Speed</i>	<i>(Hub Height)</i>	4.3	5.7	7.2	8.6	10.0	11.5	12.9	14.3	15.8	17.2
<i>F8-1</i>		22.8	25.5	30.3	33.5	34.3	34.3	34.3	34.3	34.3	34.3
<i>F9-7*</i>		18.9	21.6	26.4	29.6	30.4	30.4	30.4	30.4	30.4	30.4
<i>F9-4*</i>		20.3	23.0	27.8	31.0	31.8	31.8	31.8	31.8	31.8	31.8
<i>F9-5*</i>		19.8	22.5	27.3	30.5	31.3	31.3	31.3	31.3	31.3	31.3
<i>F9-6*</i>		19.9	22.6	27.4	30.6	31.4	31.4	31.4	31.4	31.4	31.4
<i>F9-3*</i>		21.4	24.1	28.9	32.1	32.9	32.9	32.9	32.9	32.9	32.9
<i>F9-2*</i>		21.4	24.1	28.9	32.1	32.9	32.9	32.9	32.9	32.9	32.9
<i>G9-2*</i>		15.5	18.2	23.0	26.2	27.0	27.0	27.0	27.0	27.0	27.0
<i>E9-4*</i>		16.4	19.1	23.9	27.1	27.9	27.9	27.9	27.9	27.9	27.9
<i>F9-1</i>		19.6	22.3	27.1	30.3	31.1	31.1	31.1	31.1	31.1	31.1
<i>G9-1</i>		15.6	18.3	23.1	26.3	27.1	27.1	27.1	27.1	27.1	27.1
<i>G9-3</i>		18.1	20.8	25.6	28.8	29.6	29.6	29.6	29.6	29.6	29.6
<i>G9-4</i>		14.2	16.9	21.7	24.9	25.7	25.7	25.7	25.7	25.7	25.7
<i>E8-5</i>		15.1	17.8	22.6	25.8	26.6	26.6	26.6	26.6	26.6	26.6
<i>G10-1</i>		12.5	15.2	20.0	23.2	24.0	24.0	24.0	24.0	24.0	24.0
<i>G10-2</i>		13.1	15.8	20.6	23.8	24.6	24.6	24.6	24.6	24.6	24.6
<i>G10-3</i>		12.9	15.6	20.4	23.6	24.4	24.4	24.4	24.4	24.4	24.4
<i>G10-4</i>		13.2	15.9	20.7	23.9	24.7	24.7	24.7	24.7	24.7	24.7
<i>G10-5</i>		13.1	15.8	20.6	23.8	24.6	24.6	24.6	24.6	24.6	24.6
<i>G10-7</i>		13.4	16.1	20.9	24.1	24.9	24.9	24.9	24.9	24.9	24.9
<i>G10-8</i>		13.3	16.0	20.8	24.0	24.8	24.8	24.8	24.8	24.8	24.8

<b>Zone 11</b>		3 m/s	4 m/s	5 m/s	6 m/s	7 m/s	8 m/s	9 m/s	10 m/s	11 m/s	12 m/s
SA EPA Criteria		35	35	35	35	35	35	35	35	35	35
EPA Night Criteria		35	35	35	35	35	35	35	35	35	35
WHO Criteria		45	45	45	45	45	45	45	45	45	45
<i>Wind Speed</i>	<i>(Hub Height)</i>	4.3	5.7	7.2	8.6	10.0	11.5	12.9	14.3	15.8	17.2
<i>H7-1</i>		21.1	23.8	28.6	31.8	32.6	32.6	32.6	32.6	32.6	32.6
<i>H9-1*</i>		20.5	23.2	28.0	31.2	32.0	32.0	32.0	32.0	32.0	32.0
<i>H8-1</i>		14.6	17.3	22.1	25.3	26.1	26.1	26.1	26.1	26.1	26.1
<i>H7-2</i>		13.1	15.8	20.6	23.8	24.6	24.6	24.6	24.6	24.6	24.6

**WIND TURBINE GENERATOR (WTG)****SOUND POWER LEVEL SPECIFICATION****AS PER IEC-61400-11:2002 (WIND TURBINE GENERATOR SYSTEMS - PART 11: ACOUSTIC NOISE MEASUREMENT TECHNIQUES)**

The following are the official test reports from Vestas for the model V112 Wind Turbine Generator. This data forms the basis of the noise predictions for Liverpool Range Wind Farm. The data is considered commercial in confidence and may not be reproduced without the permission of the manufacturer.

**12.1.3 Noise Curve, Noise Mode 0**

<b>Sound Power Level at Hub Height, Noise Mode 0</b>			
<b>Conditions for Sound Power Level:</b>	<b>Measurement standard IEC 61400-11 ed. 2 2002</b>		
	<b>Wind shear: 0.16</b>		
	<b>Maximum turbulence at 10 metre height: 16%</b>		
	<b>Inflow angle (vertical): 0 ±2°</b>		
	<b>Air density: 1.225 kg/m<sup>3</sup></b>		
<b>Hub Height</b>	<b>84 m</b>	<b>94 m</b>	<b>119 m</b>
LwA @ 3 m/s (10 m above ground) [dBA]	94.5	94.5	94.7
Wind speed at hub height [m/s]	4.2	4.3	4.5
LwA @ 4 m/s (10 m above ground) [dBA]	97.3	97.5	98.1
Wind speed at hub height [m/s]	5.6	5.7	5.9
LwA @ 5 m/s (10 m above ground) [dBA]	100.9	101.2	101.9
Wind speed at hub height [m/s]	7.0	7.2	7.4
LwA @ 6 m/s (10 m above ground) [dBA]	104.3	104.6	105.1
Wind speed at hub height [m/s]	8.4	8.6	8.9
LwA @ 7 m/s (10 m above ground) [dBA]	106.0	106.5	106.5
Wind speed at hub height [m/s]	9.8	10.0	10.4
LwA @ 8 m/s (10 m above ground) [dBA]	106.5	106.5	106.5
Wind speed at hub height [m/s]	11.2	11.4	11.9
LwA @ 9 m/s (10 m above ground) [dBA]	106.5	106.5	106.5
Wind speed at hub height [m/s]	12.7	12.9	13.4
LwA @ 10 m/s (10 m above ground) [dBA]	106.5	106.5	106.5
Wind speed at hub height [m/s]	14.1	14.3	14.9
LwA @ 11 m/s (10 m above ground) [dBA]	106.5	106.5	106.5
Wind speed at hub height [m/s]	15.5	15.7	16.3
LwA @ 12 m/s (10 m above ground) [dBA]	106.5	106.5	106.5
Wind speed at hub height [m/s]	16.9	17.2	17.8
LwA @ 13 m/s (10 m above ground) [dBA]	106.5	106.5	106.5
Wind speed at hub height [m/s]	18.3	18.6	19.3

Table 12-3: Noise curve, noise mode 0




**12.3.3 Noise Curve, Noise Mode 2**

<b>Sound Power Level at Hub Height, Noise Mode 2</b>			
<b>Conditions for Sound Power Level:</b>	<b>Measurement standard IEC 61400-11 ed. 2 2002</b>		
	<b>Wind shear: 0.16</b>		
	<b>Maximum turbulence at 10 metre height: 16%</b>		
	<b>Inflow angle (vertical): 0 ±2°</b>		
	<b>Air density: 1.225 kg/m<sup>3</sup></b>		
<b>Hub Height</b>	<b>84 m</b>	<b>94 m</b>	<b>119 m</b>
LwA @ 3 m/s (10 m above ground) [dBA]	94.5	94.5	94.7
Wind speed at hub height [m/s]	4.2	4.3	4.5
LwA @ 4 m/s (10 m above ground) [dBA]	97.3	97.5	98.1
Wind speed at hub height [m/s]	5.6	5.7	5.9
LwA @ 5 m/s (10 m above ground) [dBA]	100.9	101.2	101.9
Wind speed at hub height [m/s]	7.0	7.2	7.4
LwA @ 6 m/s (10 m above ground) [dBA]	104.5	104.5	104.5
Wind speed at hub height [m/s]	8.4	8.6	8.9
LwA @ 7 m/s (10 m above ground) [dBA]	104.5	104.5	104.5
Wind speed at hub height [m/s]	9.8	10.0	10.4
LwA @ 8 m/s (10 m above ground) [dBA]	104.5	104.5	104.5
Wind speed at hub height [m/s]	11.2	11.4	11.9
LwA @ 9 m/s (10 m above ground) [dBA]	104.5	104.5	104.5
Wind speed at hub height [m/s]	12.7	12.9	13.4
LwA @ 10 m/s (10 m above ground) [dBA]	104.5	104.5	104.5
Wind speed at hub height [m/s]	14.1	14.3	14.9
LwA @ 11 m/s (10 m above ground) [dBA]	104.5	104.5	104.5
Wind speed at hub height [m/s]	15.5	15.7	16.3
LwA @ 12 m/s (10 m above ground) [dBA]	104.5	104.5	104.5
Wind speed at hub height [m/s]	16.9	17.2	17.8
LwA @ 13 m/s (10 m above ground) [dBA]	104.5	104.5	104.5
Wind speed at hub height [m/s]	18.3	18.6	19.3

Table 12-9: Noise curve, noise mode 2.

**Annex 4.3: A-weighted sound pressure 1/3-octave spectrum at 8 m/s**

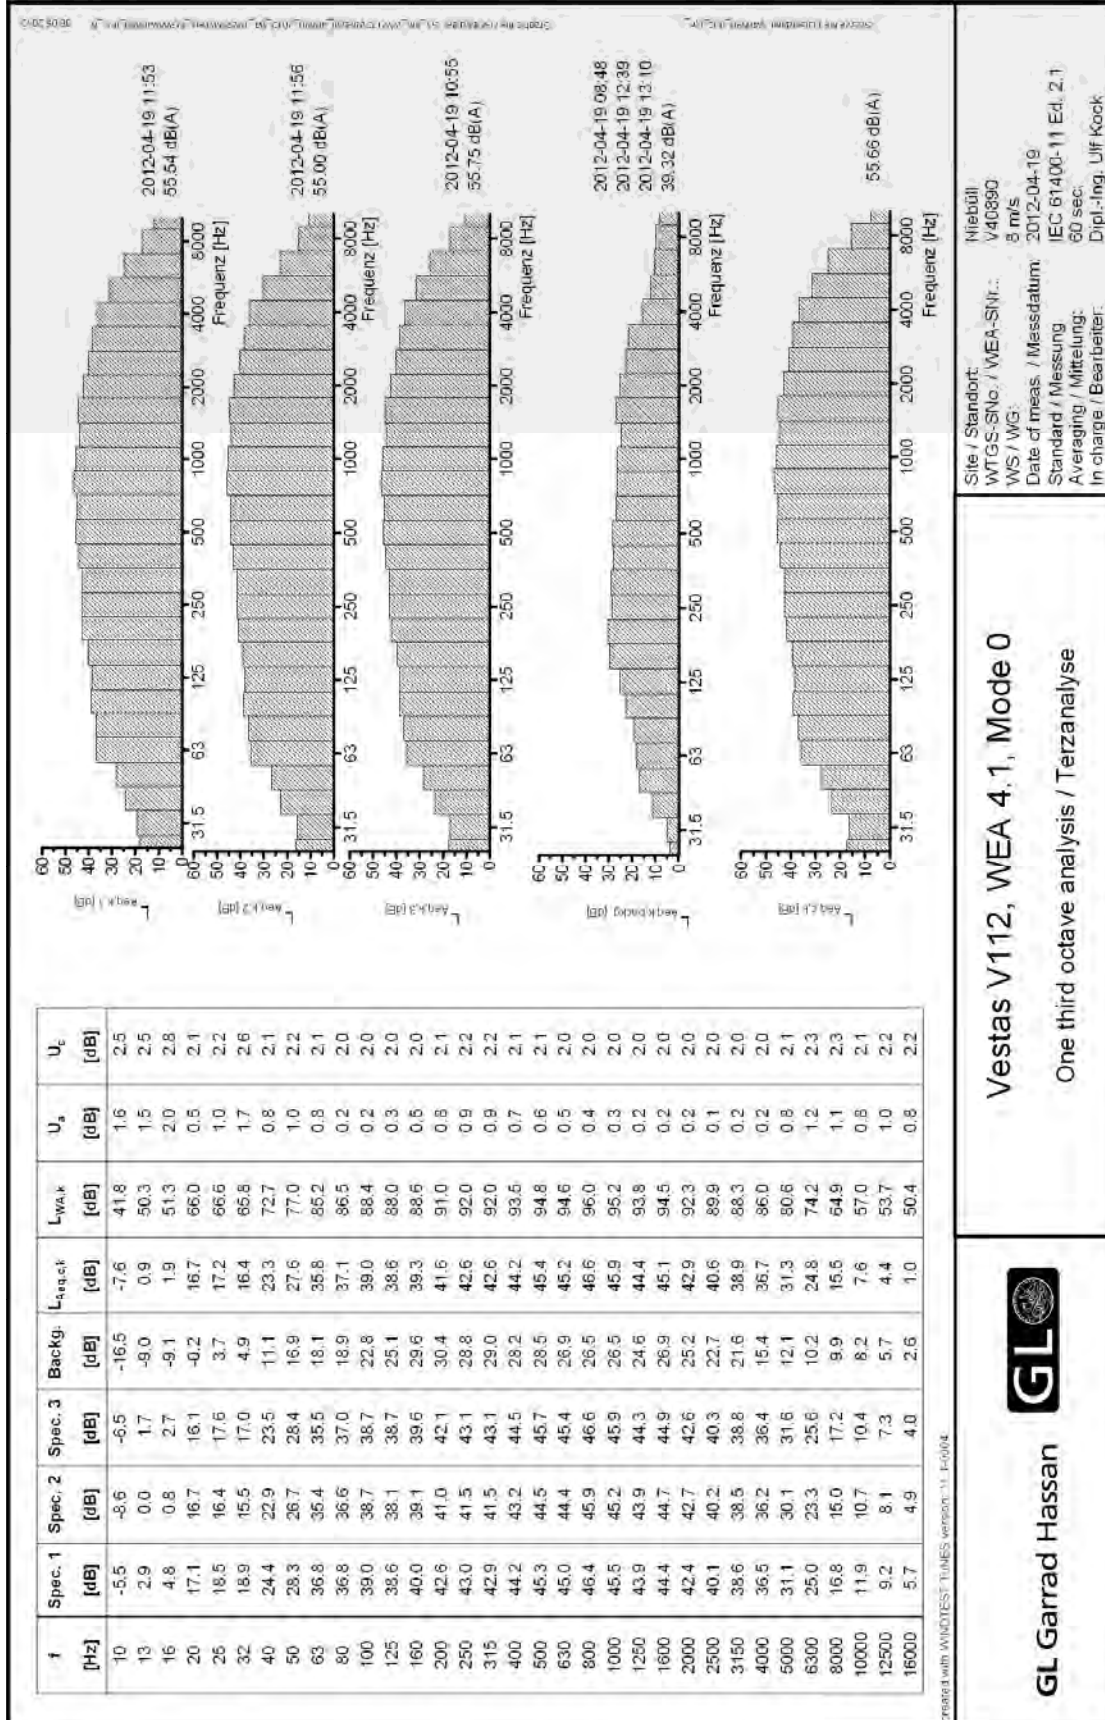

Site / Standort: Niebüll  
WTGS-SNo. / WEA-SNr.: V40890  
WS / WG: 8 m/s  
Date of meas. / Messdatum: 2012-04-19  
Standard / Messung: IEC 61400-11 Ed. 2.1  
Averaging / Mittelung: 60 sec.  
In charge / Bearbeiter: Dipl.-Ing. Ulf Kock

**Vestas V112, WEA 4.1, Mode 0**  
One third octave analysis / Terzanalyse



## 5 Summary

As ordered by Vestas Wind Systems A/S, 8940 Randers, Denmark, GL Garrad Hassan Deutschland GmbH took measurements of the acoustic noise emissions on the WTGS Vestas V112 - 3.0 MW with a hub height of 94 m.

All measurements and analysis of the sound power level and tonality described in this report were made on the basis of the international standard [IEC 61400-11 Ed. 2.1]. The analysis of the sound power level was carried out using the standardised wind speed which was calculated from the calculated power curve provided by the customer (see annex).

The data of the WTGS Vestas V112 - 3.0 MW (mode 0) have been evaluated by using a fourth order regression because this is the best fitting approximation over all relevant points.

The results of this measurement are given in table 4.

**Table 4:** Summary of results

<i>wind speed in 10 m height [m/s]</i>	<b>6</b>	<b>7</b>	<b>8</b>	<b>9</b>	<b>10</b>
<i>electrical power output calculated from the power curve [kW]</i>	1676	2548	3032	3074	3075
<i>measured pitch angle [degrees]</i>	-2,1	-3,4	0	5	8
<i>measured rotor speed [min<sup>-1</sup>]</i>	12,3	12,7	12,9	12,9	12,9
<i>sound power level [dB]</i>	103,6	104,7	103,3	101,3	103,0*
<i>combined uncertainty in the sound power level, U<sub>c</sub> [dB]</i>	1,1	1,2	1,8	2,3	1,9
<i>tonality, L<sub>k</sub> [dB]</i>	-5,31	-5,05	-15,28	-13,9	-11,21
<i>tonal audibility, L<sub>a,k</sub> [dB]</i>	-1,97	-3,04	-13,27	-11,88	-9,19
<i>frequency of the most prevalent tone [Hz]</i>	1690	126	126	126	126

\* The sound power level has to be calculated by used of the 4<sup>th</sup> order regression. This leads to an unexpected high value for the sound power level. (see annex 2.1)

***It is assured that this report has been drawn up impartially and with best knowledge and conscience.***



Turbines Ranked by Distance (m)

Receiver	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25 Zone		
B3-4	C3-1, 5.9	C3-2, 6	C3-3, 6.2	C3-4, 6.4	D3-2, 6.7	D3-3, 7.2	D3-4, 7.3	D3-5, 7.7	D3-6, 7.8	D3-7, 8.1	D3-8, 8.4	D3-9, 8.8	D3-10, 9.2	D4-1, 9.5	D3-11, 9.6	D4-4, 9.7	D4-2, 9.8	D4-6, 9.8	D4-5, 9.9	D3-12, 9.9	D4-8, 10	D3-13, 10.2	D3-15, 10.3	D3-16, 10.3	D3-17, 10.6	Zone 1	
B3-5	C3-4, 5.9	C3-2, 5.9	C3-1, 5.9	C3-3, 5.9	D3-2, 6.1	D3-3, 6.5	D3-4, 6.9	D3-5, 6.9	D3-6, 7.2	D3-7, 7.3	D3-8, 7.5	D3-9, 7.9	D3-10, 8.2	D3-11, 8.5	D3-12, 8.8	D3-13, 9	D3-15, 9	D2-1, 9.5	D2-2, 9.6	D2-3, 9.8	D4-4, 9.9	D4-6, 9.9	D4-8, 9.9	D4-1, 10	D3-16, 10.1	Zone 1	
B5-5	C6-6, 5.3	C6-7, 5.5	C6-1, 5.6	C6-2, 5.6	C6-4, 5.6	C5-2, 5.6	C6-5, 5.8	D5-1, 5.9	D5-2, 6.1	D5-3, 6.3	D5-7, 6.8	D6-11, 6.8	D6-1, 6.9	D5-5, 6.9	D5-6, 7.1	D5-8, 7.2	D5-9, 7.3	D5-10, 7.3	D5-11, 7.5	D5-13, 8.1	D5-15, 8.2	D4-8, 8.3	D5-12, 8.3	D5-16, 8.4	D5-18, 8.6	Zone 3	
B5-6	C6-6, 4.5	C6-4, 4.7	C6-5, 4.7	C6-7, 4.8	C5-1, 5	C5-3, 5.2	D5-1, 5.5	C5-2, 5.6	D5-2, 5.7	D5-3, 6.1	D6-11, 6.1	D6-1, 6.2	D5-4, 6.4	D5-5, 6.5	D5-7, 6.5	D5-6, 6.7	D5-9, 7	D5-10, 7.1	D5-8, 7.2	D5-11, 7.4	D5-13, 8	D5-12, 8	D6-10, 8	D6-9, 8.1	D6-8, 8.1	Zone 6	
B5-7	C6-6, 4.5	C6-4, 4.7	C6-5, 4.7	C6-7, 4.7	C5-1, 4.9	C5-3, 5.1	D5-1, 5.4	C5-2, 5.5	D5-2, 5.6	D5-3, 6	D6-11, 6.1	D6-1, 6.2	D5-4, 6.3	D5-5, 6.4	D5-7, 6.4	D5-6, 6.6	D5-9, 6.9	D5-10, 7	D5-8, 7.1	D5-11, 7.3	D5-13, 7.9	D5-12, 7.9	D6-10, 8	D6-9, 8	D6-8, 8	Zone 6	
B6-6	C6-6, 5.5	C6-5, 5.6	C6-4, 5.6	C6-7, 5.8	C5-1, 6	C5-3, 6.3	D5-1, 6.6	C5-2, 6.9	D5-2, 6.9	D6-11, 7.1	D6-1, 7.3	D5-3, 7.3	D5-4, 7.5	D5-5, 7.6	D5-7, 7.7	D5-6, 7.9	D5-9, 8.2	D5-10, 8.4	D5-8, 8.5	D5-11, 8.6	D6-2, 8.9	D6-4, 9	D6-8, 9	D6-6, 9.1	D6-3, 9.1	Zone 6	
B6-7	C6-5, 4.7	C6-4, 4.9	C6-6, 4.9	C6-7, 5.3	C5-1, 5.6	C5-3, 6	D5-1, 6.3	D6-11, 6.4	D5-2, 6.7	D6-1, 6.7	D5-4, 7	C5-2, 7	D5-3, 7.2	D5-5, 7.2	D5-7, 7.5	D5-6, 7.5	D5-9, 7.7	D6-3, 7.8	D6-4, 7.9	D5-11, 8.1	D6-5, 8	D6-6, 8	D6-7, 8.2	D5-10, 8.2	D6-8, 8.2	Zone 6	
B6-8	C6-5, 4.5	C6-6, 4.6	C6-4, 4.7	C6-7, 4.9	C5-1, 5.2	C5-3, 5.5	D5-1, 5.9	D5-2, 6.2	D6-11, 6.2	C5-2, 6.4	D6-1, 6.4	D5-4, 6.6	D5-3, 6.6	D5-5, 6.8	D5-7, 7	D5-6, 7.1	D5-9, 7.5	D5-10, 7.7	D6-2, 7.8	D6-4, 7.9	D6-3, 7.9	D5-8, 8	D5-11, 8	D6-6, 8	D6-8, 8	Zone 6	
B6-9	C6-5, 4.5	C6-6, 4.6	C6-4, 4.7	C6-7, 5	C5-1, 5.2	C5-3, 5.6	D5-1, 5.9	D6-11, 6.2	D5-2, 6.2	D6-1, 6.4	C5-2, 6.4	D5-4, 6.7	D5-3, 6.7	D5-5, 6.8	D5-7, 7.1	D5-6, 7.1	D5-9, 7.5	D5-10, 7.7	D6-2, 7.7	D6-4, 7.9	D6-3, 7.9	D6-6, 8	D5-11, 8	D6-8, 8	D6-5, 8	Zone 6	
B6-10	C6-6, 4.4	C6-5, 4.6	C6-4, 4.6	C6-7, 4.7	C5-1, 4.9	C5-3, 5.2	D5-1, 5.5	C5-2, 5.7	D5-2, 5.7	D6-11, 6	D5-3, 6.1	D6-1, 6.2	D5-4, 6.3	D5-5, 6.4	D5-7, 6.5	D5-6, 6.7	D5-9, 7	D5-10, 7.2	D5-8, 7.3	D5-11, 7.4	D6-3, 7.8	D6-4, 7.9	D5-12, 8	D6-9, 8	D6-2, 8	Zone 6	
B6-11	C6-5, 4.3	C6-4, 4.5	C6-6, 4.5	C6-7, 4.8	C5-1, 5.1	C5-3, 5.5	D5-1, 5.8	D6-11, 6	D5-2, 6.2	D6-1, 6.2	C5-2, 6.5	D5-4, 6.5	D5-3, 6.7	D5-5, 6.7	D5-7, 7	D5-6, 7	D6-2, 7.4	D5-9, 7.5	D6-3, 7.5	D6-4, 7.5	D5-10, 7.7	D6-6, 7.7	D6-5, 7.7	D6-7, 7.8	D6-8, 7.8	Zone 6	
C2-3	D3-3, 3.3	D3-5, 3.4	D3-2, 3.5	D3-8, 3.6	C3-4, 3.6	D3-7, 3.6	D3-9, 3.7	D3-10, 3.7	D3-11, 3.9	D3-6, 4	D3-15, 4	D3-12, 4	C3-3, 4	D3-13, 4.1	D3-4, 4.2	C3-2, 4.4	D2-1, 4.4	D2-2, 4.4	D2-3, 4.6	C3-1, 4.7	D2-4, 5	D2-5, 5.1	D2-7, 5.6	D2-8, 5.7	D3-20, 6.4	Zone 1	
C2-4	D3-3, 3.5	D3-5, 3.6	D3-8, 3.7	D3-2, 3.7	D3-7, 3.8	D3-10, 3.8	D3-9, 3.8	C3-4, 3.8	D3-11, 3.9	D3-15, 4	D3-12, 4.1	D3-13, 4.1	C3-3, 4.1	C3-4, 4.2	D3-4, 4.4	D2-2, 4.4	D2-1, 4.4	C3-2, 4.6	D2-3, 4.6	C3-1, 4.9	D2-4, 4.9	D2-5, 5	D2-7, 5.6	D2-8, 5.7	D3-20, 6.5	Zone 1	
C4-1	C3-1, 3.6	C3-2, 4	C3-3, 4.4	C3-4, 4.8	D3-4, 5.2	D3-2, 5.2	D4-1, 5.3	D4-2, 5.7	D3-5, 5.7	D3-6, 5.8	D4-5, 6	D4-4, 6	D3-5, 6	D4-6, 6.2	D3-7, 6.4	C5-2, 6.6	D4-8, 6.7	D3-8, 6.8	D5-3, 6.7	D5-6, 7	D5-16, 7.2	D3-16, 7.2	D3-9, 7.2	D5-3, 7.4	D3-17, 7.5	Zone 3	
C4-2	C3-1, 4.3	C3-2, 4.7	C3-3, 5	D4-1, 5.1	D4-2, 5.5	C3-4, 5.5	C5-2, 5.6	D3-4, 5.7	D4-5, 5.8	D3-2, 5.8	D4-4, 5.9	D5-8, 6.1	D4-6, 6.2	D5-16, 6.3	D3-3, 6.4	D3-6, 6.4	D5-3, 6.4	D3-5, 6.6	D5-11, 6.7	D5-2, 6.7	D5-15, 6.8	D4-8, 6.8	D5-19, 6.8	D5-7, 6.8	D5-13, 6.9	Zone 3	
C4-3	C3-1, 4.4	C3-2, 4.7	D4-1, 5.1	C3-3, 5.1	C5-2, 5.4	D4-2, 5.5	C3-4, 5.6	D3-4, 5.8	D4-5, 5.8	D3-2, 5.9	D4-4, 5.9	D5-8, 5.9	D5-16, 6.2	D4-6, 6.2	D5-3, 6.3	D3-3, 6.4	D3-6, 6.4	D5-2, 6.6	D5-11, 6.6	D5-15, 6.7	D3-5, 6.7	D5-7, 6.7	D5-19, 6.7	D5-13, 6.8	D5-10, 6.8	Zone 3	
C4-4	C3-1, 4.4	D4-1, 4.5	C3-2, 4.7	C5-2, 4.9	D4-2, 4.9	C3-3, 5.1	D4-5, 5.3	D5-8, 5.3	D4-4, 5.4	D5-16, 5.5	C3-4, 5.6	D3-4, 5.7	D4-6, 5.8	D5-3, 5.8	D3-2, 5.9	D5-15, 6	D5-11, 6	D5-19, 6	D5-13, 6.1	D5-2, 6.1	D5-18, 6.1	D5-7, 6.2	D5-10, 6.2	D5-17, 6.3	D3-6, 6.3	Zone 3	
C4-5	C3-1, 3.5	C3-2, 3.9	C3-3, 4.3	D3-1, 4.4	D4-2, 4.8	C3-4, 4.8	D3-4, 4.9	D4-5, 5	D3-2, 5.1	D4-4, 5.1	D4-6, 5.4	D3-6, 5.6	D3-3, 5.6	D3-5, 5.8	D4-8, 5.9	D5-8, 5.9	D5-8, 6	D5-16, 6.1	D5-11, 6.1	D5-7, 6.2	D3-16, 6.5	D5-19, 6.5	D3-8, 6.6	D5-3, 6.6	D5-15, 6.6	Zone 3	
C4-6	C3-1, 3.8	C3-2, 4.2	D4-1, 4.3	C3-3, 4.6	D4-2, 4.7	D4-5, 5	C3-4, 5.1	D3-4, 5.1	D4-4, 5.1	D3-2, 5.4	C5-2, 5.4	D4-6, 5.5	D5-8, 5.7	D3-6, 5.8	D5-16, 5.8	D3-3, 5.9	D4-8, 6	D3-5, 6.1	D5-3, 6.2	D5-19, 6.2	D5-15, 6.3	D5-11, 6.4	D3-7, 6.4	D5-18, 6.4	D5-13, 6.5	Zone 3	
C4-7	C3-1, 3.5	C3-2, 3.9	C3-3, 4.2	D4-1, 4.3	D4-2, 4.7	C3-4, 4.7	D3-4, 4.8	D4-5, 5	D3-2, 5	D4-4, 5	D4-6, 5.3	D3-6, 5.5	D3-3, 5.5	C5-2, 5.8	D3-5, 5.8	D4-8, 5.9	D5-8, 6	D5-16, 6.1	D3-7, 6.1	D3-16, 6.4	D5-19, 6.5	D3-8, 6.5	D5-3, 6.6	D5-15, 6.6	D5-18, 6.7	Zone 3	
C4-8	C3-1, 3.2	D4-1, 3.3	C3-2, 3.6	D4-2, 3.7	C3-3, 3.9	D4-5, 4	D4-4, 4.1	D3-4, 4.3	D4-6, 4.4	C3-4, 4.4	D3-2, 4.7	D4-8, 4.9	D3-6, 5	D3-5, 5.1	D5-16, 5.4	D5-8, 5.5	D3-16, 5.5	C5-2, 5.6	D3-7, 5.6	D5-19, 5.7	D3-17, 5.9	D3-8, 6	D5-15, 6	D5-18, 6.1	Zone 3		
C4-9	D4-1, 3.6	C5-2, 3.6	D5-8, 3.7	D5-16, 3.8	D4-2, 4	D5-15, 4.2	D5-19, 4.3	D4-5, 4.3	D5-3, 4.4	D5-11, 4.4	D5-18, 4.4	D5-13, 4.4	D5-17, 4.5	D5-10, 4.6	D5-7, 4.7	D4-4, 4.7	D5-2, 4.8	D5-9, 4.9	D5-22, 5	D5-21, 5.1	C3-1, 5.1	D3-16, 5.1	D4-7, 5.1	D5-1, 5.1	D5-6, 5.2	C5-3, 5.4	Zone 3
C5-1	C6-6, 4.1	C6-7, 4.3	C6-4, 4.4	C5-1, 4.4	C6-5, 4.4	C5-3, 4.6	C5-2, 4.8	D5-1, 4.8	D5-2, 5	D5-3, 5.3	D6-11, 5.6	D6-1, 5.7	D5-7, 5.8	D5-4, 5.8	D5-5, 5.8	D5-6, 6	D5-9, 6.3	D5-10, 6.4	D5-8, 6.4	D5-11, 6.6	D5-13, 7.2	D5-12, 7.3	D5-15, 7.4	D6-10, 7.5	D6-9, 7.6	Zone 3	
C5-2	C6-6, 4	C6-7, 4.2	C5-1, 4.3	C6-4, 4.3	C6-5, 4.4	C5-3, 4.5	C5-2, 4.6	D5-1, 4.7	D5-2, 4.9	D5-3, 5.2	D6-11, 5.5	D6-1, 5.6	D5-7, 5.7	D5-4, 5.7	D5-5, 5.7	D5-6, 5.9	D5-9, 6.2	D5-10, 6.2	D5-8, 6.3	D5-11, 6.5	D5-13, 7	D5-12, 7.2	D5-15, 7.3	D6-10, 7.4	D5-16, 7.5	Zone 3	
C5-3	C5-2, 4.5	D5-3, 5.4	D5-2, 5.5	D5-1, 5.6	C5-3, 5.6	C5-1, 5.6	C6-7, 5.8	C6-6, 5.8	D5-8, 5.8	D5-7, 5.9	C6-11, 6.2	D5-10, 6.3	D5-5, 6.4	D5-6, 6.4	D5-9, 6.4	D5-9, 6.4	D5-6, 6.5	D5-4, 6.6	D5-16, 6.6	D6-11, 6.7	D5-13, 6.7	D5-15, 6.8	D6-11, 6.8	D5-18, 7.1	C3-1, 7.4	Zone 3	
C5-4	C5-2, 3.9	C6-6, 4.2	C5-1, 4.2	C6-7, 4.3	C5-3, 4.3	D5-1, 4.4	D5-2, 4.5	C6-4, 4.5	D5-3, 4.7	C6-5, 4.7	D5-7, 5.2	D5-5, 5.4	D6-1, 5.4	D5-4, 5.5	D6-11, 5.5	D5-8, 5.5	D5-6, 5.5	D5-10, 5.7	D5-9, 5.7	D5-11, 5.8	D5-13, 6.3	D5-15, 6.5	D5-16, 6.6	D5-12, 6.7	D5-18, 6.9	Zone 3	
C5-5	C5-2, 4.3	D5-3, 5.2	D5-2, 5.3	D5-8, 5.4	D5-1, 5.5	C5-3, 5.5	C5-1, 5.6	D5-7, 5.7	C6-7, 5.8	C6-6, 5.9	D5-11, 5.9	D5-10, 6	D5-16, 6.1	D5-9, 6.1	D5-6, 6.2	D5-5, 6.2	D5-13, 6.3	D5-15, 6.3	C6-4, 6.3	D5-4, 6.4	D5-18, 6.6	D6-1, 6.6	D4-1, 6.6	C6-5, 6.6	C3-1, 6.7	Zone 3	
C5-6	C5-2, 3.4	C5-3, 4.1	C5-1, 4.1	D5-2, 4.1	D5-1, 4.1	D5-3, 4.2	C6-6, 4.2	C6-7, 4.2	C6-4, 4.7	D5-7, 4.7	D5-8, 4.8	C6-5, 4.9	D5-5, 5	D5-6, 5.1	D5-10, 5.1	D5-4, 5.2	D5-9, 5.2	D5-11, 5.2	D6-1, 5.2	D6-11, 5.3	D5-13, 5.4	D5-15, 5.9	D5-16, 5.9	D5-18, 6.2	D5-12, 6.2	Zone 3	
C5-7	C5-2, 2	C5-3, 2.4	D5-1, 2.4	D5-1, 2.4	D5-2, 2.5	C6-7, 2.6	C6-6, 2.6	D5-3, 2.6	C6-4, 3.1	D5-7, 3.1	C6-5, 3.4	D5-5, 3.4	D5-6, 3.5	D5-4, 3.5	D6-1, 3.5	D5-8, 3.6	D6-11, 3.6	D5-9, 3.6	D5-10, 3.7	D5-11, 3.8	D5-13, 4.4	D5-15, 4.6	D5-12, 4.7	D5-16, 4.8	D5-18, 5	Zone 3	
C5-8	C5-2, 1.8	C5-3, 2.3	D5-1, 2.4	D5-2, 2.4	C5-1, 2.4	D5-3, 2.5	C6-7, 2.6	C6-6, 2.6	D5-7, 3	C6-4, 3.1	D5-5, 3.3	D5-6, 3.4	D5-4, 3.4	C6-5, 3.4	D5-8, 3.4	D6-1, 3.5	D5-10, 3.5	D5-9, 3.5	D6-11, 3.6	D5-11, 3.7	D5-13, 4.2	D5-15, 4.4	D5-12, 4.5	D5-16, 4.6	D5-18, 4.8	Zone 3	
C5-9	C5-2, 3.1	D5-8, 3.5	D5-16, 3.9	D5-3, 3.9	D5-11, 4.2	D5-15, 4.2	D5-2, 4.3	D5-7, 4.3	D5-10, 4.3	D5-13, 4.3	D4-1, 4.4	D5-18, 4.4	D5-19, 4.5	D5-1, 4.6	D5-9, 4.6	D5-17, 4.7	D4-2, 4.8	D5-6, 4.8	C5-3, 4.8	D5-5, 5	C5-1, 5.1	D4-5, 5.2	D5-22, 5.3	D5-21, 5.3	D5-4, 5.3	Zone 3	
C5-10	C5-2, 2.7	D5-8, 2.9	D5-16, 3.2	D5-3, 3.4	D5-11, 3.6	D5-15, 3.6	D5-13, 3.7	D5-10, 3.7	D5-7, 3.8	D5-18, 3.8	D5-2, 3.9	D5-19, 3.9	D5-9, 4	D5-17, 4	D5-1, 4.2	D4-1, 4.2	D5-6, 4.3	C5-3, 4.4	D5-5, 4.5	D4-2, 4.6	D5-22, 4.7	D5-21, 4.7	C5-1, 4.7	D5-12, 4.8	D5-4, 4.9	Zone 3	
C6-1	C6-5, 2.3	C6-6, 3.4	C6-4, 3.4	C6-7, 3.8	C5-1, 4.1	C5-3, 4.4	D5-1, 4.7	D6-11, 5	D5-2, 5.1	D6-1, 5.2	C5-2, 5.4	D5-4, 5.4	D5-3, 5.6	D5-5, 5.6	D5-7, 5.9	D5-6, 6	D5-9, 6.4	D5-10, 6.6	D6-2, 6.6	D6-4, 6.7	D6-3, 6.7	D6-6, 6.8	D6-8, 6.8	D6-9, 6.9	D5-9, 6.9	Zone 6	
C6-2	C6-5, 1.6	C6-4, 1.9	C6-6, 2.2	C6-7, 2.6	C5-1, 3	C5-3, 3.3	D6-11, 3.4	D6-1, 3.7	D5-1, 3.7	D5-4, 4.1	D5-2, 4.1	D5-5, 4.4	D6-2, 4.5	D6-3, 4.6	D6-4, 4.6	D5-3, 4.7	D5-6, 4.7	D6-5, 4.8	D6-6, 4.8	D5-7, 4.9	D6-7, 4.9	C5-2, 4.9	D6-8, 5	D6-9, 5.1	D5-9, 5.2	Zone 6	
C6-3	C6-5, 2.3	C6-4, 2.7	D6-3, 3.1	D6-2, 3.1	C6-6, 3.1	C6-7, 3.3	D6-11, 3.4	D6-5, 3.5	D6-4, 3.5	C5-1, 3.7	D6-6, 3.7	D6-1, 3.8	C5-3, 4	D6-7, 4	D5-4, 4.2	D											



Turbines Ranked by Distance (m)

640.10487-R1

Appendix C - Distance to WTG's

E6-2	E6-24, 1.7	E6-22, 1.7	E5-17, 1.7	E5-14, 1.8	E6-21, 1.8	E5-13, 1.8	E5-19, 1.8	F5-1, 2	F5-2, 2.1	E6-20, 2.1	E5-20, 2.2	E6-18, 2.4	E6-13, 2.5	E6-17, 2.7	E5-8, 2.7	E6-10, 2.9	E5-3, 2.9	E6-25, 3	E5-10, 3.1	E5-6, 3.2	F5-7, 3.2	E6-9, 3.2	E5-4, 3.2	E5-1, 3.3	F6-10, 3.3	Zone 7
E7-1	E6-1, 4.2	E6-2, 4.6	E6-7, 4.9	E7-6, 4.9	E7-7, 5.2	E6-4, 5.2	E6-11, 5.3	E7-8, 5.5	E6-5, 5.6	D6-3, 6.2	E6-14, 6.2	E6-9, 6.3	D6-2, 6.6	D6-5, 6.6	E6-10, 6.7	D6-4, 7	E6-13, 7	D6-6, 7.3	F7-1, 7.4	E6-17, 7.4	D6-7, 7.7	F7-2, 7.7	E6-18, 7.8	F7-3, 8.1	D6-8, 8.1	Zone 7
E7-2	E6-1, 4.3	E6-2, 4.7	E7-6, 4.9	E6-7, 4.9	E7-7, 5.2	E6-4, 5.3	E6-11, 5.3	E7-8, 5.4	E6-5, 5.6	E6-14, 6.2	D6-3, 6.3	E6-9, 6.3	E6-10, 6.7	D6-2, 6.7	D6-5, 6.7	E6-13, 7.1	D6-4, 7.1	F7-1, 7.4	D6-6, 7.4	E6-17, 7.5	F7-2, 7.7	D6-7, 7.8	E6-18, 7.8	F7-3, 8	D6-8, 8.2	Zone 7
E8-1	E7-6, 5.9	E6-1, 6.1	E7-7, 6.2	E6-2, 6.5	E7-8, 6.5	E6-7, 6.6	E6-11, 7	E6-4, 7.1	E6-5, 7.4	E6-14, 7.9	D6-3, 7.9	F8-7, 8	E6-9, 8.1	F8-2, 8.1	F8-1, 8.1	F8-3, 8.1	F8-8, 8.1	F8-4, 8.1	F9-2, 8.3	F9-1, 8.3	D6-2, 8.4	F7-1, 8.4	E6-10, 8.4	D6-5, 8.5	E6-8, 8.5	Zone 9
E8-4	F8-1, 6.7	F9-1, 6.7	F8-2, 6.8	F9-2, 6.8	E7-6, 6.8	F8-3, 6.9	F8-4, 7	F8-6, 7.1	F8-7, 7.2	E7-7, 7.3	F8-8, 7.4	E7-8, 7.6	F9-5, 7.8	F8-1, 8	F9-3, 8	E6-7, 8.3	E6-2, 8.4	F9-6, 8.4	F9-4, 8.5	E6-11, 8.7	E6-4, 8.9	F8-9, 8.9	E6-5, 9.2	F8-10, 9.3	F7-1, 9.3	Zone 9
E8-5	F9-1, 4.8	F9-2, 4.9	F8-1, 5	F8-2, 5.1	F8-3, 5.4	F8-4, 5.6	F8-6, 5.9	F9-5, 5.9	F9-3, 5.9	F8-7, 6	F9-4, 6.3	F8-8, 6.3	F9-6, 6.4	E7-6, 7.8	F8-9, 8	G9-28, 8.1	G8-2, 8.1	G9-29, 8.1	E7-7, 8.2	G8-3, 8.2	G8-4, 8.4	F8-10, 8.4	G8-5, 8.5	G8-7, 8.6	E7-8, 8.6	Zone 10
E9-2	F9-1, 5.5	F9-2, 5.7	F9-3, 5.9	F8-1, 6	F8-2, 6.2	F9-4, 6.2	F9-5, 6.5	F8-3, 6.6	F9-6, 6.9	F8-4, 7	F8-6, 7.3	F8-7, 7.6	F8-8, 8	G9-29, 8.9	G9-28, 9	G8-3, 9.2	G8-2, 9.2	G8-4, 9.5	F8-9, 9.6	G8-5, 9.7	F8-7, 9.9	F8-10, 10.1	G8-6, 10.1	E7-6, 10.1	G8-1, 10.4	Zone 9
E9-4	F9-1, 4	F9-2, 4.1	F8-1, 4.3	F8-2, 4.4	F8-3, 4.7	F9-3, 4.9	F9-5, 5	F8-4, 5.1	F8-6, 5.4	F9-4, 5.4	F9-6, 5.6	F8-7, 5.6	F8-8, 5.9	G9-29, 7.4	G9-28, 7.4	G8-2, 7.5	G8-3, 7.5	F8-9, 7.6	G8-4, 7.8	G8-5, 7.9	F8-10, 8	G8-7, 8	G8-6, 8.2	E7-6, 8.2	G8-1, 8.3	Zone 10
F2-1	E3-18, 4.1	E3-17, 4.2	E3-15, 4.6	E3-16, 4.8	F3-14, 4.9	F3-12, 5	F3-8, 5.1	E3-14, 5.2	E2-4, 5.3	E2-5, 5.3	E3-19, 5.6	F3-7, 5.6	E3-13, 5.6	E2-3, 5.7	F3-25, 5.8	F3-29, 5.8	E3-12, 6	D2-8, 6.3	E3-20, 6.3	F3-18, 6.3	E3-11, 6.4	D2-5, 6.6	D2-7, 6.6	E3-21, 6.6	E3-10, 6.7	Zone 2
F2-2	F3-14, 4.3	E3-17, 4.4	F3-12, 4.5	E3-18, 4.5	F3-8, 4.7	E3-15, 4.9	E3-16, 5	F3-29, 5.1	F3-25, 5.1	F3-7, 5.2	E3-14, 5.4	E3-19, 5.6	F3-18, 5.8	E3-13, 5.8	E2-5, 5.9	E2-4, 5.9	E3-12, 6.2	E2-3, 6.3	E3-20, 6.3	F3-5, 6.4	E3-11, 6.6	F3-3, 6.7	E3-21, 6.7	F3-24, 6.8	D2-8, 6.9	Zone 2
F2-3	F3-14, 4	F3-12, 4.1	E3-17, 4.1	E3-18, 4.3	F3-8, 4.3	E3-16, 4.7	E3-15, 4.7	F3-25, 4.8	F3-7, 4.8	F3-29, 4.8	E3-14, 5.1	E3-19, 5.3	F3-18, 5.4	E3-13, 5.6	E2-5, 5.7	E2-4, 5.8	E3-12, 6	F3-5, 6	E3-20, 6	E2-3, 6.1	F3-3, 6.3	E3-11, 6.4	F3-24, 6.4	E3-21, 6.4	E3-26, 6.6	Zone 2
F2-4	F3-14, 3.6	F3-12, 3.7	F3-8, 4	E3-17, 4	E3-18, 4.2	F3-25, 4.4	F3-29, 4.4	F3-7, 4.5	F3-7, 4.5	F3-7, 4.5	E3-15, 4.6	E3-14, 5	F3-18, 5	E3-19, 5.1	E3-13, 5.4	F3-5, 5.7	E2-5, 5.7	E3-20, 5.8	E2-4, 5.9	E3-12, 5.9	F3-3, 6	F3-24, 6	E3-11, 6.3	E3-21, 6.2	E3-26, 6.4	Zone 2
F2-5	F3-14, 3.7	F3-12, 3.8	F3-8, 4.1	E3-17, 4.1	E3-18, 4.4	F3-29, 4.5	F3-25, 4.5	F3-7, 4.6	E3-16, 4.7	E3-15, 4.7	F3-18, 5.1	E3-14, 5.2	E3-19, 5.3	E3-13, 5.6	F3-5, 5.8	E2-5, 5.9	E3-20, 6	E2-4, 6	E3-12, 6	F3-24, 6.1	F3-3, 6.1	E2-3, 6.3	E3-21, 6.4	E3-11, 6.4	E3-26, 6.6	Zone 2
F6-1	F6-14, 1.9	G6-3, 2.2	F7-3, 2.3	F7-2, 2.6	G7-6, 2.6	G7-8, 2.7	G7-4, 2.8	F7-1, 2.9	G7-9, 2.9	G6-4, 3	G7-7, 3.1	G7-3, 3.4	G6-6, 3.4	G7-2, 3.6	G6-7, 3.8	G7-1, 3.8	F6-7, 3.9	F6-10, 4.2	F6-11, 4.3	F6-12, 4.6	F6-13, 4.8	E7-8, 4.8	G7-10, 4.8	F5-15, 5.1	E7-7, 5.1	Zone 8
F6-2	F6-14, 2	G6-3, 2.1	F7-3, 2.3	F7-2, 2.6	G7-6, 2.6	G7-8, 2.7	G7-4, 2.8	G7-9, 2.9	F7-1, 2.9	G6-4, 3	G7-7, 3.1	G6-6, 3.4	G7-3, 3.4	G7-2, 3.6	G6-7, 3.8	F6-7, 3.8	G7-1, 3.8	F6-10, 4.2	F6-11, 4.2	F6-12, 4.6	F6-13, 4.8	G7-10, 4.9	E7-8, 4.9	F5-15, 5	E7-7, 5.1	Zone 8
F6-3	F6-14, 2	G6-3, 2.1	F7-3, 2.3	G7-6, 2.6	G7-8, 2.6	G7-2, 2.7	G7-4, 2.8	G7-9, 2.9	G6-4, 2.9	F7-1, 3	G7-7, 3.1	G6-6, 3.3	G7-3, 3.4	G7-2, 3.6	G6-7, 3.7	G7-1, 3.8	F6-7, 3.9	F6-10, 4.2	F6-11, 4.3	F6-12, 4.6	F6-13, 4.8	E7-8, 4.9	F5-15, 5.1	E7-7, 5.1	E7-11, 5.1	Zone 8
F6-4	G7-6, 1.8	G7-8, 1.9	G7-4, 1.9	G7-9, 2.2	G7-7, 2.2	F6-14, 2.4	G6-3, 2.5	G7-3, 2.6	F7-3, 2.6	G7-2, 2.8	F7-2, 2.9	G7-1, 3	F7-1, 3.1	G6-4, 3.3	G6-6, 3.7	G7-10, 4.1	G6-7, 4.1	G7-11, 4.5	F6-7, 4.7	G7-16, 4.7	G7-15, 4.7	G7-14, 4.8	G7-12, 4.9	E7-8, 5.1	F6-10, 5.1	Zone 8
F7-1	F7-1, 0.8	F7-2, 1	F7-3, 1.3	E7-8, 1.4	F6-14, 1.6	E7-7, 1.8	E7-6, 2.2	E6-14, 3.1	E6-11, 3.3	E6-7, 3.3	F6-7, 3.3	E6-17, 3.5	E6-18, 3.7	E6-9, 4	E6-20, 4	E6-10, 4.1	F6-10, 4.1	E6-13, 4.1	E6-5, 4.2	E6-4, 4.3	F6-11, 4.4	E6-21, 4.5	E6-2, 4.5	E6-1, 4.6	E6-22, 4.8	Zone 8
F7-2	F7-1, 0.9	F7-2, 1	F7-3, 1.2	F6-14, 1.5	E7-8, 1.6	E7-7, 2	E7-6, 2.4	E6-14, 3.1	F6-7, 3.1	E6-11, 3.3	E6-17, 3.3	E6-7, 3.4	E6-18, 3.5	E6-20, 3.8	F6-10, 3.8	E6-9, 3.9	E6-10, 4	E6-13, 4	F6-11, 4.1	E6-5, 4.2	E6-21, 4.2	E6-4, 4.3	E6-2, 4.5	E6-22, 4.6	E6-1, 4.6	Zone 8
F7-3	F7-1, 0.8	F7-2, 0.9	F7-3, 1.1	F6-14, 1.4	E7-8, 1.7	E7-7, 2	E7-6, 2.4	F6-7, 3.1	E6-14, 3.1	E6-11, 3.3	E6-17, 3.4	E6-7, 3.4	E6-18, 3.5	E6-20, 3.8	F6-10, 3.8	E6-9, 4	E6-10, 4	E6-13, 4	F6-11, 4.2	E6-5, 4.2	E6-21, 4.3	E6-4, 4.3	E6-2, 4.5	E6-22, 4.6	E6-1, 4.7	Zone 8
F7-4	F7-1, 1.6	F7-2, 1.9	E7-7, 2	E7-8, 2	E7-6, 2.1	F7-3, 2.3	F6-14, 2.6	G7-1, 3.5	G7-2, 3.6	G7-3, 3.8	G7-4, 4.2	G7-6, 4.5	G7-7, 4.7	G7-8, 4.9	E6-7, 4.9	E6-11, 5	E6-14, 5	G8-1, 5.1	F8-10, 5.2	F6-7, 5.2	F8-8, 5.3	G7-9, 5.3	F8-9, 5.3	E6-17, 5.5	F8-7, 5.6	Zone 8
F7-5	F7-1, 1.6	F7-2, 1.9	E7-7, 2.1	E7-8, 2.2	E7-6, 2.3	F7-3, 2.3	F6-14, 2.6	G7-1, 3.4	G7-2, 3.5	G7-3, 3.7	G7-4, 4	G7-6, 4.4	G7-7, 4.5	G7-8, 4.7	G8-1, 5	E6-7, 5	F8-10, 5.1	E6-11, 5.1	G7-9, 5.1	F8-9, 5.2	F8-8, 5.2	F6-7, 5.3	F8-7, 5.5	E6-17, 5.6	Zone 8	
F7-6	F7-1, 1.3	F7-2, 1.6	F7-3, 1.9	F6-14, 2.2	E7-8, 2.3	E7-7, 2.3	E7-6, 2.5	G7-1, 3.2	G7-2, 3.3	G7-3, 3.4	G7-4, 3.7	G7-6, 4.1	G7-7, 4.2	G7-8, 4.4	G7-9, 4.8	F6-7, 4.9	E6-7, 5	E6-14, 5	E6-11, 5.1	F8-10, 5.3	E6-17, 5.4	F8-9, 5.4	G6-3, 5.5	E6-18, 5.6	Zone 8	
F8-1	F8-8, 2.3	F8-9, 2.6	F8-10, 2.6	F8-7, 2.7	G8-1, 2.7	F8-6, 3.1	G7-1, 3.4	F8-4, 3.7	G8-10, 3.7	G8-6, 3.7	G8-11, 3.7	G7-2, 3.8	G8-7, 3.9	G8-12, 3.9	G8-14, 3.9	G7-3, 4.1	E7-6, 4.1	G8-5, 4.1	F8-3, 4.1	E7-7, 4.3	G8-15, 4.3	F8-2, 4.5	F7-1, 4.5	E7-8, 4.5	G8-4, 4.5	Zone 10
F9-1	F9-3, 2.3	F9-4, 2.4	F9-1, 3	F9-2, 3.4	F9-5, 3.5	F9-6, 3.6	F8-1, 3.9	F8-2, 4.2	F8-3, 4.7	F8-4, 5.1	G9-29, 5.7	F8-6, 5.7	G9-28, 6	F8-7, 6.1	G8-3, 6.3	G8-2, 6.5	F8-8, 6.5	G8-4, 6.9	G8-5, 7.3	G8-7, 7.6	G8-17, 7.7	F8-9, 7.8	G8-18, 7.9	G8-6, 7.9	G8-10, 8.2	Zone 10
F9-2	F9-4, 2.4	F9-3, 2.9	F9-6, 3.1	F9-5, 3.7	G9-29, 3.7	G9-28, 4.3	F9-1, 4.4	F9-2, 4.5	G8-3, 4.6	F8-1, 4.9	G8-17, 4.9	G8-2, 5.1	F8-2, 5.1	G8-18, 5.3	F8-3, 5.4	G8-4, 5.5	F8-4, 5.7	G8-9, 5.8	G8-5, 6.1	F8-6, 6.2	G8-16, 6.2	G8-7, 6.4	G8-19, 6.5	F8-7, 6.6	G8-6, 6.8	Zone 10
F9-3	F9-4, 2.5	F9-3, 3	F9-6, 3.1	G9-29, 3.6	F9-5, 3.7	G9-28, 4.2	F9-1, 4.4	G8-3, 4.5	F9-2, 4.6	G8-17, 4.8	F8-1, 4.9	G8-2, 5.1	F8-2, 5.1	G8-18, 5.2	F8-3, 5.3	G8-4, 5.5	F8-4, 5.7	G8-9, 5.7	G8-5, 6	F8-6, 6.2	G8-7, 6.4	G8-19, 6.4	F8-7, 6.6	G8-6, 6.7	Zone 10	
F9-4	F9-4, 2.4	F9-6, 2.8	F9-3, 2.9	G9-29, 3.2	F9-5, 3.4	G9-28, 3.8	G8-3, 4.1	F9-1, 4.3	F9-2, 4.3	G8-17, 4.4	G8-2, 4.6	F8-1, 4.7	G8-18, 4.7	F8-2, 4.9	G8-4, 5.1	F8-3, 5.1	G8-9, 5.3	F8-4, 5.4	G8-5, 5.6	G8-16, 5.7	F8-6, 5.8	G8-7, 6	G8-19, 6	F8-7, 6.3	G8-6, 6.3	Zone 10
F9-5	F9-4, 2.5	F9-6, 2.9	F9-3, 2.9	G9-29, 3.3	F9-5, 3.5	G9-28, 3.8	G8-3, 4.2	F9-1, 4.3	F9-2, 4.4	G8-17, 4.5	G8-2, 4.6	F8-1, 4.7	G8-18, 4.8	F8-2, 4.9	G8-4, 5.1	F8-3, 5.1	G8-9, 5.3	F8-4, 5.4	G8-5, 5.7	G8-16, 5.7	F8-6, 5.9	G8-7, 6	G8-19, 6	F8-7, 6.3	G8-6, 6.4	Zone 10
F9-6	F9-4, 2.5	F9-6, 2.9	F9-3, 2.9	G9-29, 3.3	F9-5, 3.5	G9-28, 3.9	G8-3, 4.2	F9-1, 4.4	F9-2, 4.4	G8-17, 4.5	G8-2, 4.6	F8-1, 4.8	G8-18, 4.8	F8-2, 4.9	G8-4, 5.1	F8-3, 5.2	G8-9, 5.3	F8-4, 5.5	G8-5, 5.7	G8-16, 5.8	F8-6, 5.9	G8-7, 6.1	G8-19, 6.1	F8-7, 6.4	G8-6, 6.4	Zone 10
F9-7	F9-4, 2.5	F9-6, 2.9	F9-3, 2.9	G9-29, 3.2	F9-5, 3.5	G9-28, 3.8	G8-3, 4.1	F9-1, 4.3	F9-2, 4.4	G8-17, 4.4	G8-2, 4.6	G8-18, 4.7	F8-1, 4.8	F8-2, 4.9	G8-4, 5.1	F8-3, 5.1	G8-9, 5.2	F8-4, 5.4	G8-5, 5.6	G8-16, 5.7	F8-6, 5.9	G8-7, 6	G8-19, 6	F8-7, 6.3	G8-6, 6.3	Zone 10
G2-1	F3-29, 4.3	F3-14, 4.6	F3-25, 4.8	F3-12, 5	F3-8, 5.4	F3-18, 5.7	F3-7, 6	F3-37, 6.2	F3-24, 6.3	F3-35, 6.6	F3-28, 7	F3-5, 7.1	E3-17, 7.3	F3-19, 7.4	F3-27, 7.4	F3-3, 7.5	F3-11, 7.6	E3-16, 7.7	G4-3, 7.8	E3-18, 7.8	F3-10, 8	E3-15, 8.1	E3-19, 8.1	F4-26, 8.2	F3-6, 8.3	Zone 2
G2-2	F3-29, 4.5	F3-25, 5.1	F3-14, 5.2	F3-12, 5.6	F3-37, 5.9	F3-8, 6	F3-18, 6.1	F3-35, 6.3	F3-24, 6.4	F3-7, 6.6	F3-28, 6.9	F3-27, 7.3	G4-3, 7.4	F3-19, 7.5	F3-5, 7.5	F3-11, 7.8	F3-3, 7.9	F4-26, 7.9	F4-22, 8.2	F3-10, 8.2	E3-17, 8.4	F4-31, 8.4	F3-6, 8.6	E3-16, 8.7	E3-19, 9	Zone 2
G2-3	F3-29, 4.6	F3-25, 5.1	F3-14, 5.3	F3-12, 5.7	F3-37, 5.8	F3-18, 6.1	F3-8, 6.1	F3-35, 6.2	F3-24, 6.4	F3-7, 6.7	F3-28, 6.9	F3-27, 7.3	G4-3, 7.3	F3-19, 7.5	F3-5, 7.6	F4-26, 7.8	F3-11, 7.8	F4-22, 8.2	F3-10, 8.2	E3-17, 8.4	F4-31, 8.4	F3-6, 8.6	E3-17, 8.6	E3-16, 8.9	F3-4, 9	Zone 2
G4-1	G4-5, 0.9	G4-4, 1.3	G4-2, 1.7	G4-3, 2	F4-26, 2.1	F4-22, 2.4	F4-22, 2.4	F4-25, 3.1	F4-31, 2.8	F4-25, 3.1	F3-35, 3.4	F4-24, 3.4	F4-14, 3.5	F3-27, 3.6	F3-37, 3.7	F4-29, 4.2	F4-9, 3.9	F5-29, 4.2	F4-10, 4.3	F3-19, 4.4	F4-34, 4.5	G5-12				

## NOISE FUNDAMENTALS

### Noise

Hearing is a fundamental human sense and is used constantly for communication and awareness of the environment.

Noise is generally described as being ‘unwanted’ or ‘unfavourable’ sound and, to some extent, is an individual or subjective response as what may be sound to one person, may be regarded as noise by another.

The measurement and assessment of sound has been developed steadily over the last century, taking into account human response measures such as hearing damage and other potential health affects such as stress. Complex sound measurement and analytical devices have also been developed.

### A-weighting and ‘dBA’

The overall level of a sound is usually expressed in terms of dBA, which is measured using the ‘A-weighting’ filter incorporated in sound level meters. These filters have a frequency response corresponding approximately to that of human hearing. People’s hearing is most sensitive to sounds at mid frequencies (typically 500 Hz to 4,000 Hz) and less sensitive at lower and higher frequencies. The level of a sound in dBA is a considered a good measure of the loudness of that sound. Different sources having the same dBA level generally sound about equally as loud, although the perceived loudness can also be affected by the character of the sound (e.g. the loudness of human speech and a distant motorbike may be perceived differently, although they can be of the same dBA level).

A change of up to 3 dBA in the level of a sound is difficult for most people to detect, whilst a 3 dBA to 5 dBA change corresponds to a small but noticeable change in loudness. A 10 dBA change corresponds to an approximate doubling or halving in loudness.

**Table 1** below presents examples of typical noise levels.

Table 1 Typical Noise Levels

Sound Pressure Level (dBA)	Typical Source	Subjective Evaluation
130	Threshold of pain	Intolerable
120 110	Heavy rock concert Grinding on steel	Extremely noisy
100 90	Loud car horn at 3 m Construction site with pneumatic hammering	Very noisy
80 70	Kerbside of busy street Loud radio or television	Loud
60 50	Department store General Office	Moderate to quiet
40 30	Inside private office Inside bedroom	Quiet to very quiet
20	Unoccupied recording studio	Almost silent


## Statistical Noise Level Descriptors

As environmental noise usually varies in level over time, it is common to present the results of environmental noise testing in the form of statistical descriptors.

An explanation of noise level descriptors typically used for assessing the noise environment are illustrated in **Figure 1** and described below.

L <sub>Amax</sub>	The maximum A-weighted noise level associated with a noise measurement interval.
L <sub>A1</sub>	The noise level exceeded for 1% of a given measurement period. This parameter is often used to represent the <u>typical</u> maximum noise level in a given interval.
L <sub>A10</sub>	The A-weighted sound pressure level exceeded 10% of a given measurement interval and is utilised normally to characterise <u>average maximum</u> noise levels.
L <sub>Aeq</sub>	The A-weighted equivalent continuous sound level. It is defined as the steady sound level that contains the same amount of acoustical energy as a given time-varying sound over the same measurement interval. Can be loosely thought of as the 'average'.
L <sub>A90</sub>	The A-weighted sound pressure level exceeded 90% of a given measurement interval and is representative of the <u>average minimum</u> sound level. Often used to describe the 'background' level.

Figure 1 Graphical Display of Typical Noise Descriptors

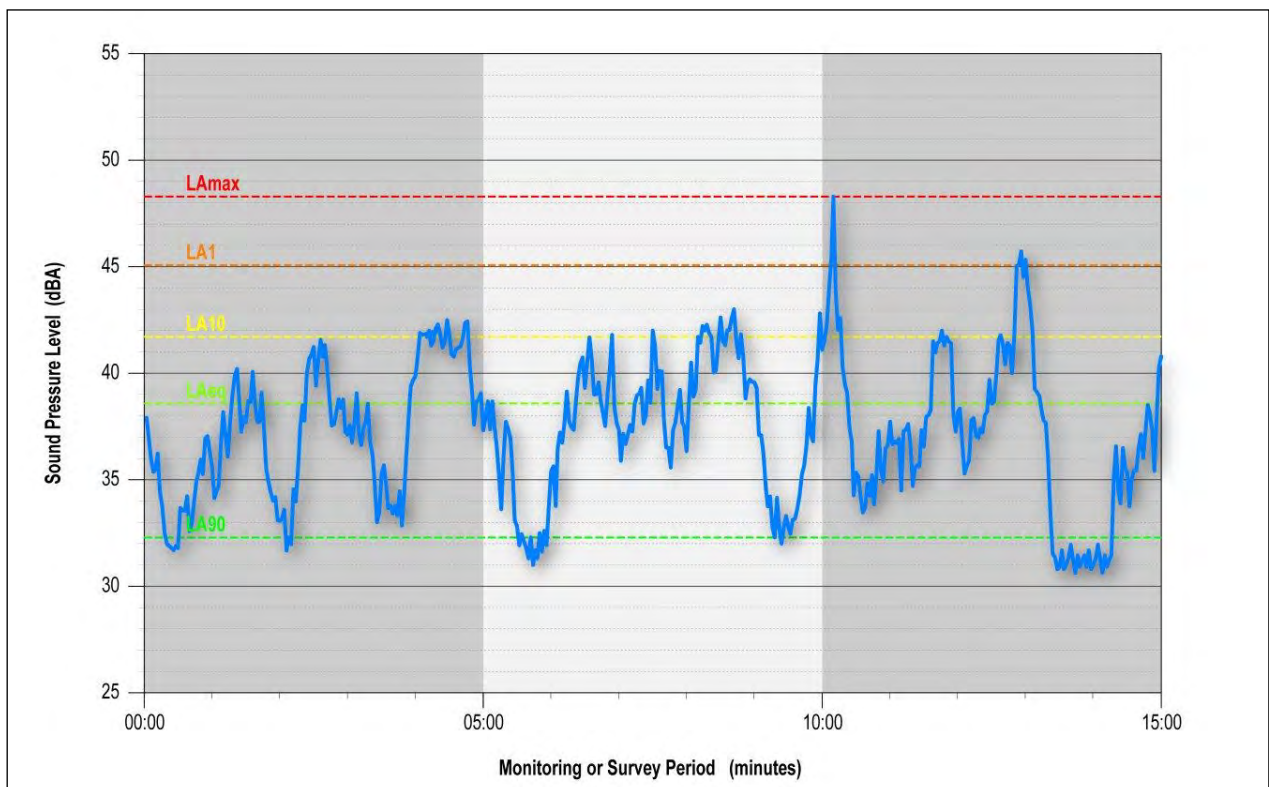

### Character

The A-weighted noise level alone is a simplistic parameter and may not be sufficient in providing a thorough assessment of noise. The subjective character of a sound is also a significant parameter that needs to be considered.

Some basic characteristics of sound which can make a sound more or less intrusive include:

- The frequency content of a sound – i.e. low frequency sound such as exhaust noise or high frequency sound such as birds or insects,
- the 'tonality' of a sound – i.e. sound contains one or more prominent tones such as a horn or a whistle,
- the 'impulsiveness' of a sound – i.e. hammering, dog barking or a intermittently operating power saw.

The above parameters can usually be indicatively subjectively assessed, but more thorough assessment can be made with advanced sound measuring devices (i.e. narrow band or one-third octave analysis). Many noise policies provide an assessment method which applies penalties to sounds that exhibit particular characteristics such as the above.

### Frequency Analysis

Frequency analysis is the process used to examine the tones (or frequency components) which make up the overall noise or vibration signal. This analysis was traditionally carried out using analogue electronic filters, but is now normally carried out using Fast Fourier Transform (FFT) analysers.

The units for frequency are Hertz (Hz), which represent the number of cycles per second.


Frequency analysis can be in:

- Octave bands (where the centre frequency and width of each band is double the previous band)
- 1/3 octave bands (3 bands in each octave band)
- Narrow band (where the spectrum is divided into 400 or more bands of equal width)

**Figure 2** shows a 1/3 octave band frequency analysis where the noise is dominated by the 200 Hz band. Note that the indicated level of each individual band is less than the overall level, which is the logarithmic sum of the bands.



Figure 2 Representative 1/3 Octave Band Analysis

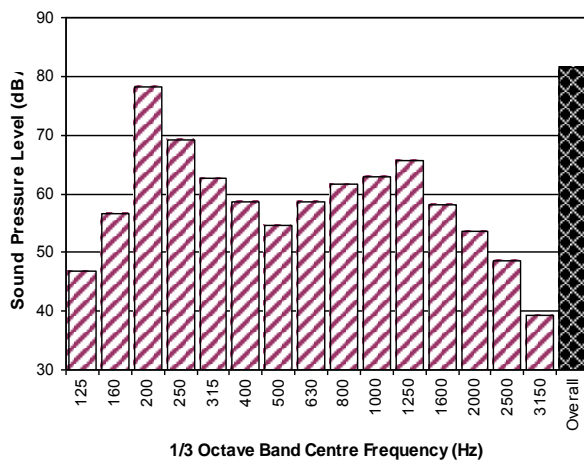

## Vibration

Vibration may be defined as cyclic or transient motion. This motion can be measured in terms of its displacement, velocity or acceleration. Most assessments of human response to vibration or the risk of damage to buildings use measurements of vibration velocity. These may be expressed in terms of “peak” velocity or “rms” velocity.

The former is the maximum instantaneous velocity, without any averaging, and is sometimes referred to as “peak particle velocity”, or PPV. The latter incorporates “root mean squared” averaging over some defined time period.

Vibration measurements may be carried out in a single axis or alternatively as triaxial measurements. Where triaxial measurements are used, the axes are commonly designated vertical, longitudinal (aligned toward the source) and transverse.

The common units for velocity are millimetres per second (mm/s). As with noise, decibel units can also be used, in which case the reference level should always be stated. A vibration level  $V$ , expressed in mm/s can be converted to decibels by the formula  $20 \log (V/V_0)$ , where  $V_0$  is the reference level (1E-6 mm/s). Care is required in this regard, as other reference levels are used by some organizations.

## Human Perception of Vibration

People are able to “feel” vibration at levels lower than those required to cause even superficial damage to the most susceptible classes of building (even though they may not be disturbed by the motion). An individual's perception of motion or response to vibration depends very strongly on previous experience and expectations, and on other connotations associated with the perceived source of the vibration. For example, the vibration that a person responds to as “normal” in a car, bus or train is considerably higher than what is perceived as “normal” in a shop, office or dwelling.

## Over-Pressure

The term “over-pressure” is used to describe the air pressure pulse emitted during blasting or similar events. The peak level of an event is normally measured using a microphone in the same manner as linear noise (ie unweighted), at frequencies both in and below the audible range.

## Appendix E - Wind Turbine Coordinates

Report 640.10487-R1

Page 1 of 4

Turbine Name	Easting	Northing
E5-2	770076	6478547
D5-12	767367	6475892
D5-22	768975	6478651
E3-12	772155	6488316
D4-5	767868	6483146
D4-8	768340	6484770
E5-12	771399	6478445
D3-20	769364	6486587
D3-18	769077	6486050
D4-2	767611	6482866
D3-17	768942	6485623
E3-16	773462	6488920
E3-15	772771	6489554
D6-6	767271	6472790
E3-14	772795	6488857
E5-11	771379	6477732
E7-8	774999	6468488
E5-24	772999	6479156
D4-4	767804	6483810
E4-3	773216	6480602
E3-25	772026	6485906
D6-9	767419	6474100
C6-5	763851	6473510
D5-21	768879	6478264
E5-18	771935	6479013
F4-5	776474	6482738
D5-2	765079	6475815
E5-21	772056	6479383
E4-11	771536	6484335
E4-2	772939	6480332
E5-6	770565	6476714
E5-15	771718	6478669
E5-7	770391	6478774
F4-2	775083	6481896
E5-26	772920	6478645
D5-3	765379	6476318
E4-7	774529	6481346
E4-5	773621.2	6480882
E5-8	771190	6476835
E5-4	770314	6476427
D5-8	766284	6477441
D4-1	767243	6482687
E3-24	772073	6486348

Turbine Name	Easting	Northing
F6-10	776175	6473575
E7-7	774913	6468081
F3-8	776788	6488401
F5-25	777922	6477194
F3-12	777148	6488678
F5-16	777032	6478516
F4-8	776875	6481267
F5-7	776086	6476221
E6-21	774422	6473676
F4-29	779959.6	6481127
E6-11	772835	6470561
F3-3	776102	6486364
F3-29	778726	6488547
F3-18	777646	6487456
F4-25	779625.1	6480335
F5-27	778686.9	6479123
F4-14	777770	6483715
F5-14	777048	6477913
F3-28	778673	6485773
G4-2	780168.7	6481590
F4-24	779510.8	6479984
F6-13	776727	6474836
F4-10	777151	6481564
F3-37	779894.1	6486420
F5-18	777198.8	6478879
G6-6	781283	6473492
E6-24	774874	6474745
E6-4	771949	6470953
G5-4	781047	6476314
F4-9	777331	6483435
E6-7	772707	6470195
F3-35	779705.9	6486038
E6-5	772167	6471265
F3-11	777019	6485678
F4-33	775913	6483306
F6-7	776059	6472837
F7-1	776773	6469273
G5-9	781943	6477891
F4-22	779135	6484253
G5-8	781690	6477602
E6-20	774309	6473134
F5-29	779012	6479376
F5-19	777534	6476242

## Appendix E - Wind Turbine Coordinates

Report 640.10487-R1

Page 2 of 4

Turbine Name	Easting	Northing
E6-25	770232	6474872
D3-12	767905	6488924
E5-1	770127	6476095
E5-20	772028	6476797
E4-10	774793	6481632
D5-18	767644	6477650
E5-3	770307	6475342
E5-13	771407	6475263
D6-11	765461	6474258
D6-7	767361	6473248
D5-19	768151	6478599
D6-8	767356	6473655
D5-7	765853	6476132
E3-22	772491	6487064
E5-14	771566	6475625
E5-19	771956	6476318
D5-4	765798	6474962
C6-6	763858	6474324
F4-3	775463	6482426
D5-5	765881	6475371
D6-1	765620	6474610
D5-10	766415	6476470
C5-3	764609	6475171
E5-23	772438	6479983
C6-4	763962	6473880
D6-3	766934	6471367
E4-8	774691	6480596
D3-6	766153	6486914
D5-11	766603	6476812
C6-7	764167	6474538
C5-1	764362	6474877
D5-16	767320	6478205
D5-1	764872	6475454
D6-5	767243	6472045
E2-3	770714	6490065
D5-17	768108	6477995
D6-10	767421	6474554
D5-6	766101	6475679
D5-15	767303	6477485
E2-5	771102	6490217
C3-4	764734	6486809
F3-6	776415	6485184
D3-2	765070	6486992

Turbine Name	Easting	Northing
G6-4	781163	6473079
G4-5	780657	6482236
F5-17	777294	6475612
F4-26	779634	6484412
F3-10	776773	6485385
E6-2	771559	6470459
F4-28	779809.1	6480692
F6-11	776408	6473879
G5-6	781337	6477178
F5-15	777023	6475273
E6-13	773075	6472419
G4-3	780212	6484775
E6-18	774197	6472718
F5-1	775203	6475050
G5-12	782644	6478708
E6-1	771426	6470084
F6-12	776572	6474450
E6-9	772689	6471761
F7-2	776986	6469585
F5-24	777743	6476858
E6-17	773994	6472394
F5-20	777322.2	6479313
F4-34	776709	6483257
F4-12	776663	6480221
F5-8	776274	6476641
F5-9	776583.4	6476889
F3-5	776352	6486655
F3-4	776009	6485046
G6-7	781492	6473813
F5-10	776861.5	6477556
F6-14	777417	6470211
F5-2	775234	6475426
E6-22	774655	6474088
E6-10	772837.1	6472109
F3-24	778247	6486603
F4-7	776704	6480627
F5-26	778065	6477548
F3-25	778197.6	6488290
G6-3	780682	6472379
E6-14	773408	6471305
F3-7	776484	6487872
F3-27	778566	6485399
F7-3	777188	6469907

## Appendix E - Wind Turbine Coordinates

Report 640.10487-R1

Page 3 of 4

Turbine Name	Easting	Northing
D2-5	769193	6491105
D2-8	769873	6490338
D3-5	765927.9	6487403
D5-9	766371	6476094
D3-3	765517	6487338
D6-2	766913	6471836
D3-15	768071	6489664
E5-17	771777	6475943
D3-10	767316	6488442
F4-4	775685	6482767
D3-13	768103	6489262
D2-1	768529	6489772
D3-16	768706	6485319
C3-2	764424	6485998
D3-7	766371	6487494
C5-2	764716	6476944
D5-14	767808	6474713
D2-7	769725	6489975
C3-3	764606	6486331
D3-11	767619	6488667
E3-18	772809	6490126
F4-31	778650	6484175
D2-2	768577	6490200
D3-9	767004	6488042
D2-3	768774	6490528
E3-17	773523	6489630
D3-4	765671	6486432
E3-23	772199	6486798
E3-28	772938	6485936
C3-1	764267	6485655
E3-5	770876	6487368
E3-7	771164	6487616
E3-26	773631	6486533
E2-4	770774	6490770
D3-8	766621	6487807
E3-27	773174	6486241
D2-4	769109	6490703
E3-10	771597	6487787
E3-21	773094	6487107
D6-4	767127	6472425
E3-8	771289	6486039
E3-29	772768	6485595
E3-30	772611	6485236

Turbine Name	Easting	Northing
E7-6	774748	6467705
F3-19	777710	6485668
G8-25	783351	6463802
G8-15	781972	6464084
G8-14	781493	6463939
G8-9	782495	6460832
G8-12	781295	6463343
G7-12	784240	6468049
F9-1	776846	6459250
G8-1	780148	6463809
G7-15	784426	6469246
G8-27	783974	6463734
G9-29	780247	6459465
G7-6	781209	6468977
F9-5	777890	6459054
G7-10	783615	6468558
G7-14	784066	6467762
G9-28	780253	6460030
G7-11	784103	6468825
G7-1	780312	6467072
G7-16	784471	6469700
G8-26	783736	6462401
G7-7	781448	6468539
G7-2	780477	6467375
G7-4	780934	6468523
G8-21	782790	6462499
G7-9	781848	6469371
G8-24	783709	6463358
F8-7	777904	6462206
G8-19	782430	6461682
G8-20	782552	6462222
G8-5	780490	6461838
G7-3	780675	6467650
F8-6	777849	6461730
G8-7	780542	6462189
G8-23	783485	6463093
F8-8	778103	6462544
G8-16	782137	6461473
F8-9	779629	6463172
G8-22	783015	6462789
G8-3	780382.7	6460362
G8-6	780584	6462549
F8-10	779953	6463534

## Appendix E - Wind Turbine Coordinates

Report 640.10487-R1

Page 4 of 4

<b>Turbine Name</b>	<b>Easting</b>	<b>Northing</b>
E5-10	771190	6477293
D5-13	767143	6477146
E3-11	771893	6488024
E3-6	771061	6485729
E3-20	773313	6487417
E3-4	770832	6485440
E4-1	772157	6480467
E3-19	773547	6488078
E3-13	772519	6488535
E4-12	772157	6484436
D4-6	768013	6484128
D5-23	769784	6478362
F3-14	777496	6488887

<b>Turbine Name</b>	<b>Easting</b>	<b>Northing</b>
G8-4	780486	6461281
G8-17	782273	6459982
F9-6	778329	6458606
G8-10	780769	6462832
F8-2	777290	6460358
F9-3	777425	6457733
G7-8	781481	6469214
F9-4	777662	6457241
G8-2	780277	6460830
F9-2	777031	6459541
F8-3	777514	6460741
G8-11	781000	6463107
F8-4	777725	6461179

# Appendix F - Low Frequency Noise and Tonality Analysis

Report 640.10487-R1  
Page 1 of 8

## Low Frequency Noise

Low frequency noise has been evaluated by determining the C-weighted noise for each receptor. The overall results in dBC for each receptor are shown in the table below.

Location	Predicted Noise Level, Leq dBC	Location	Predicted Noise Level, Leq dBC
B3-4	45.8	E4-6*	57.3
B3-5	46.6	E5-1*	57.8
B5-5	50.3	E5-2*	57.9
B5-6	49.9	E5-3*	56.2
B5-7	50.2	E5-4*	56.6
B6-6	49.2	E5-5*	56.6
B6-7	49.1	E5-6*	56.4
B6-8	49.7	E6-1*	57.2
B6-9	49.7	E6-2*	57.9
B6-10	50.1	E7-1	50.0
B6-11	49.6	E7-2	50.2
C2-3	51.1	E8-1	49.6
C2-4	49.7	E8-4	48.6
C4-1	51.2	E8-5	48.8
C4-2	52.2	E9-2	47.1
C4-3	52.2	E9-4*	49.4
C4-4	53.1	F2-1	50.0
C4-5	52.5	F2-2	49.8
C4-6	52.5	F2-3	50.2
C4-7	52.1	F2-4	50.5
C4-8	53.5	F2-5	50.3
C4-9	54.4	F6-1*	54.8
C5-1	51.1	F6-2*	54.9
C5-2	51.3	F6-3*	54.7
C5-3	52.0	F6-4*	55.0
C5-4*	51.9	F7-1*	57.7
C5-5	52.3	F7-2*	57.6
C5-6	51.8	F7-3*	57.9
C5-7*	53.0	F7-4*	55.4
C5-8*	52.7	F7-5*	55.3
C5-9	53.9	F7-6*	55.9
C5-10*	54.0	F8-1	54.1
C6-1	50.8	F9-1	48.4
C6-2	52.4	F9-2*	52.1
C6-3	53.6	F9-3*	52.1

# Appendix F - Low Frequency Noise and Tonality Analysis

Report 640.10487-R1  
Page 2 of 8

Location	Predicted Noise Level, Leq dBC
C6-4	53.0
C7-1	52.3
C7-2	49.0
D4-1*	55.5
D4-2*	55.8
D4-3*	56.1
D4-4*	55.3
D4-5*	55.9
D4-6*	56.7
D4-7*	58.0
D4-8*	58.1
D4-9	56.1
D6-1*	56.6
D6-2*	56.1
D6-3*	56.3
D7-1	48.6
D7-2*	52.1
D7-3	52.2
D7-4	52.4
D7-5*	53.3
D7-6*	53.4
D7-7*	50.6
D8-4	49.3
E1-1	46.7
E2-1	49.8
E3-2*	57.1
E3-3*	57.5
E4-1*	57.6
E4-2*	57.5
E4-3*	57.6
E4-4*	57.2
E4-5*	56.9

Location	Predicted Noise Level, Leq dBC
F9-4*	50.5
F9-5*	50.5
F9-6*	50.7
F9-7*	49.6
G2-1	48.3
G2-2	47.2
G2-3	47.1
G4-1*	54.8
G6-1*	55.7
G6-2	53.5
G6-3	50.8
G9-1	47.6
G9-2*	47.4
G9-3	49.7
G9-4	46.6
G10-1	45.5
G10-2	45.9
G10-3	45.6
G10-4	45.8
G10-5	46.0
G10-7	46.1
G10-8	46.0
H6-1	49.9
H6-2	48.1
H6-3	49.9
H6-4	46.8
H6-5	46.8
H6-6	47.7
H7-1	51.2
H7-2	46.2
H8-1	47.0
H9-1*	51.1

The results of the SoundPLAN predicted levels showed that no receiver locations exceeded 60 dBC.

## Tonality

Tonality is assessed using the one-third octave field testing methodology. The table below shows the level of each one third octave band relative to its sidebands. Noise is said to be tonal when the one third octave band level exceeds the level of the adjacent sidebands on both sides by:

- **5 dB or more** if the centre frequency of the band containing the tone is above 400Hz
- **8 dB or more** if the centre frequency of the band containing the tone is 160 to 400Hz inclusive
- **15 dB or more** if the centre frequency of the band containing the tone is below 160Hz

The results presented in the tables below in each column are for either side-band, respectively.



# Appendix F - Low Frequency Noise and Tonality Analysis

Report 640.10487-R1

Page 4 of 8

Receiver	Frequency																						
	25	31	40	50	63	80	100	125	160	200	250	315	400	500	630	800	1 k	1.2 k	1.6 k	2 k	2.5 k	3.1 k	4 k
B3-4	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,4	-4,0	0,-1	1,3	-3,2	-2,3	-3,0	0,2	-2,3	-3,5	-5,9	-9,14	-14,18	-18,-44	44,0	0,0	0,0
B3-5	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,4	-4,0	0,-1	1,3	-3,2	-2,3	-3,0	0,2	-2,3	-3,5	-5,8	-8,13	-13,18	-18,-41	41,0	0,0	0,0
B5-5	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,1	1,2	-2,3	-3,5	-5,8	-8,13	-13,17	-17,28	-28,-60	60,0	0,0
B5-6	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,1	1,1	-1,2	-2,4	-4,7	-7,11	-11,14	-14,24	-24,-48	48,0	0,0
B5-7	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,1	1,1	-1,2	-2,4	-4,7	-7,11	-11,14	-14,24	-24,-47	47,0	0,0
B6-6	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,1	1,2	-2,3	-3,5	-5,8	-8,13	-13,17	-17,-34	34,0	0,0	0,0
B6-7	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,1	1,1	-1,3	-3,4	-4,7	-7,11	-11,15	-15,25	-25,-52	52,0	0,0
B6-8	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,1	1,1	-1,2	-2,4	-4,7	-7,11	-11,14	-14,24	-24,-48	48,0	0,0
B6-9	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,1	1,1	-1,2	-2,4	-4,7	-7,11	-11,14	-14,24	-24,-48	48,0	0,0
B6-10	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,1	1,1	-1,2	-2,4	-4,7	-7,11	-11,14	-14,24	-24,-46	46,0	0,0
B6-11	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,1	1,1	-1,2	-2,4	-4,7	-7,10	-10,13	-13,23	-23,-45	45,0	0,0
C2-3	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,2	-2,0	0,1	-1,-2	2,1	-1,1	-1,3	-3,5	-5,8	-8,11	-11,19	-19,27	-27,-53	53,0
C2-4	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,2	-2,1	-1,2	-2,1	1,1	-1,2	-2,3	-3,6	-6,9	-9,11	-11,20	-20,-33	33,0	0,0
C4-1	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,1	1,1	-1,2	-2,4	-4,6	-6,9	-9,12	-12,20	-20,-37	37,0	0,0
C4-2	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,1	1,2	-2,3	-3,5	-5,8	-8,12	-12,15	-15,24	-24,-50	50,0	0,0
C4-3	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,1	1,2	-2,3	-3,4	-4,7	-7,11	-11,14	-14,24	-24,-48	48,0	0,0
C4-4	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,1	1,2	-2,3	-3,4	-4,7	-7,11	-11,15	-15,24	-24,-46	46,0	0,0
C4-5	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,1	1,1	-1,2	-2,4	-4,7	-7,10	-10,12	-12,20	-20,-39	39,0	0,0
C4-6	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,1	1,1	-1,2	-2,4	-4,7	-7,10	-10,13	-13,21	-21,-39	39,0	0,0
C4-7	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,1	1,1	-1,2	-2,4	-4,7	-7,10	-10,12	-12,20	-20,-38	38,0	0,0
C4-8	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,1	1,1	-1,2	-2,3	-3,6	-6,8	-8,10	-10,18	-18,25	-25,-53	53,0
C4-9	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-2	2,2	-2,1	-1,2	-2,1	1,1	-1,2	-2,3	-3,6	-6,9	-9,12	-12,20	-20,28	-28,-59	59,0
C5-1	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,1	1,1	-1,2	-2,4	-4,6	-6,10	-10,13	-13,23	-23,-41	41,0	0,0
C5-2	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,1	1,1	-1,2	-2,4	-4,6	-6,10	-10,13	-13,22	-22,-40	40,0	0,0
C5-3	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,1	1,2	-2,3	-3,5	-5,8	-8,12	-12,15	-15,25	-25,-52	52,0	0,0
C5-4	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,1	1,1	-1,2	-2,3	-3,6	-6,10	-10,13	-13,22	-22,-38	38,0	0,0
C5-5	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,1	1,2	-2,3	-3,4	-4,8	-8,12	-12,15	-15,23	-23,-48	48,0	0,0
C5-6	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,2	-2,1	-1,2	-2,1	1,1	-1,2	-2,3	-3,6	-6,9	-9,12	-12,20	-20,27	-27,-59	59,0
C5-7	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,1	-1,2	-2,4	-4,6	-6,7	-7,13	-13,17	-17,23	-23,-49
C5-8	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,1	-1,2	-2,4	-4,6	-6,7	-7,12	-12,15	-15,22	-22,-42

# Appendix F - Low Frequency Noise and Tonality Analysis

Report 640.10487-R1

Page 5 of 8

Receiver	Frequency																						
	25	31	40	50	63	80	100	125	160	200	250	315	400	500	630	800	1 k	1.2 k	1.6 k	2 k	2.5 k	3.1 k	4 k
C5-9	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-2	2,2	-2,1	-1,2	-2,-1	1,1	-1,2	-2,3	-3,6	-6,9	-9,11	-11,18	-18,25	-25,-53	53,0
C5-10	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,2	-2,0	0,2	-2,-1	1,1	-1,1	-1,3	-3,5	-5,8	-8,9	-9,16	-16,22	-22,-42	42,0
C6-1	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,2	-2,1	-1,2	-2,-1	1,1	-1,2	-2,3	-3,5	-5,8	-8,11	-11,19	-19,26	-26,-55	55,0
C6-2	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,1	-1,2	-2,3	-3,5	-5,6	-6,11	-11,14	-14,19	-19,-35
C6-3	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,2	-2,0	0,1	-1,-2	2,1	-1,1	-1,2	-2,5	-5,7	-7,8	-8,15	-15,19	-19,-33	33,0
C6-4	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,2	-2,0	0,2	-2,-1	1,1	-1,2	-2,3	-3,5	-5,8	-8,10	-10,17	-17,23	-23,-45	45,0
C7-1	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,2	-2,1	-1,2	-2,-1	1,1	-1,2	-2,3	-3,6	-6,9	-9,11	-11,18	-18,25	-25,-53	53,0
C7-2	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,-1	1,1	-1,2	-2,4	-4,7	-7,10	-10,12	-12,20	-20,-42	42,0	0,0
D4-1	N/A	0,-4	4,-3	3,-9	9,2	-2,-6	6,3	-3,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,1	-1,2	-2,4	-4,5	-5,6	-6,12	-12,15	-15,21	-21,-38
D4-2	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,1	-1,2	-2,4	-4,5	-5,6	-6,12	-12,15	-15,22	-22,-38
D4-3	N/A	0,-5	5,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,1	-1,2	-2,4	-4,5	-5,7	-7,12	-12,16	-16,23	-23,-41
D4-4	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,1	-1,2	-2,4	-4,5	-5,6	-6,11	-11,13	-13,18	-18,-33
D4-5	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,2	-2,0	0,1	-1,-2	2,0	0,1	-1,2	-2,3	-3,5	-5,5	-5,10	-10,12	-12,17	-17,32
D4-6	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,2	-2,0	0,1	-1,-2	2,0	0,1	-1,2	-2,4	-4,5	-5,6	-6,11	-11,13	-13,19	-19,-31
D4-7	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,0	0,1	-1,3	-3,4	-4,5	-5,10	-10,12	-12,16	-16,31
D4-8	N/A	0,-4	4,-3	3,-9	9,2	-2,-6	6,3	-3,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,0	0,1	-1,3	-3,4	-4,5	-5,10	-10,12	-12,16	-16,30
D4-9	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,2	-2,0	0,1	-1,-2	2,1	-1,1	-1,2	-2,5	-5,7	-7,8	-8,14	-14,19	-19,27	-27,-56
D6-1	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,1	-1,2	-2,4	-4,6	-6,7	-7,13	-13,16	-16,24	-24,-44
D6-2	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,2	-2,0	0,1	-1,-2	2,0	0,1	-1,2	-2,4	-4,6	-6,8	-8,14	-14,19	-19,27	-27,-55
D6-3	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,2	-2,0	0,1	-1,-2	2,0	0,1	-1,2	-2,4	-4,6	-6,8	-8,14	-14,19	-19,27	-27,-54
D7-1	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,-1	1,1	-1,2	-2,4	-4,6	-6,9	-9,12	-12,20	-20,-41	41,0	0,0
D7-2	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,-1	1,1	-1,2	-2,3	-3,6	-6,9	-9,11	-11,19	-19,26	-26,-56	56,0
D7-3	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,2	-2,1	-1,2	-2,-1	1,1	-1,1	-1,3	-3,5	-5,7	-7,9	-9,16	-16,21	-21,-41	41,0
D7-4	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,2	-2,0	0,1	-1,-2	2,1	-1,1	-1,3	-3,5	-5,7	-7,8	-8,14	-14,19	-19,-35	35,0
D7-5	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,2	-2,0	0,1	-1,-2	2,1	-1,1	-1,2	-2,4	-4,6	-6,7	-7,13	-13,17	-17,25	-25,-53
D7-6	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,2	-2,0	0,1	-1,-2	2,0	0,1	-1,2	-2,4	-4,6	-6,7	-7,12	-12,16	-16,23	-23,-47
D7-7	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,-1	1,1	-1,2	-2,3	-3,6	-6,10	-10,13	-13,22	-22,-43	43,0	0,0
D8-4	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,4	-4,0	0,-1	1,3	-3,2	-2,3	-3,0	0,2	-2,4	-4,6	-6,9	-9,15	-15,19	-19,-45	45,0	0,0	0,0
E1-1	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,3	-3,1	-1,3	-3,0	0,2	-2,3	-3,5	-5,9	-9,14	-14,18	-18,-42	42,0	0,0	0,0
E2-1	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,-1	1,1	-1,2	-2,4	-4,7	-7,10	-10,13	-13,22	-22,-44	44,0	0,0
E3-2	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,1	-1,2	-2,3	-3,5	-5,5	-5,10	-10,13	-13,18	-18,33
E3-3	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,1	-1,1	-1,3	-3,4	-4,5	-5,10	-10,11	-11,14	-14,28

# Appendix F - Low Frequency Noise and Tonality Analysis

Report 640.10487-R1

Page 6 of 8

Receiver	Frequency																						
	25	31	40	50	63	80	100	125	160	200	250	315	400	500	630	800	1 k	1.2 k	1.6 k	2 k	2.5 k	3.1 k	4 k
E4-1	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,1	-1,2	-2,3	-3,4	-4,5	-5,10	-10,11	-11,16	-16,30
E4-2	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,1	-1,2	-2,3	-3,5	-5,5	-5,10	-10,12	-12,16	-16,32
E4-3	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,1	-1,1	-1,3	-3,4	-4,5	-5,10	-10,11	-11,16	-16,31
E4-4	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,1	-1,2	-2,3	-3,5	-5,6	-6,11	-11,14	-14,20	-20,-31
E4-5	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,1	-1,2	-2,4	-4,5	-5,6	-6,12	-12,15	-15,21	-21,-36
E4-6	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,1	-1,2	-2,4	-4,5	-5,6	-6,11	-11,13	-13,17	-17,32
E5-1	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,1	-1,2	-2,3	-3,5	-5,5	-5,11	-11,13	-13,19	-19,-27
E5-2	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,1	-1,2	-2,3	-3,5	-5,6	-6,11	-11,14	-14,20	-20,-30
E5-3	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,1	-1,2	-2,4	-4,5	-5,6	-6,11	-11,13	-13,19	-19,-34
E5-4	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,1	-1,2	-2,4	-4,6	-6,6	-6,12	-12,14	-14,20	-20,-36
E5-5	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,1	-1,2	-2,4	-4,6	-6,6	-6,12	-12,14	-14,20	-20,-37
E5-6	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,2	-2,0	0,1	-1,-2	2,0	0,1	-1,2	-2,4	-4,6	-6,7	-7,12	-12,15	-15,22	-22,-42
E6-1	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,1	-1,2	-2,4	-4,5	-5,6	-6,12	-12,15	-15,21	-21,-36
E6-2	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,1	-1,2	-2,3	-3,5	-5,6	-6,11	-11,14	-14,21	-21,-32
E7-1	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,3	-3,1	-1,2	-2,-1	1,2	-2,3	-3,4	-4,7	-7,11	-11,14	-14,23	-23,-50	50,0	0,0
E7-2	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,3	-3,1	-1,2	-2,-1	1,2	-2,3	-3,4	-4,7	-7,11	-11,14	-14,24	-24,-51	51,0	0,0
E8-1	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,4	-4,0	0,-1	1,3	-3,2	-2,3	-3,0	0,2	-2,3	-3,5	-5,9	-9,14	-14,18	-18,-40	40,0	0,0	0,0
E8-4	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,4	-4,0	0,-1	1,3	-3,1	-1,3	-3,0	0,2	-2,4	-4,6	-6,9	-9,15	-15,20	-20,-45	45,0	0,0	0,0
E8-5	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,4	-4,0	0,-1	1,3	-3,1	-1,2	-2,-1	1,2	-2,3	-3,4	-4,7	-7,12	-12,15	-15,26	-26,-57	57,0	0,0
E9-2	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,4	-4,0	0,-1	1,3	-3,2	-2,3	-3,0	0,2	-2,3	-3,5	-5,8	-8,13	-13,17	-17,-40	40,0	0,0	0,0
E9-4	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,-2	2,1	-1,2	-2,3	-3,6	-6,10	-10,13	-13,22	-22,-40	40,0	0,0
F2-1	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,-1	1,1	-1,2	-2,4	-4,7	-7,10	-10,13	-13,22	-22,-43	43,0	0,0
F2-2	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,-1	1,1	-1,2	-2,4	-4,7	-7,10	-10,14	-14,23	-23,-45	45,0	0,0
F2-3	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,-1	1,1	-1,2	-2,4	-4,6	-6,10	-10,12	-12,22	-22,-39	39,0	0,0
F2-4	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-2	2,2	-2,1	-1,2	-2,-1	1,1	-1,2	-2,3	-3,6	-6,9	-9,12	-12,21	-21,-37	37,0	0,0
F2-5	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,-1	1,1	-1,2	-2,4	-4,6	-6,10	-10,12	-12,21	-21,-38	38,0	0,0
F6-1	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,2	-2,0	0,1	-1,-2	2,0	0,1	-1,2	-2,4	-4,6	-6,7	-7,13	-13,16	-16,23	-23,-46
F6-2	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,1	-1,2	-2,4	-4,6	-6,7	-7,13	-13,16	-16,24	-24,-46
F6-3	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,1	-1,2	-2,4	-4,6	-6,7	-7,13	-13,17	-17,24	-24,-48
F6-4	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,1	-1,2	-2,4	-4,5	-5,6	-6,12	-12,15	-15,22	-22,-39
F7-1	N/A	0,-4	4,-3	3,-9	9,2	-2,-6	6,3	-3,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,0	0,1	-1,2	-2,3	-3,3	-3,7	-7,8	-8,10	-10,22
F7-2	N/A	0,-4	4,-3	3,-9	9,2	-2,-6	6,3	-3,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,0	0,1	-1,2	-2,3	-3,3	-3,8	-8,8	-8,11	-11,23

# Appendix F - Low Frequency Noise and Tonality Analysis

Report 640.10487-R1  
Page 7 of 8

Receiver	Frequency																						
	25	31	40	50	63	80	100	125	160	200	250	315	400	500	630	800	1 k	1.2 k	1.6 k	2 k	2.5 k	3.1 k	4 k
F7-3	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,0	0,1	-1,2	-2,3	-3,3	-3,7	-7,8	-8,10	-10,22
F7-4	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,1	-1,2	-2,3	-3,5	-5,6	-6,11	-11,14	-14,20	-20,-34
F7-5	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,2	-2,0	0,1	-1,-2	2,0	0,1	-1,2	-2,4	-4,5	-5,6	-6,11	-11,14	-14,20	-20,-35
F7-6	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,1	-1,1	-1,3	-3,4	-4,5	-5,10	-10,11	-11,16	-16,30
F8-1	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,2	-2,1	-1,2	-2,-1	1,1	-1,1	-1,3	-3,5	-5,7	-7,8	-8,14	-14,19	-19,-33	33,0
F9-1	N/A	0,-4	4,-3	3,-9	9,2	-2,-6	6,2	-2,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,1	-1,2	-2,4	-4,6	-6,8	-8,14	-14,19	-19,27	-27,-60
F9-2	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,2	-2,0	0,2	-2,-1	1,1	-1,1	-1,3	-3,5	-5,7	-7,8	-8,15	-15,19	-19,-36	36,0
F9-3	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,2	-2,0	0,2	-2,-2	2,1	-1,1	-1,3	-3,5	-5,7	-7,8	-8,15	-15,20	-20,-37	37,0
F9-4	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,2	-2,0	0,1	-1,-2	2,0	0,1	-1,2	-2,5	-5,7	-7,8	-8,15	-15,20	-20,-36	36,0
F9-5	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,2	-2,0	0,1	-1,-2	2,1	-1,1	-1,3	-3,5	-5,7	-7,9	-9,15	-15,20	-20,-41	41,0
F9-6	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,2	-2,0	0,2	-2,-2	2,1	-1,1	-1,3	-3,5	-5,7	-7,9	-9,16	-16,21	-21,-42	42,0
F9-7	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,2	-2,0	0,1	-1,-2	2,1	-1,1	-1,3	-3,5	-5,7	-7,9	-9,15	-15,20	-20,-42	42,0
G2-1	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,-1	1,2	-2,3	-3,4	-4,7	-7,11	-11,14	-14,24	-24,-50	50,0	0,0
G2-2	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,4	-4,0	0,-1	1,3	-3,1	-1,2	-2,-1	1,2	-2,3	-3,4	-4,7	-7,11	-11,15	-15,24	-24,-56	56,0	0,0
G2-3	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,4	-4,0	0,-1	1,3	-3,1	-1,2	-2,-1	1,2	-2,3	-3,4	-4,8	-8,11	-11,15	-15,24	-24,-57	57,0	0,0
G4-1	N/A	0,-4	4,-3	3,-9	9,2	-2,-6	6,2	-2,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,0	0,1	-1,3	-3,3	-3,3	-3,7	-7,8	-8,10	-10,23
G6-1	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,0	0,1	-1,3	-3,4	-4,5	-5,10	-10,12	-12,17	-17,32
G6-2	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,1	-1,0	0,1	-1,-2	2,0	0,1	-1,2	-2,3	-3,5	-5,6	-6,12	-12,15	-15,22	-22,-41
G6-3	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,2	-2,0	0,1	-1,-2	2,0	0,1	-1,2	-2,4	-4,6	-6,7	-7,14	-14,19	-19,27	-27,-60
G9-1	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-2	2,2	-2,1	-1,2	-2,-1	1,1	-1,2	-2,4	-4,7	-7,11	-11,14	-14,24	-24,-49	49,0	0,0
G9-2	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-1	1,2	-2,1	-1,2	-2,-1	1,1	-1,2	-2,4	-4,6	-6,10	-10,13	-13,21	-21,-42	42,0	0,0
G9-3	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,2	-2,1	-1,2	-2,-1	1,1	-1,2	-2,4	-4,7	-7,11	-11,14	-14,23	-23,-46	46,0	0,0
G9-4	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,-1	1,1	-1,3	-3,4	-4,7	-7,11	-11,14	-14,24	-24,-52	52,0	0,0
G10-1	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,-1	1,2	-2,3	-3,5	-5,8	-8,12	-12,15	-15,25	-25,-58	58,0	0,0
G10-2	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,-1	1,2	-2,3	-3,5	-5,8	-8,12	-12,16	-16,26	-26,-59	59,0	0,0
G10-3	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,-1	1,2	-2,3	-3,5	-5,8	-8,12	-12,15	-15,25	-25,-58	58,0	0,0
G10-4	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,-1	1,2	-2,3	-3,4	-4,8	-8,12	-12,15	-15,25	-25,-58	58,0	0,0
G10-5	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,-1	1,2	-2,3	-3,5	-5,8	-8,12	-12,15	-15,25	-25,-59	59,0	0,0
G10-7	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,-1	1,2	-2,3	-3,5	-5,8	-8,12	-12,16	-16,26	-26,-59	59,0	0,0
G10-8	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,-1	1,2	-2,3	-3,5	-5,8	-8,12	-12,15	-15,26	-26,-59	59,0	0,0
H6-1	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,-1	1,1	-1,2	-2,4	-4,6	-6,10	-10,13	-13,22	-22,-40	40,0	0,0
H6-2	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,3	-3,1	-1,2	-2,-1	1,2	-2,3	-3,4	-4,8	-8,12	-12,16	-16,-33	33,0	0,0	0,0

## Appendix F - Low Frequency Noise and Tonality Analysis

Report 640.10487-R1  
Page 8 of 8

Receiver	Frequency																						
	25	31	40	50	63	80	100	125	160	200	250	315	400	500	630	800	1 k	1.2 k	1.6 k	2 k	2.5 k	3.1 k	4 k
H6-3	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,2	-2,0	0,1	-1,-2	2,1	-1,1	-1,3	-3,5	-5,7	-7,9	-9,16	-16,22	-22,-43	43,0
H6-4	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,4	-4,0	0,-1	1,3	-3,1	-1,3	-3,0	0,2	-2,3	-3,5	-5,8	-8,13	-13,16	-16,-38	38,0	0,0	0,0
H6-5	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,4	-4,0	0,-1	1,3	-3,2	-2,3	-3,0	0,2	-2,3	-3,5	-5,9	-9,13	-13,17	-17,-41	41,0	0,0	0,0
H6-6	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,-1	1,2	-2,3	-3,4	-4,8	-8,12	-12,16	-16,26	-26,-58	58,0	0,0
H7-1	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,2	-2,0	0,1	-1,-2	2,0	0,1	-1,2	-2,4	-4,6	-6,7	-7,12	-12,15	-15,21	-21,-47
H7-2	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,-1	1,2	-2,3	-3,5	-5,8	-8,13	-13,17	-17,-36	36,0	0,0	0,0
H8-1	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,0	0,-1	1,2	-2,1	-1,2	-2,-1	1,1	-1,2	-2,4	-4,7	-7,10	-10,13	-13,23	-23,-48	48,0	0,0
H9-1	N/A	0,-4	4,-3	3,-9	9,2	-2,-5	5,3	-3,-1	1,-2	2,2	-2,0	0,2	-2,-1	1,1	-1,2	-2,3	-3,5	-5,9	-9,11	-11,19	-19,26	-26,-54	54,0